

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE

NEW DELHI-110 001.


No. F6/DAS/MS/2011/1917

Dated: 09/08/11

FIRE SAFETY CERTIFICATE

Certified that the **TITIKSHA PUBLIC SCHOOL** at **Sector-11, Rohini, Delhi-110085** comprised of ground and three upper floors was issued NOC vide this office letter No. F.6/MS/DFS/2003/3185 dated 31/12/2003. The premises was re-inspected by the Officer concerned of this department on 20/7/2011 in the presence of **Mr. R.K. Gupta, Teacher** and observed that all the fire safety and fire prevention arrangement are provided in the premises found in good working condition and there is no additional construction. The premises have therefore deemed complied with the requirement under Rule 33 of the Delhi Fire Service Rules, 2010 and building/premises is fit for occupancy under **Educational Class** with effect from 09/08/11 for a period of **03 (Three) years** in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rule, 2010.

Issued on 09/08/11 at New Delhi by


7/8
Chief Fire Officer
for Director
Delhi Fire Service

C.C

1. Shri M.L. Gupta, Manager
Titiksha Public School,
Sector-11, Rohini,
Delhi-110085
2. The Director (Education)
Old Sectt., Civil lines, Delhi



Conditions for the validity of fire safety certificate:-

- a) All the fire safety means of escape facilities shall be maintained in good conditions at all time. Any lapse rendering fire safety or means of evacuation facilities rendering non functional shall be responsibility of the management.
- b) Building sanctioning authority may verify any deviation with regard to the construction/occupancy in the building. In case of any deviation, the fire safety certificate stands null and void.
- c) The staff shall be trained for operating fire fighting system and mock evacuation drills be conducted at regular intervals and record be maintained.

SCHOOL, Sector-11, Rohini, Delhi-110085, regarding the renewal of NOC from fire safety and fire prevention point of view. In this connection the premises was inspected by the undersigned in the presence of Shri R.K.. Gupta, Teacher on 20.07.2011 as per the Delhi Fire Service Act, 2007 and Delhi Fire Service Rules, 2010.

During the course of inspection it has been observed that the school is running in a ground plus three upper floors and having a total area of 16230 square meters and building is constructed on an area of 6,324 square meters approximately situated on approachable road and easily assessable for fire engine. Two numbers of staircases are provided by the school authority of width 160 cms each and two ramps are also provided.. All the class rooms have less than 45 children and have Single door of width 105 cms..

As regards to the fire protection arrangements, the status is as under:


S. No.	Fire Safety Provision	Provided / Not Provided
1.	Access to building	Fire Engine is accessible
2.	Number, width type and arrangement of exits	Two staircases of width 160 cms each are provided and two ramps are also provided.
3.	Protection of Exits by means of fire check door (s) and or pressurization	Not required
4.	Compartmentation	Not required
5.	Smoke Managements System	Not required
6.	Fire Extinguishers	Provided
7.	Fire Aid Hose Reels	Provided
8.	Automatic Fire detection and alarming system	Provided
9.	MOEF A	Not required
10.	Public Address System	Provided
11.	Automatic Sprinkler System	Not required
12.	Internal Hydrants and Yard Hydrants	Not required
13.	Pumping Arrangements	900 lpm pump is provided at the terrace and jockey pump of 180 lpm
14.	Captive Water Storage for fire fighting	Over head tank of 10,000 liters and underground tank of 50000 liters are provided
15.	Exit Signage	Provided
16.	Provision of lifts	Not required
17.	Standby power Supply	Not required
18.	Refuge Area	Not required
19.	Fire Control Room	Not required
20.	Special Fire Protection Systems for Protection of Special Risks	Not required

DFA Merge



Part to put up for Synthesis

Left →

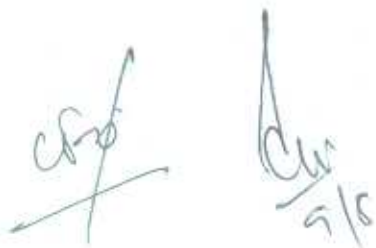

MC