

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI - 110001**


No. F6/DFS/MS/ school/2012/1994

Dated: 31/05/12

FIRE SAFETY CERTIFICATE

Certified that **M.C. Primary Co-Education School, Masihgarh (Central Zone), New Delhi**, comprised of ground plus one upper floor only **Owned/Occupied** by M.C. Primary Co-Education School have complied with the fire prevention and fire safety requirements in accordance with Directorate of Education Circular No. F.16/Estate/CC/Fire Safety/2011/3298-3398 dated 01/03/2011 and Rule 33 of the Delhi Fire Service Rules, 2010 and verified by officer concerned of Delhi Fire Service on 19.05.2012 in the presence of Mr./Miss/Mrs. Sehgufta Khurshid, Principal of the school and that the building/premises is fit for occupancy class-B "Educational building" with effect from 31/05/12 for a period of **THREE** years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rule 2010.

Issued on 31/05/12 at New Delhi by



CHIEF FIRE OFFICER
For DIRECTOR
DELHI FIRE SERVICE

Copy To: -

1. The Directorate of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi.
2. The Principal, MC Primary Co-Education School, Masihgarh (Central Zone), New Delhi.

Conditions for the validity of fire safety Certificate

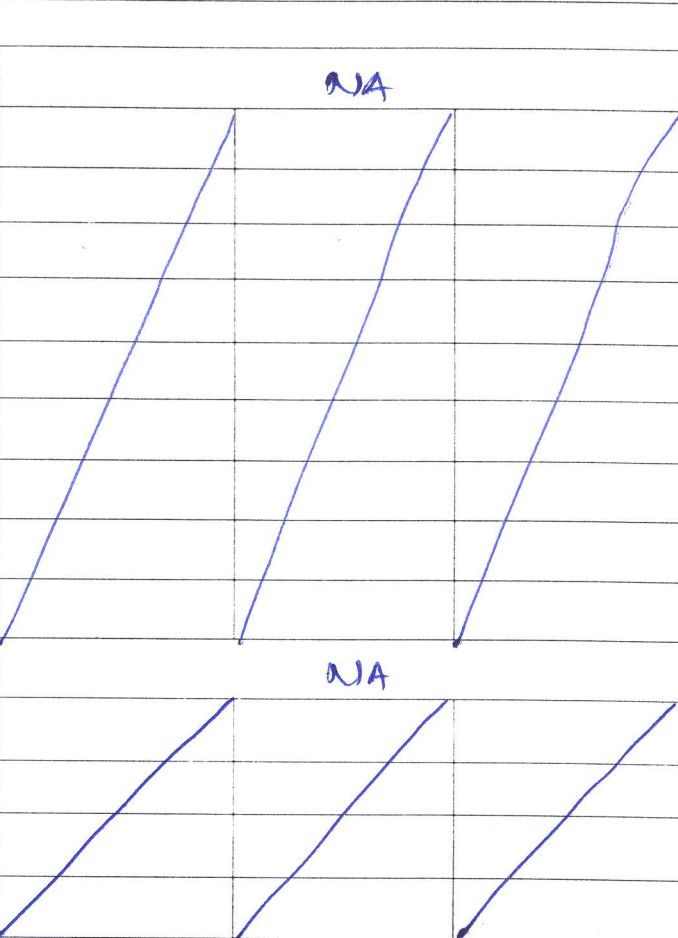
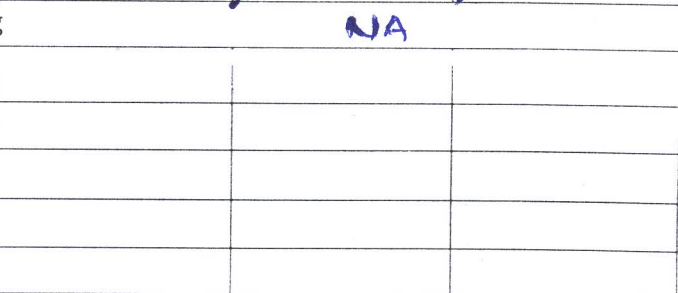
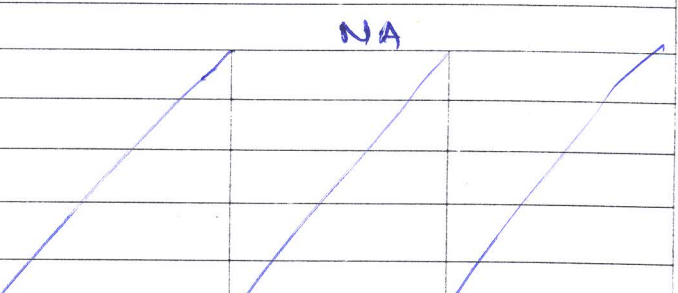
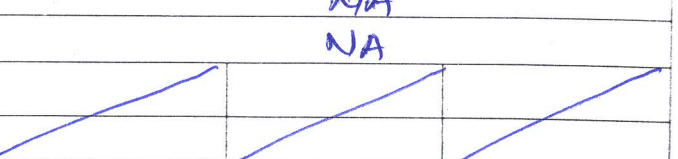
1. All the Fire Safety and means of escape facilities shall be maintained in good working conditions at all time. Any lapse rendering fire safety or means of evacuation facilities non-functional shall be the responsibility of the management.
2. Building Sanctioning Authority may verify any deviation with regard to the construction/occupancy in the building. In case of any deviation, the fire safety certificate stands null and void.
3. The staff shall be trained for operating fire fighting system and mock evacuation drills be conducted at regular intervals and record be maintained.
4. The Basement shall be used strictly as per the provisions of Building Bye Laws.
5. The owner/occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in

INSPECTION REPORT

1. Name and address of the building: M.C. Primary Co-Ed. School.
: Mashgarh (Central zone), New Delhi-25
2. Type of Occupancy : Educational
3. Type of Case : New.
4. Details of previous NOC : Nil
5. Fire Safety directives letter No : Nil Dated: _____
6. Date of Inspection : 19.05.2012
7. Name of the Inspecting Officers : Rajan Wadehra, ADO/Mrd.
8. Name and designation of Officers
From the building side : Ms. Sehnappa Khursid, Principal
9. Year of Construction : _____
(Ground Plus one upper floor)
10. Applicant's letter No : Nil

S. No.	Minimum Standards on Fire Prevention and Fire Safety U/R 33	NBC Requirement	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	15 MB	15 MB	✓ M/R
	• Gate width	NA	NA	NA
	• Width of internal road	NA	NA	NA
2	Number, Width, Type & Arrangement of Exits			
	• Number of staircase			
	➤ Upper Floors	ONE	TWO	✓ M/R
	➤ Basements	NA	NA	NA
	• Width of Staircases			
	➤ Upper Floors	1.5 MB	1.55 MB	✓ M/R
	➤ Basements	NA	NA	NA
	• Protection of exits		NA	
	➤ Fire check door			
	➤ Pressurization			
	• No. of continuous staircases to terrace		NA	
	• Width of Corridor			
	• Door Size			

3	Compartmentation				NA
	<ul style="list-style-type: none"> • Fire check door • Sealing of electrical shafts • Fire rating of shaft door • Water curtain • Fire Dampers 				
4	Smoke Management System				NA
	<ul style="list-style-type: none"> • Basements • Upper Floors 	30 a/c Per hour	12 a/c Per hour		
5	Fire Extinguishers				
	<ul style="list-style-type: none"> • Total Number • Types • IS marking 	01/300 ml	ISI mark	Six Nos ✓	M/R M/R M/R
6	Firs-Aid Hose Reels				NA
	<ul style="list-style-type: none"> • Total Number on each floor • Length of hose reel hose • Nozzle diameter 	_____	30 m 5mm		
7	Automatic Fire detection and alarming system				NA
	<ul style="list-style-type: none"> • Type of detectors • Location of Main Panel • Location of Repeater Panel • Alternate source of power • Hooter's Location 				
8	MOEFA				NA
9	Public Address System				NA
10	Automatic Sprinkler System				NA
	<ul style="list-style-type: none"> • Basement • Upper Floor • Sprinkler above false ceiling 				
11	Internal Hydrants				NA
	<ul style="list-style-type: none"> • Size of riser/down comer • Number of hydrants per floor • Hose Box 				
12	Yard Hydrants				NA
	<ul style="list-style-type: none"> • Total Number of hydrants • Hose Box 				

13	Pumping Arrangements	<ul style="list-style-type: none"> • Ground Level <ul style="list-style-type: none"> ➤ Number of main pump ➤ Discharge of main pump ➤ Head of main pump ➤ Jockey pump out put ➤ Jockey pump Head ➤ Standby pump out put ➤ Standby Pump Head ➤ Auto Starting/Manual ➤ Pump House Access • Terrace level <ul style="list-style-type: none"> ➤ Discharge of pump ➤ Head of the pump ➤ Power Supply ➤ Auto starting /manual 
14	Captive Water Storage for Fire Fighting	<ul style="list-style-type: none"> • Underground tank capacity <ul style="list-style-type: none"> ➤ Draw-off connection ➤ Fire service inlet ➤ Access to tank • Overhead tank capacity 
15	Exit Signage	NA
16	Provision of Lifts	<ul style="list-style-type: none"> • Pressurization of Lift Shaft • Pressurization of Lift lobby • Communication in lift Car • Fireman's Grounding Switch • Lift Signage 
17	Standby Power Supply	NA
18	Refuge Area	<ul style="list-style-type: none"> • Total Area • Location 
19	Fire Control Room	<ul style="list-style-type: none"> • Detector System Panel • Flow Switch Panel • PA System Panel • Battery back up • Building Floor Plans 