

FORM 'H' FORM FOR ISSUING FIRE SAFETY CERTIFICATE

{SEE SUB -RULE (1) OF RULE 35}

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI - 110001**

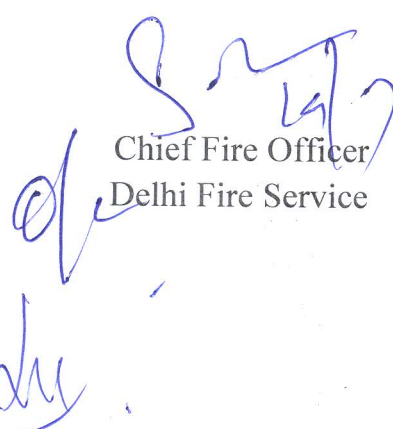
NO. F.6/DFS/MS/2012/2631

DATED: 20.07.2012

FIRE SAFETY CERTIFICATE

Certified that the M/s Pacific Banquets located at 3rd Floor, Pacific Metro Mall, Near Subhash Nagar Metro Station, Khyala, New Delhi comprised have complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rule, 2010 and verified by the officer concerned of Delhi Fire Service on 14.06.2012 in the presence of Sh.Sunil Munshi of the banquet hall and that the premises is fit for occupancy Class Group Assembly (Banquet) with effect from the issuance of this certificate for a period of three years in accordance with rule 36 unless renewed under rule 37 of sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010, printed overleaf.

Issued on 20/07/12 at New Delhi.


Chief Fire Officer
Delhi Fire Service

C.C to:-

1. Dy. Health Officer(West Zone),
SDMC, Rajouri Garden, New Delhi
2. Sh. Sunil Munshi, M/S Pacific Banquet,
3rd Floor, Pacific Metro Mall,
Near Subhash Nagar Metro Station.New Delhi.

Note: - conditions overleaf may also be taken care of.

Following fire safety directives must be adhered to:-

- 1) All the fire safety arrangement provided their in shall be maintained in good working g conditions at all time.
- 2) Loss of life or property due to non-functional fire safety measure shall be at the responsibility of the management.
- 3) The trained fire fighting staff should be available round the clock.
- 4) Any deviation, with regards to construction etc shall be verified b y the concerned building sanctioning agency.
- 5) The basement shall be used strictly as per the provision of building Bye-Laws.
- 6) This certificate cannot be treated in any case for regularizations of unauthorized construction unauthorized use of land if any.
- 7) The owner/occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. This is available on www.dfs.delhigovt.nic.in

May Kindly peruse letter no. D-796/HD/WZ/2012 dated 28/05/2012 received from DHO (West Zone regarding issue of NOC in favor of their M/s Pacific Banquets located at 3rd floor Pacific Metro Mall, Near Subhash Nagar Metro Station, Khayala, New Delhi. Accordingly premises was inspected & observed that the building comprised of lower & upper basement with ground plus four upper floors. All the fire safety arrangements for the mall has been extended to the Banquet Hall. Third floor has already been marked for restaurant & kitchen etc. hence the occupancy is not changing as the Banquet Hall falls under assembly occupancy. Detail are put up on prescribed Performa.

1. Name & address of the building : **M/s Pacific Banquets** located at 3rd floor Pacific Metro Mall, Near Subhash Nagar Metro Station, Khayala, New Delhi
2. Type of Occupancy : Class-Assembly (Banquet)
3. Type of Case : New
4. Details of previous NOC : F6/DFS/MS/2010/3350 dated 15/12/2010 for Mall
5. Fire Safety directives letter No. : N.A.
6. Date of inspection : 14.06.2012
7. Name of the Inspecting Officers : A.D.O. S.S. Tuli & D.O. Sunil Chawdhary
8. Name and designation of officers
From the building side : Sh. Sunil Muni
9. Year of Construction :
10. Applicant's letter No. : D-796/HD/WZ/2012 dated 28/05/2012

INSPECTION REPORT

Point wise fire safety arrangements/equipments are mentioned as under:-

S. No.	Minimum Standards on fire Prevention and fire safety U/R 33	NBC Requirement	Provided at site	Remarks MR/NMR
1.	Access to building			
	• Road width	12mtrs	60 mtr	M/R
	• Gate width	5 mtr	6 mtr	M/R
	• Width of internal road	6 mtr	12 mtr	M/R
2.	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	• Upper Floors	11	11	M.R

	<ul style="list-style-type: none"> Basement 	22	22	M.R. ✓
b.	Width of staircases	1.5 mtr	Provided	M.R. ✓
	<ul style="list-style-type: none"> Upper Floors 	1.5 mtr	Provided	M.R. ✓
	<ul style="list-style-type: none"> Basement 	1.5 mtr	Provided	M.R. ✓
c.	Protection of exits	Required	Provided	M.R. ✓
	<ul style="list-style-type: none"> Fire check door 	Required	Provided	M.R.
	<ul style="list-style-type: none"> Pressurization 	Required	Provided	M.R. ✓
d.	No. of continuous staircases to terrace	11	11	M.R.
e.	Width of Corridor	2 mtr	Provided	M.R. ✓
f.	Door size	2 mtrs for Banquet	Provided	M.R. ✓
3.	Compartmentation.			
	<ul style="list-style-type: none"> Fire check door 	Required for Banquet	P. for Banquet	M.R. ✓
	<ul style="list-style-type: none"> Sealing of electrical shafts 	Required “ “	Provided “ “	M.R. ✓
	<ul style="list-style-type: none"> Fire Rating of shaft door 	Required “ “ “	Provided “ “	M.R. ✓
	<ul style="list-style-type: none"> Water Curtain 	Required “ “	Provided “ “	M.R.
	<ul style="list-style-type: none"> Fire Dampers 	Required “ “	Provided “ “	M.R. ✓
4.	Smoke Management System.			
	<ul style="list-style-type: none"> Basements 	Required	Provided	M.R. ✓
	<ul style="list-style-type: none"> Upper floors 	Required	Provided	M.R. ✓
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> Total numbers 	20	25	M.R. ✓
	<ul style="list-style-type: none"> Types 	DCP & CO ₂ Required required	provided	M.R. ✓
	<ul style="list-style-type: none"> IS marking 			

	<ul style="list-style-type: none"> Types IS marking 	DCP & CO ₂ Required	provided	M.R
		required	provided	M.R
6.	First-Aid Hose Rees.			
	<ul style="list-style-type: none"> Total numbers on each floor 	13	4 for Banquet	M.R
	<ul style="list-style-type: none"> Length of hose reel hose 	30 m required	Provided	M.R
	<ul style="list-style-type: none"> Nozzle diameter 	5 mm required	provided	M.R
7.	Automatic fire detection and alarming system.			
	<ul style="list-style-type: none"> Type of detectors 	Smoke & Heat	Provided	M.R
	<ul style="list-style-type: none"> Location of Main Panel 	Ground floor	Provided	M.R
	<ul style="list-style-type: none"> Location of Repeater Panel 	At each floor	Provided	M.R
	<ul style="list-style-type: none"> Alternate source of power 	Required	Provided	M.R
	<ul style="list-style-type: none"> Hooter's Location 	Required	Provided	M.R
8.	MOEFA	Required	Provided	M.R
9.	Public Address System.	Required	Provided	M.R
10.	Automatic Sprinkler system			
	<ul style="list-style-type: none"> Basement 	Required	Provided	M.R
	<ul style="list-style-type: none"> Upper Floor 	Required	Provided	M.R
	<ul style="list-style-type: none"> Sprinkler above false ceiling 	Required	Provided	M.R
11.	Internal Hydrants			
	<ul style="list-style-type: none"> Size of riser/down-comer 	150 mm	Provided	M.R

	<ul style="list-style-type: none"> Number of hydrants per floor 	13	Provided	M.R.
	<ul style="list-style-type: none"> Hose Box 	13	Provided	M.R.
12.	Yard Hydrants.			
	<ul style="list-style-type: none"> Total number of hydrants 	Required	Provided	M.R.
	<ul style="list-style-type: none"> Hose Box 	Required	Provided	M.R.
13.	Pumping Arrangements.			
	Ground Level			
	➤ Discharge of main pump	2850 LPM	Provided	M.R.
	➤ Head of Main pump	60 mtr	Provided	M.R.
	➤ Number of main pumps	2	Provided	M.R.
	➤ Jockey Pump out put	180 LPM	Provided	M.R.
	➤ Jockey pump head	60 mtr	Provided	M.R.
	➤ Standby pump out put	2850 LPM	Provided	M.R.
	➤ Standby pump Head	60 mtr	Provided	M.R.
	➤ Auto Starting/Manual stopping	Required	Provided	M.R.
	➤ Pump Hose Access	Required	Provided	M.R.
	Terrace level			
	➤ Discharge of pump	N.R.	N.P.	N.R.
	➤ Head of the pump	N.R.	N.P.	N.R.
	➤ Power supply	N.R.	N.P.	N.R.

	➤ Auto Starting of pump	N.R.	N.P.	N.R.
14.	Captive Water Storage for fire fighting.			
	Underground tank capacity	2,00,000 ltrs	provided	M.R
	➤ Draw -off connection	Required	Provided	M.R
	➤ Fire service inlet	Required	Provided	M.R
	➤ Access to tank	Required	Provided	M.R
	➤ Overhead Tank Capacity	20,000 ltrs	Provided	M.R
15	Exit Signage.	Required	Provided	M.R
16.	Provision of Lifts			
	• Pressurization of Lift Shaft	Required	Provided	M.R
	• Pressurization of Lift lobby	Required	Provided	M.R
	• Communication In lift Car	Required	Provided	M.R
	• Fireman's Grounding Switch	Required	Provided	M.R
	• Lift Signage	Required	Provided	M.R
17.	Standby power supply	Required	Provided	M.R
18.	Refuge Area			
	➤ Total Area	Not Required for the Banquet	Provided for the Banquet	M.R.
	➤ Location	Not Required for the Banquet	Provided for the Banquet	M.R.
19.	Fire Control Room			
	➤ Detector System Panel	Required	Provided	M.R

	➤ Flow Switch Panel	Required	Provided	M.R ✓
	➤ PA system Panel	Required	Provided	M.R ✓
	➤ Batter backup	Required	Provided	M.R ✓
	➤ Building Floor plans	Required	Provided	M.R ✓
20.	Special Fire Protection Systems for Protection of special Risks, if any:	N.A.	N.A.	Not applicable ✓

The fire protection systems provided in the building were test checked and found functional at the time of inspection. Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules 2010/

Signature of the Inspection Officer

Signature of the Inspection Officer

Name

S.S. Tuli

Name

Designation

ADD (MN)

Designation