

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001.**


No. F6/DFS/MS/INDU/2012/3244

Dated 05/09/12

FIRE SAFETY CERTIFICATE

Certified that M/s Vinty Impex Pvt Ltd, Plot No. A-57, Okhla Industrial Area Phase-1, New Delhi, comprised of basement, ground plus two upper Floors **Owned/Occupied** by Vinty Impex Pvt. Ltd. was granted NOC by this department vide letter No. F.6/MS/DFS/2006/1981 dated 09.08.2006. The premises was re-inspected by the officer concerned of Delhi Fire Service on 07.06.2012 in the presence of Mr. Alok Shukla, Civil Engineer and observed that fire safety norms as required under Rule 33 of Delhi Fire Service Rules, 2010 are deemed complied and that the building/premises is fit for occupancy class-G "**Industrial building**" with effect from5/9/12..... for a period of **Three years** in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rule, 2010.

Issued on5/9/12..... at New Delhi by



CHIEF FIRE OFFICER
DELHI FIRE SERVICE

(Handwritten initials)

Copy to:

1. The Executive Engineer (Bldg.), Building Department (HQ), MCD, Town hall, New Delhi.
2. Authorised Signatory, Vinty Impex Pvt Ltd, A-57, Okhla Indl. Area Phase-1, New Delhi.

Conditions for the validity of Fire Safety Certificate

- 1) All the Fire Safety and means of escape facilities shall be maintained in good working conditions at all time. Any lapse rendering fire safety or means of evacuation facilities non-functional shall be the responsibility of the management.
- 2) Building Sanctioning Authority may verify any deviation with regard to the construction/occupancy in the building. In case of any deviation, the fire safety certificate stands null and void.
- 3) The staff shall be trained for operating fire fighting system and mock evacuation drills be conducted at regular intervals and record be maintained.
- 4) The Basement shall be used strictly as per the provisions of Building Bye Laws.
- 5) The owner/occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in

INSPECTION REPORT

N/4 Encl-8021
FSC

1. Name and address of the building	: M/S VINTY IMPEX PVT. LTD. : A-57, OKHLA INDL. AREA : PHASE - I, NEW DELHI
2. Type of Occupancy	: INDUSTRIAL
3. Type of Case	: OLD/RENEWAL
4. Details of previous NOC	: EG/MS/DFS/2006/1981 Dt. 09.08.2006
5. Fire Safety Directives letter No	: FG/DFS/MS/BP/2642 dt. 11/11/04
6. Date of Inspection	: 07.06.2012 / 2004
7. Name of the Inspecting Officer	: SH. RAJAN WADEHRA, ADO/MRD.
8. Name and designation of the Officers from the building side	: SH. ALOK SHUKLA, CIVIL ENGG.
9. Year of Construction	: 92 - 93
10. Applicant's letter No.	: NIL.

S. No.	Minimum Standards on Fire Prevention and Fire Safety U/R 33	NBC Requirement	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	15 MTS	16 MTS	MR
	• Gate width	5 MTS	5 MTS	MR
	• Width of internal road	NA	NA	NA
2	Number, Width, Type & Arrangement of Exits			
	• Number of Staircase			
	➤ Upper floors	2	2	MR
	➤ Basement	2	2	MR
	• Width of Staircase			
	➤ Upper floors	1.25 MTS	1.30 each	MR
	➤ Basement	1.25 MTS	1.20 each	MR
	• Protection of Exits			
	➤ Upper floors	Required	Provided	MR
	➤ Basement	Required	Provided	MR
	• No of Continuous Staircases to terrace	1	1	MR
	• Width of Corridor	NA	NA	NA
	• Door Width	NA	NA	NA

N/S

3	Compartmentation			
	<ul style="list-style-type: none"> • Fire check door • Sealing of electrical shafts • Fire rating of shaft door • Water curtain • Fire Dampers 		NA	
4	Smoke Management System			
	<ul style="list-style-type: none"> • Basements • Upper Floors 	30 a/c Per hour	Provided	MR
		12 a/c Per hour	Provided	MR
5	Fire Extinguishers			
	<ul style="list-style-type: none"> • Total Number • Types • IS marking 	16 / 300 m ² ABC / CO ₂ ISI mark	Provided ABC - 08 Nos CO ₂ - 08 Nos YES	M/R M/R M/R
6	First-Aid Hose Reels			
	<ul style="list-style-type: none"> • Total Number on each floor • Length of hose reel hose • Nozzle diameter 	6 / Per Floor 30 m 5mm	Provided Provided Provided	MR MR MR
7	Automatic Fire Detection and Alarming System			
	<ul style="list-style-type: none"> • Type of detectors • Location of Main Panel • Location of Repeater Panel • Alternate source of power • Hooter's Location 	NA NA NA 950 KVA NA	NA Provided Provided at G/F NA 950 KVA NA	NA NA NA NA NA
8	MOEFA			
		Required	Provided	MR
9	Public Address System			
		NA		
10	Automatic Sprinkler System			
	<ul style="list-style-type: none"> • Basement • Upper Floor • Sprinkler above false ceiling 	Required Required NA	Provided Provided NA	MR MR NA
11	Internal Hydrant			
	<ul style="list-style-type: none"> • Size of riser/down comer • Number of hydrants per floor • Hose Box 	150 MM 2 Nos 2 Nos	150 MM 2 Nos 2 Nos	MR MR MR
12	Yard Hydrant			
	<ul style="list-style-type: none"> • Total Number of hydrants • Hose Box 	2 Nos Required 2 Nos Required	Provided Provided	MR MR


13	Pumping Arrangements			
	Ground Level			
	➤ Number of main pump	1	1	MR
	➤ Discharge of main pump	2280 LPM	2280	MR
	➤ Head of main pump	70 mts	70 mts	MR
	➤ Jockey pump out put	450 LPM	450 LPM	MR
	➤ Jockey pump Head	70 mts	70 mts	MR
	➤ Standby pump out put	2280 LPM	2280 LPM	MR
	➤ Standby Pump Head	70 mts	70 mts	MR
	➤ Auto Starting/Manual stopping	Auto	Auto	MR
	➤ Pump House Access	Required	Provided	MR
	Terrace level			
	➤ Discharge of pump	950 LPM	950 LPM	MR
	➤ Head of the pump	40 mts	40 mts	MR
	➤ Power Supply	950 kVA	950 kVA	MR
	➤ Auto starting /Manual stopping	Auto	Auto	MR
14	Captive Water Storage for Fire Fighting			
	• Underground tank capacity	25,000 Lts	25,000 Lts	MR
	➤ Draw-off connection	Required	Provided	MR
	➤ Fire service inlet	Required	Provided	MR
	➤ Access to tank	Required	Provided	MR
	• Overhead tank capacity	15,000 Lts	15,000 Lts	MR
15	Exit Signage	Required	Provided	MR
16	Provision of Lifts	NA		
	<ul style="list-style-type: none"> • Pressurization of Lift Shaft • Pressurization of Lift lobby • Communication in lift Car • Fireman's Grounding Switch • Lift Signage 			
17	Standby Power Supply	950 kVA	950 kVA	
18	Refuge Area	NA		
	<ul style="list-style-type: none"> • Total Area • Location 			
19	Fire Control Room	NA		
	<ul style="list-style-type: none"> • Detector System Panel • Flow Switch Panel • PA System Panel • Battery back up • Building Floor Plans 			

20	Special Fire Protection system for Protection of special risk, if any	4 ABC FIRE	Provided	m.
----	---	------------	----------	----


The Fire protection systems provided in the building were test checked and found functional at the time of inspection.

Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules , It is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules 2010 / issue shortcomings as noted at serial Number.....

Signature of Inspecting Officer
 Name :
 Designation:


Signature of Inspecting Officer
 Name : RAJAN WADEHRA
 Designation: A. D. O. (M.Rd.)

DOCS

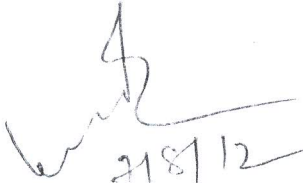
 21/8/12