

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS, DELHI FIRE SERVICE, CONNAUGHT PLACE
NEW DELHI-110001**


No.F6/DFS/MS/2012/Audi./ 4361

Dated : 23/11/12

FIRE SAFETY CERTIFICATE

Certified that the **Main Auditorium, Mini Auditorium I & II** located at **Baha'I House of Worship, Bahapur, Kalkaji, New Delhi**. comprised of **Ground Floor Only** was granted NOC by this department vide letter No./F6/DFS/MS/2009/3080 dated 23/10/09. The premises was re-inspected by the officer concerned of this department on 19/10/12 in the presence of **Mr. Shaheen Javid** and found that the said premises have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the premises fit for occupancy class **Business Building Group – E** with effect from 23/11/12 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010 subject to conditions printed below.

Issued 23/11/12 at New Delhi by



Chief Fire Officer
Delhi Fire Service

Copy to:- (1) The Addl. Commissioner of Police, (Lic.),
First Floor, PS Defence, New Delhi

(2) Main Auditorium, Mini audi I & II at Baha'I House of Worship,
Bahapur, Kalkaji, New Delhi.

Following fire safety directives must be adhered to:-

1. All the fire safety arrangements provided therein shall be maintained in good working conditions at all times.
2. Any loss of life or property due to non functional fire safety measures shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation w.r.t. construction etc. shall be verified by the concerned building sanctioning authority.
5. The basement shall be used as per the provisions of BBL.
6. This fire safety certificate may not be treated in any case for regularization of unauthorized construction, if any.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in

- 1/25

INSPECTION REPORT

1. Name & address of the building:- Main Auditorium, Mini Auditorium I & II at Baha'I House of Workship, Bahapur, Kalkaji, New Delhi.
2. Type of occupancy:- Business Building Group-E.
3. Type of case:- Renewal
4. Details of previous NOC:- No./F6/DFS/MS/2009/3080 dated 23/10/09
5. Fire safety directives No.- N/A
6. Date of inspection:- 19/10/12.
7. Name of the inspecting officer:- A.D.O. S.S. Kaushik
8. Name & designation of officer
From the building side:- Mr. Shaheen Javid.
9. Year of construction:- 1994.
10. Applicant's letter No:- Nil. dated 18/09/12 Three Auditorium having seating capacity
11. Main-408, Mini audi-1=70, Mini audi-II=70

S.No.	Minimum Standards on fire Prevention and fire safety U/R 33	NBC Requirement	Provided at site	Remarks MR/NMR
1.	Access to Building			
	1) Road width	Required	12 mtr.	MR
	2) Gate width	Required	Provided	MR
	3) Width of internal road	Required	Provided	MR
2.	Number, Width Type & Arrangement of Exits			
	A. Number of staircases			
	1. Upper floors	N/A	N/A	N/A
	2. Basements	N/A	N/A	N/A
	B. Width of staircase			
	1. Upper floors	N/A	N/A	N/A
	2. Basements	N/A	N/A	N/A
	C. Protection of exits			
	1. Fire check door	Required	Provided	MR
	2. Pressurization	N/A	N/A	N/A
	D. No. of continuous staircase to terrace	N/A	N/A	N/A
	E. Width of corridor	N/A	N/A	N/A
	F. Door size	2 mtr.	2 mtr.	MR
3.	Compartmentation			
	1) Fire check door	N/A	N/A	N/A
	2) Sealing of electrical shafts	N/A	N/A	N/A
	3) Fire rating of shaft door	N/A	N/A	N/A
	4) Water curtain	N/A	N/A	N/A
	5) Fire Dampers	N/A	N/A	N/A
4.	Smoke Management System			
	1) Basements	30 a/c per hour	provided	MR
	2) Upper floors	12 a/c per hour	provided	MR
5.	Fire Extinguishers			
	1) Total numbers	ISI Marked	16 Nos.	MR
	2) Types		ABC & W.Co2	MR
	3) ISI marking		Yes	MR

- N/28 -

M

6.	First-Aid Hose Reel			
	1) Total number of each floor	Yes	Two	MR
	2) Length of hose reel hose	30 m	Yes	MR
	3) Nozzle diameter	5 mm	Yes	MR
7.	Automatic Fire Detection & Alarming System			
	1) Type of detectors	Required	Smoke	MR
	2) Location of main panel	Required	Near entry	MR
	3) Location of repeater panel	NA	NA	NA
	4) Alternate source of power	Required	UPS provided	MR
	5) Hooter's Location	Required	provided	MR
8.	MOEFA	Yes	Provided	MR
9.	Public Address System	Yes	Required	MR
10.	Automatic Sprinkler System			
	1) Basement	N/A	N/A	N/A
	2) Upper floors	Required	Provided	MR
	3) Sprinkler above false ceiling	N/A	N/A	N/A
11.	Internal Hydrants			
	1) Size of riser/down-comer	Required	150 mm.	MR
	2) Number of hydrants per floor	Required	2 Nos.	MR
	3) Hose box	Required	2 Nos.	MR
12.	Yard Hydrants			
	1) Total number of hydrants	N/A	N/A	N/A
	2) Hose box	N/A	N/A	N/A

13.	Pumping Arrangement			
	1) Ground level			
	a) Discharge of main pump	Required	1620 LPM	MR
	b) Head of main pump	Required	55 mtr.	MR
	c) Number of main pump	Required	2 Nos.	MR
	d) Jockey pump out put	Required	180 LPM	MR
	e) Jockey pump head	Required	55 mtr.	MR
	f) Stand by pump output	N/A	N/A	N/A
	g) Stand by pump head	N/A	N/A	N/A
	h) Auto starting/Manual stopping	Yes	Provided	MR
	2) Terrace level			
	a) Discharge of pump	N/A	N/A	N/A
	b) Head of pump	N/A	N/A	N/A
	c) Power supply	N/A	N/A	N/A
	d) Auto starting of pump	N/A	N/A	N/A
14.	Captive Water Storage for Fire Fighting			
	1) Under ground tank capacity	Required	1,00,000 ltrs.	MR
	a) Draw-off connection	Yes	Provided	MR
	b) Fire service inlet	Yes	Provided	MR
	c) Access to tank	Yes	Provided	MR
	d) Over head tank capacity	Yes	20,000 Ltr.	MR
15.	Exit Signage.	Yes	Provided	MR
16.	Provision of Lifts.	Yes	Provided	MR

11/27

	a) Pressurization of lift shaft	N/A	N/A	N/A
	b) Pressurization of lift lobby	N/A	N/A	N/A
	c) Communication in lift car	N/A	N/A	N/A
	d) Fireman's switch	N/A	N/A	N/A

	e) Lift signage	N/A	N/A	N/A
17.	Stand by Power Supply	Yes	Provided	MR
18.	Refuge Area	N/A	N/A	N/A
	Total area location	N/A	N/A	N/A
19.	Fire Control Room	N/A	N/A	N/A
	a) Detector system panel	Yes	Provided	MR
	b) Flow switch panel	N/A	N/A	N/A
	c) PA system panel	Yes	Provided	MR
	d) Battery backup	Yes	Provided	MR
	e) Building floor plan	Yes	Provided	MR
20.	Special Fire Protection System for Protection of special Risk, if any:			MR


The fire protection system provided in the building were checked and found functional at the time of inspection.

Keeping in view of the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules it is recommended to grant Fire Safety Certificate under rules 35 of the Delhi Fire Service Rules 2010-----


Signature of the inspecting officer

Signature of the inspecting officer

Name:- D.P. Bharadwaj

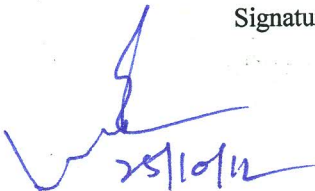

Name:- S.S. Kaushik



Designation:- Divisional Officer

Designation:- Assistant Divisional Officer