

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI – 110001


No. F6/DFS/MS/ school/2012/475

Dated: 10/02/12

FIRE SAFETY CERTIFICATE

Certified that the **M.C. Primary Girls School No-II, Gautampuri (1st Shift), Badarpur, New Delhi- 110044** comprised of ground and one upper floor **Owned/Occupied** by M.C. Primary Girls School has complied with the fire prevention and fire safety requirements in accordance with Directorate of Education Circular No. F.16/Estate/CC/Fire Safety/2011/3298-3398 dated 01/03/2011 and Rule 33 of the Delhi Fire Service Rules, 2010 and verified by officers concerned of Delhi Fire Service on 19/01/2012 in the presence of Shri Virender Singh, Principal of the school and that the building/premises is fit for occupancy class-B "Educational" with effect from 10/02/12 for a period of THREE years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rule 2010.

Issued on 10/02/12 at New Delhi by


Chief Fire Officer
For Director
Delhi Fire Service

Copy To: -

1. The Directorate of Education, M.C. NCC Civic Centres, Delhi.
2. Principal, M.C. Primary Girls School No-II, Gautampuri (1st Shift), Badarpur, New Delhi-110044

Conditions for the validity of fire safety Certificate

1. All the Fire Safety and means of escape facilities shall be maintained in good working conditions at all time. Any lapse rendering fire safety or means of evacuation facilities rendering non-functional shall be the responsibility of the management.
2. Building Sanctioning Authority may verify any deviation with regard to the construction/occupancy in the building. In case of any deviation, the fire safety certificate stands null and void.
3. The staff shall be trained for operating fire fighting system and mock evacuation drills be conducted at regular intervals and record be maintained.
4. The Basement shall be used strictly as per the provisions of Building Bye Laws.
5. The owner/occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in

INSPECTION REPORT

1. Name and address of the building: MC Primary Girls School No: 2
: Ganwampuri (1st Shift), Badarpur, ND - 44
2. Type of Occupancy : Educational
3. Type of Case : New.
4. Details of previous NOC : NIL
5. Fire Safety directives letter No : NIL Dated: _____
6. Date of Inspection : 19/01/2012
7. Name of the Inspecting Officers : Rajan Wadehra, ADO/M.Ed.
8. Name and designation of Officers
From the building side : Sh. Virender Singh (Principal)
9. Year of Construction : _____
(Ground and one upper floor)
10. Applicant's letter No : NIL


S. No.	Minimum Standards on Fire Prevention and Fire Safety U/R 33	NBC Requirement	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	15 Mts	15 Mts	M/R
	• Gate width	NA	NA	NA
	• Width of internal road	NA	NA	NA
2	Number, Width, Type & Arrangement of Exits			
	• Number of staircase			
	➤ Upper Floors	TWO	TWO	M/R
	➤ Basements	NO Basement	NA	NA
	• Width of Staircases			
	➤ Upper Floors	1.50 Mts	1.50 Mts	M/R
	➤ Basements	NO Basement	NA	NA
	• Protection of exits		NA	
	➤ Fire check door			
	➤ Pressurization			
	• No. of continuous staircases to terrace	1	1	M/R
	• Width of Corridor	NA	NA	NA
	• Door Size	NA	NA	NA

3	Compartmentation		NA
	<ul style="list-style-type: none"> • Fire check door • Sealing of electrical shafts • Fire rating of shaft door • Water curtain • Fire Dampers 		
4	Smoke Management System		NA
	<ul style="list-style-type: none"> • Basements • Upper Floors 	30 a/c Per hour 12 a/c Per hour	
5	Fire Extinguishers		
	<ul style="list-style-type: none"> • Total Number • Types • IS marking 	One/300 m ² ISI mark	04 ABC YES M/R M/R M/R
6	Firs-Aid Hose Reels		NA
	<ul style="list-style-type: none"> • Total Number on each floor • Length of hose reel hose • Nozzle diameter 	_____ 30 m 5mm	
7	Automatic Fire detection and alarming system		NA
	<ul style="list-style-type: none"> • Type of detectors • Location of Main Panel • Location of Repeater Panel • Alternate source of power • Hooter's Location 		
8	MOEFA		NA
9	Public Address System		NA
10	Automatic Sprinkler System		NA
	<ul style="list-style-type: none"> • Basement • Upper Floor • Sprinkler above false ceiling 		
11	Internal Hydrants		NA
	<ul style="list-style-type: none"> • Size of riser/down comer • Number of hydrants per floor • Hose Box 		
12	Yard Hydrants		NA
	<ul style="list-style-type: none"> • Total Number of hydrants • Hose Box 		

13 Pumping Arrangements

NA


- Ground Level
 - Number of main pump
 - Discharge of main pump
 - Head of main pump
 - Jockey pump out put
 - Jockey pump Head
 - Standby pump out put
 - Standby Pump Head
 - Auto Starting/Manual
 - Pump House Access
- Terrace level
 - Discharge of pump
 - Head of the pump
 - Power Supply
 - Auto starting /manual

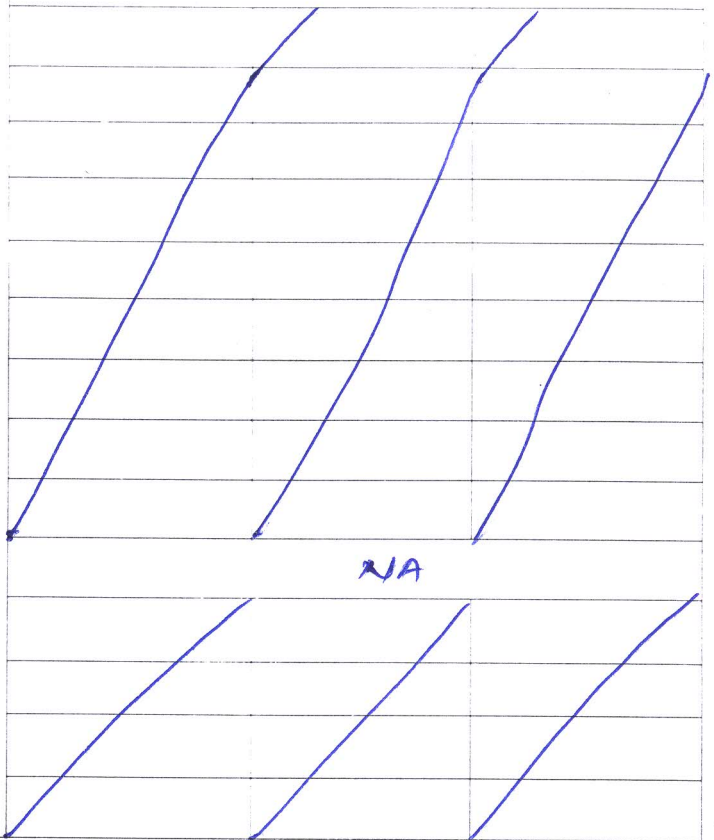

14 Captive Water Storage for Fire Fighting

NA

- Underground tank capacity
 - Draw-off connection
 - Fire service inlet
 - Access to tank
- Overhead tank capacity

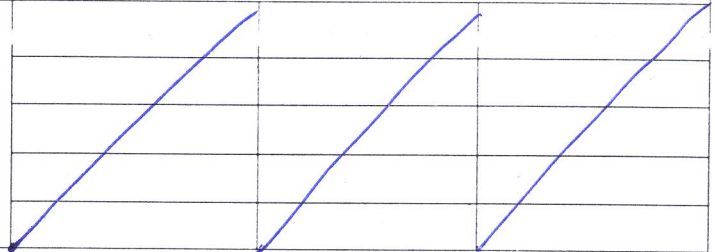


15 Exit Signage

NA

16 Provision of Lifts

NA

- Pressurization of Lift Shaft
- Pressurization of Lift lobby
- Communication in lift Car
- Fireman's Grounding Switch
- Lift Signage

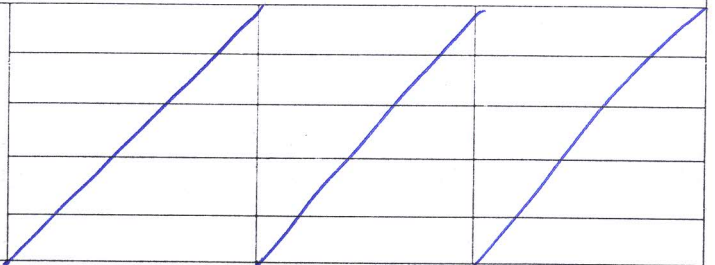


17 Standby Power Supply

NA

18 Refuge Area

NA


- Total Area
- Location



19 Fire Control Room

NA

- Detector System Panel
- Flow Switch Panel
- PA System Panel
- Battery back up
- Building Floor Plans

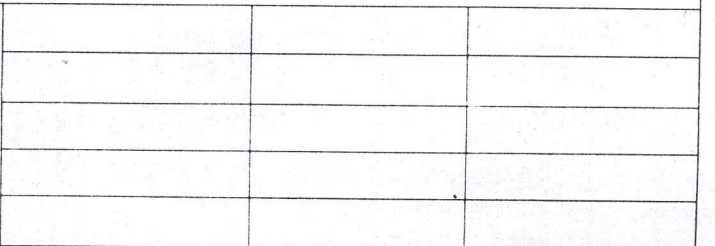

20

Special Fire Protection System for
Protection of special risk, if any

NA

NA

NA

The Fire protection systems provided in the building were test checked and found functional at the time of inspection.

Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules , It is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules 2010/issue shortcomings as noted at serial number.....

Signature of Inspecting Officer

Name : RAJAN WADEHRA

Designation: Asst. Div. Officer