

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI - 110001**


No. F6/DFS/MS/2012/ *School/443*

Dated: *09/02/12*

FIRE SAFETY CERTIFICATE

Certified that the **M.C.D. Primary School (Boys), Lajpat Nagar-IV, New Delhi-110024**, comprised of ground floor only Owned/**Occupied** by M.C.D. Primary School, has complied with the fire prevention and fire safety requirements in accordance with Directorate of Education Circular No. F.16/Estate/CC/Fire Safety/2011/3298-3398 dated 01/03/2011 and Rule 33 of the Delhi Fire Service Rules, 2010 and verified by officers concerned of Delhi Fire Service on 18 /01/2012 in the presence of Mrs. Vashundhara Joshi, Principal of the school and that the building/premises is fit for occupancy class-B (Educational) with effect from *09/02/12* for a period of THREE years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rule 2010

Issued on ----- *09/02/12* ----- at New Delhi by


Chief Fire Officer
For Director
Delhi Fire Service

Copy To: -

1. The Director of Education, *MEO Civic Center*, Delhi.
2. Principal, M.C.D. Primary School (Boys), Lajpat Nagar-IV, New Delhi-110024

Conditions for the validity of fire safety Certificate

1. All the Fire Safety and means of escape facilities shall be maintained in good working conditions at all time. Any lapse rendering fire safety or means of evacuation facilities rendering non-functional shall be the responsibility of the management.
2. Building Sanctioning Authority may verify any deviation with regard to the construction/occupancy in the building. In case of any deviation, the fire safety certificate stands null and void.
3. The staff shall be trained for operating fire fighting system and mock evacuation drills be conducted at regular intervals and record be maintained.
4. The Basement shall be used strictly as per the provisions of Building Bye Laws.
5. The owner/occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in

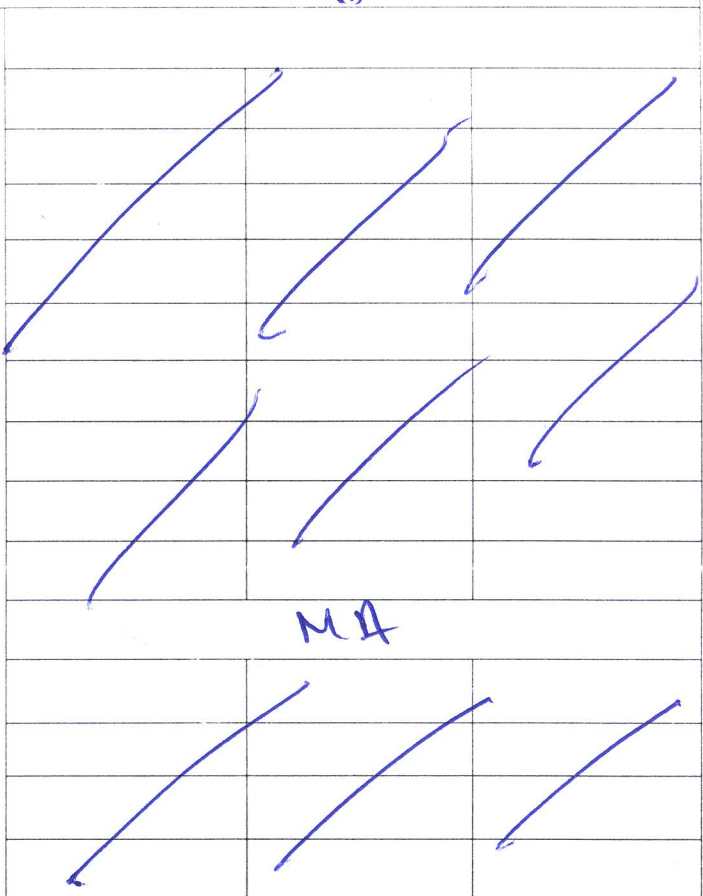
INSPECTION REPORT

1. Name and address of the building: M.C.D. Primary School (Boys)
Kajpat Nagar - A New Delhi 110024.
2. Type of Occupancy : Educational
3. Type of Case : New
4. Details of previous NOC : NIL
5. Fire Safety directives letter No : NIL Dated: 19/1/12
6. Date of Inspection : 18/01/2012
7. Name of the Inspecting Officers : Rajan. Wadehra Aso/M. Road.
8. Name and designation of Officers
From the building side : Mrs. Yashvindhra. Jashi (Principal)
9. Year of Construction : Ground Floor
10. Applicant's letter No : NIL

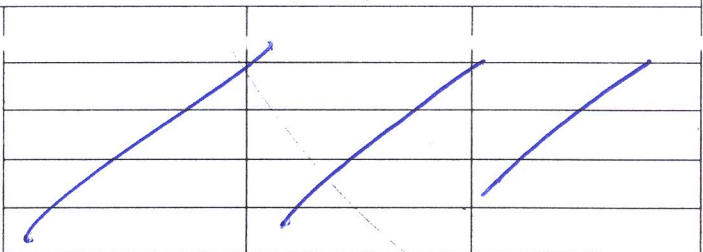
S. No.	Minimum Standards on Fire Prevention and Fire Safety U/R 33	NBC Requirement	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	15m	15m	MR
	• Gate width	NA	NA	NA
	• Width of internal road	NA	NA	NA
2	Number, Width, Type & Arrangement of Exits	NA		
	• Number of staircase			
	➤ Upper Floors	/	/	/
	➤ Basements	/	/	/
	• Width of Staircases		NA	
	➤ Upper Floors	/	/	/
	➤ Basements	/	/	/
	• Protection of exits		NA	
	➤ Fire check door	/	/	/
	➤ Pressurization	/	/	/
	• No. of continuous staircases to terrace	/	/	/
	• Width of Corridor	/	/	/
	• Door Size	/	/	/

3	Compartmentation		NA	
	<ul style="list-style-type: none"> • Fire check door • Sealing of electrical shafts • Fire rating of shaft door • Water curtain • Fire Dampers 			
4	Smoke Management System		NA	
	<ul style="list-style-type: none"> • Basements 	30 a/c Per hour		
	<ul style="list-style-type: none"> • Upper Floors 	12 a/c Per hour		
5	Fire Extinguishers			
	<ul style="list-style-type: none"> • Total Number 	1 ext 1300sr mt	4 NOS	MR
	<ul style="list-style-type: none"> • Types 	ISI mark	4 ABC	MIR
	<ul style="list-style-type: none"> • IS marking 		YES	YES
6	Firs-Aid Hose Reels		NA	
	<ul style="list-style-type: none"> • Total Number on each floor 	_____		
	<ul style="list-style-type: none"> • Length of hose reel hose 	30 m		
	<ul style="list-style-type: none"> • Nozzle diameter 	5mm		
7	Automatic Fire detection and alarming system		NA	
	<ul style="list-style-type: none"> • Type of detectors • Location of Main Panel • Location of Repeater Panel • Alternate source of power • Hooter's Location 			
8	MOEFA		NA	
9	Public Address System		NA	
10	Automatic Sprinkler System		NA	
	<ul style="list-style-type: none"> • Basement • Upper Floor • Sprinkler above false ceiling 			
11	Internal Hydrants		NA	
	<ul style="list-style-type: none"> • Size of riser/down comer • Number of hydrants per floor • Hose Box 			
12	Yard Hydrants		NA	
	<ul style="list-style-type: none"> • Total Number of hydrants • Hose Box 			

13 Pumping Arrangements

	<ul style="list-style-type: none"> • Ground Level <ul style="list-style-type: none"> ➤ Number of main pump ➤ Discharge of main pump ➤ Head of main pump ➤ Jockey pump out put ➤ Jockey pump Head ➤ Standby pump out put ➤ Standby Pump Head ➤ Auto Starting/Manual ➤ Pump House Access • Terrace level <ul style="list-style-type: none"> ➤ Discharge of pump ➤ Head of the pump ➤ Power Supply ➤ Auto starting /manual 	<p style="text-align: center;">NA</p> 
--	--	---

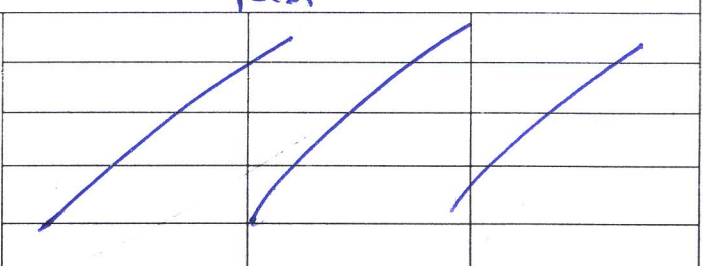
14 Captive Water Storage for Fire Fighting

	<ul style="list-style-type: none"> • Underground tank capacity <ul style="list-style-type: none"> ➤ Draw-off connection ➤ Fire service inlet ➤ Access to tank • Overhead tank capacity 	<p style="text-align: center;">NA</p> 
--	--	--

15 Exit Signage

	<p style="text-align: center;">NA</p>
--	---------------------------------------


16 Provision of Lifts

	<ul style="list-style-type: none"> • Pressurization of Lift Shaft • Pressurization of Lift lobby • Communication in lift Car • Fireman's Grounding Switch • Lift Signage 	<p style="text-align: center;">NA</p> 
--	---	--

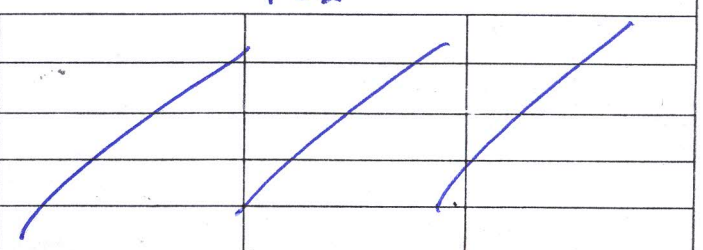
17 Standby Power Supply

	<p style="text-align: center;">NA</p>
--	---------------------------------------

18 Refuge Area

	<ul style="list-style-type: none"> • Total Area • Location 	<p style="text-align: center;">NA</p> 
--	--	--

19 Fire Control Room


	<ul style="list-style-type: none"> • Detector System Panel • Flow Switch Panel • PA System Panel • Battery back up • Building Floor Plans 	<p style="text-align: center;">NA</p> 
--	--	--

20	Special Fire Protection System for Protection of special risk, if any	N/A	N/A
----	---	-----	-----

The Fire protection systems provided in the building were test checked and found functional at the time of inspection.

Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules , It is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules 2010/~~issue shortcomings as noted~~ at serial number.....

Does


25/11/2


Signature of Inspecting Officer

Name RAJAN WADHWHA

Designation: Asst Dir other