

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI - 110001


No. F6/DFS/MS/ School/2012/ 948

Dated: 15/03/12

FIRE SAFETY CERTIFICATE

Certified that **Vijay Bharati Public School, D-53, Mohan Baba Nagar, Tajpur Road, Badarpur, New Delhi-110044, (School Id: 1925290)** comprised of ground plus one upper floor **Owned/Occupied by** Vijay Bharati Public School has complied with the fire prevention and fire safety requirements in accordance with Directorate of Education Circular No. F.16/Estate/CC/Fire Safety/2011/3298-3398 dated 01/03/2011 and Rule 33 of the Delhi Fire Service Rules, 2010 and verified by officer concerned of Delhi Fire Service on 29/02/2012 in the presence of Shri Shyam Kala, Manager and Mrs. P Kaur, Principal of the school and that the building/premises is fit for occupancy class-B "Educational building" with effect from 15/03/12 for a period of THREE years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rule 2010.

Issued on 15/03/12 at New Delhi by


Chief Fire Officer
For Director
Delhi Fire Service

Copy To: -

1. The Directorate of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi.
2. The Manager, Vijay Bharati Public School
D-53, Mohan Baba Nagar, Tajpur Road, Badarpur, New Delhi-110044

Conditions for the validity of fire safety Certificate

1. All the Fire Safety and means of escape facilities shall be maintained in good working conditions at all time. Any lapse rendering fire safety or means of evacuation facilities non-functional shall be the responsibility of the management.
2. Building Sanctioning Authority may verify any deviation with regard to the construction/occupancy in the building. In case of any deviation, the fire safety certificate stands null and void.
3. The staff shall be trained for operating fire fighting system and mock evacuation drills be conducted at regular intervals and record be maintained.
4. The Basement shall be used strictly as per the provisions of Building Bye Laws.
5. The owner/occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in

INSPECTION REPORT

1. Name and address of the building: VISAY BHARATI PUBLIC SCHOOL
D-53, Mohan Baba Nagar, Pappun Rd, Badli, ND-64
2. Type of Occupancy: Educational
3. Type of Case: Nil
4. Details of previous NOC: Nil
5. Fire Safety directives letter No: Nil Dated: _____
6. Date of Inspection: 29/2/12
7. Name of the Inspecting Officers: Rajan Wadhwa, ADO/MRD.
8. Name and designation of Officers
 From the building side: Sh shyam Kola (Manager)
Mrs P. Kaur
9. Year of Construction: — GT + 1 upper floor
10. Applicant's letter No: —

So-2011-001486

S. No.	Minimum Standards on Fire Prevention and Fire Safety U/R 33	NBC Requirement	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	15m	5m	M/R
	• Gate width	NA	NA	NA
	• Width of internal road	NA	NA	NA
2	Number, Width, Type & Arrangement of Exits			
	• Number of staircase			
	➤ Upper Floors	2	1	M/R
	➤ Basements	NA	NA	NA
	• Width of Staircases			
	➤ Upper Floors	1.50m	1.708/1.10m	M/R
	➤ Basements	NA	NA	NA
	• Protection of exits		NA	
	➤ Fire check door			
	➤ Pressurization			
	• No. of continuous staircases to terrace	1	1	M/R
	• Width of Corridor			
	• Door Size			

3	Compartmentation	NA		
	<ul style="list-style-type: none"> • Fire check door • Sealing of electrical shafts • Fire rating of shaft door • Water curtain • Fire Dampers 			
4	Smoke Management System	NA		
	<ul style="list-style-type: none"> • Basements • Upper Floors 	30 a/c Per hour		
		12 a/c Per hour		
5	Fire Extinguishers			
	<ul style="list-style-type: none"> • Total Number • Types • IS marking 	1 Per 30sqm	8 NOS	MIR
		ISI mark	4 CO2 4 ABC	MIR
			Yes	MIR
6	Firs-Aid Hose Reels	NA		
	<ul style="list-style-type: none"> • Total Number on each floor • Length of hose reel hose • Nozzle diameter 			
		30 m		
		5mm		
7	Automatic Fire detection and alarming system	NA		
	<ul style="list-style-type: none"> • Type of detectors • Location of Main Panel • Location of Repeater Panel • Alternate source of power • Hooter's Location 			
8	MOEFA	NA		
9	Public Address System	NA		
10	Automatic Sprinkler System	NA		
	<ul style="list-style-type: none"> • Basement • Upper Floor • Sprinkler above false ceiling 			
11	Internal Hydrants	NA		
	<ul style="list-style-type: none"> • Size of riser/down comer • Number of hydrants per floor • Hose Box 			
12	Yard Hydrants	NA		
	<ul style="list-style-type: none"> • Total Number of hydrants • Hose Box 			

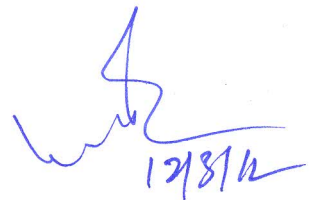
13	Pumping Arrangements	NA	
	<ul style="list-style-type: none"> • Ground Level <ul style="list-style-type: none"> ➤ Number of main pump ➤ Discharge of main pump ➤ Head of main pump ➤ Jockey pump out put ➤ Jockey pump Head ➤ Standby pump out put ➤ Standby Pump Head ➤ Auto Starting/Manual ➤ Pump House Access • Terrace level <ul style="list-style-type: none"> ➤ Discharge of pump ➤ Head of the pump ➤ Power Supply ➤ Auto starting /manual 		
14	Captive Water Storage for Fire Fighting	NA	
	<ul style="list-style-type: none"> • Underground tank capacity <ul style="list-style-type: none"> ➤ Draw-off connection ➤ Fire service inlet ➤ Access to tank • Overhead tank capacity 		
15	Exit Signage	Provided	M/R
16	Provision of Lifts	NA	
	<ul style="list-style-type: none"> • Pressurization of Lift Shaft • Pressurization of Lift lobby • Communication in lift Car • Fireman's Grounding Switch • Lift Signage 		
17	Standby Power Supply	25 kVA	M/R
18	Refuge Area	NA	
	<ul style="list-style-type: none"> • Total Area • Location 		
19	Fire Control Room	NA	
	<ul style="list-style-type: none"> • Detector System Panel • Flow Switch Panel • PA System Panel • Battery back up • Building Floor Plans 		


20	Special Fire Protection System for Protection of special risk, if any		NA	NA
----	---	--	----	----

The Fire protection systems provided in the building were test checked and found functional at the time of inspection.

Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules , It is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules 2010/~~issue shortcomings as noted at serial number~~.....

Docst


12/8/12


Signature of Inspecting Officer
Name : RAJAN WADEHRA
Designation: ADO / M. Rd.