

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI - 110001

No F 6 / DFS / MS / 2013 / 81

Dated 15/03/13

FIRE SAFETY CERTIFICATE

Certified that the M/s Lally Automobile (P) Ltd. located at D-160, Okhla Industrial Area Ph-I, New Delhi, comprised of Basement + Ground Floor, have complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010, and verified by the officers concerned of this department on 02.03.2013 in the presence of Mr. Deepak Kapoor (DGM/ Sales) and found that the building is fit for occupancy class "Industrial" with effect from 15/03/13 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010 subject to conditions printed below.

Issued 15/03/13 at New Delhi by.


Chief Fire Officer
Delhi Fire Service

Copy to:-

1. The Executive Engineer (Bldg.)
MCD, Building Department, Civic Centre, Minto Road,
New Delhi.
2. M/s Lally Automobiles Pvt. Ltd.
D-160, Okhla Industrial Area Phase - I, New Delhi

Following fire safety directives must be adhered to:-

1. All the fire safety arrangements provided therein shall be maintained in good working conditions at all times.
2. Any loss of life or property due to non functional fire safety measures shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation w.r.t construction etc. shall be verified by the concerned building sanctioning authority.
5. The basement shall be uses as per the provisions of BBL.
6. This fire safety certificate may not be treated in any case for regularization of unauthorized construction, if any.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in

N/4

INSPECTION REPORT

- 1. Name & address of the building: M/s Lally Automobile (P) Ltd. D-160, Okhla Industrial Area, Ph-I, New Delhi -110020.
- 2. Type of Occupancy : Industrial
- 3. Type of Case : Renewal
- 4. Details of previous NOC : F6/DFS/MS/2006/3394 Dated 17.11.2006
- 5. Fire Safety directives Letter No. : F6/DFS/MS/BP/2006/762 Dated 28.06.2006
- 6. Date of inspection : 02.03.2013
- 7. Name of the Inspecting Officer : Dy. CFO Atul Garg
- 8. Name and designation of Officer
from the building side : Mr. Deepak Kapoor (DGM/ Sales)
- 9. Year of Construction : 2006 (Basement+ Ground floor)
- 10. Applicant's letter No. : Nil dated 04.02.13

S No	Minimum standards on fire prevention and fire safety U/R 33	BBL Requirements	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	09 mtr	13.71 mtr.	MR
	• Gate width	4.5 m	5 m	MR
	• Width of internal road	N/A	N/A	N/A
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	02	02	MR
	• Basements	02	02	MR
	b. Width of staircases			
	• Upper floors	N/A	1.30 M	MR (old case)
	• Basements	-----	1.46 m 1.20 m	MR (old case)
	c. Protection of exits			
	• Fire check door	Required	Provided	MR
	• Pressurization	N/A	N/A	N/A

Atul Garg

 ATUL GARG

M/5


	d. No of continuous staircase to terrace	02	02	MR
	e. Width Of Corridor	N/A	N/A	N/A
	f. Door Size	1 m	1.25 m	MR
3.	Compartmentation			
	• Fire check door	N/A	N/A	N/A
	• Sealing of electrical shafts	N/A	N/A	N/A
	• Fire Rating of shaft door	N/A	N/A	N/A
	• Water Curtain	N/A	N/A	N/A
	• Fire Dampers	N/A	N/A	N/A
4.	Smoke managements System			
	• Basements	Required	Provided	MR
	• Upper floors	N/A	N/A	N/A
5.	Fire Extinguishers			
	• Total numbers	10	Provided	MR
	• Types	ABC/ CO ₂	Provided	MR
	• IS marking	ISI marked	YES	MR
6.	First – Aid Hose Reels			
	• Total numbers on each floor	01	Provided	MR
	• Length of hose reel hose	30 mtr	Provided	MR
	• Nozzle diameter	5 mm	Provided	MR
7.	Automatic fire detection and alarming system			
	• Type of detectors	YES	Smoke/Heat	MR
	• Location of Main Panel	N/A	N/A	N/A
	• Location of Repeater Panel	N/A	N/A	N/A
	• Alternate source of power	YES	Provided	MR
	• Hooters' Location	Public Area	Public Area	MR
8.	MOEFA			
		Not Required	Provided	MR
9.	Public Address System/Intercom			
		Not Required	Provided	MR
10.	Automatic Sprinkler System			
	• Basements	Required	Provided	MR
	• Upper Floor	N/A	Provided	MR
	• Sprinkler above false ceiling	N/A	N/A	N/A

Abhijit

N/6

OLD CASE

11.	Internal Hydrants			
	• Size of riser/down- comer	100 mm	100 mm	MR
	• Number of hydrants per floor	01	01	MR
	• Hose Box	01	01	MR
12.	Yard Hydrants			
	• Total number of hydrants	Not required	01	MR
	• Hose Box	Not required	01	MR
13.	Pumping Arrangements			
	• Ground Level			
	• Discharge of main pump	900 LPM	900 LPM	MR
	➤ Head of main pump	40 m	40 m	MR
	➤ Number of main pumps	01	01	MR
	➤ Jockey pump out put	180 LPM	180 LPM	MR
	➤ Jockey pump head	40 m	40 m	MR
	➤ Standby Pump out put	N/A	N/A	N/A
	➤ Standby Pump Head	N/A	N/A	N/A
	➤ Auto Staring/Manual stopping	YES	Provided	MR
	➤ Pump House Access	YES	YES	MR
	• Terrace level			
	➤ Discharge of pump	N/A	N/A	N/A
	➤ Head of the pump	N/A	N/A	N/A
	➤ Power supply	N/A	N/A	N/A
	➤ Auto starting of pump	N/A	N/A	N/A
14.	Captive water Storage for fire fighting			
	• Under ground tank capacity	N/A	N/A	N/A
	➤ Draw of connection	YES	Provided	MR
	➤ Fire service inlet	YES	Provided	MR
	➤ Access to tank	N/A	Provided	MR
	• Overhead Tank capacity	10,000 ltr	10,000 ltr	MR
15	Exit Signage	Required	Provided	MR
16.	Provision of Lifts			
	➤ Pressurization of Lift Shaft	N/A	N/A	N/A
	➤ Pressurization of lift lobby	N/A	N/A	N/A
	➤ Communication in lift Car	N/A	N/A	N/A
	➤ Fireman's Grounding Switch	N/A	N/A	N/A

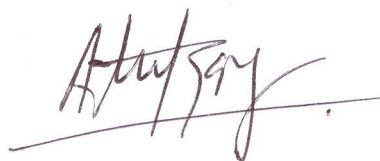

N/7

OLD CASE

	➤ Lift Signage	N/A	N/A	N/A
17.	Standby power supply	Required	Provided	MR
18.	Refuge Area			
	➤ Total area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19.	Fire control room			
	➤ Detector system panel	N/A	N/A	N/A
	➤ Flow Switch Panel	N/A	N/A	N/A
	➤ PA System Panel	N/A	N/A	N/A
	➤ Batter backup	N/A	N/A	N/A
	➤ Building Floor Plans	N/A	N/A	N/A
20.	Special Fire Protection Systems for Protection of special Risks, if any;	N/A	N/A	N/A

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules it is recommended to renew Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules 2010

Signature of the Inspecting Officer

Signature of the Inspecting Officer

Name

X

Name

ATUL GARG

Designation

Designation

DCFO/SOUTH