

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001

NO. F6/DFS/MS/Hospital/1013/241


Dated: 03/05/2013

FIRE SAFETY CERTIFICATE

Certified that the Satyawadi Raja Harish Chand Hospital (200 Bedded) located at Narela Delhi is comprised of Basement + Ground + Four upper floors owned and occupied by Delhi Government was issued NOC vide this office letter No F-6/DFS/MS/Hospital/2004/667 dated 26/03/2004 was inspected by the officers concerned of this department on 11/04/2013 in the presence of Sh F C Tyagi AE (E) PWD and Sh Vashisth JE (Electric) PWD and found that the Hospital building have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and premises is fit for occupancy with effect from 03/05/2013 for a period of three years subject to conditions printed below.

1. Means of escape shall not be kept locked or bolted from outside and shall be easily open able by guests in an event of emergency.
2. All employees shall be acquainted with the use and maintenance of all the fire fighting installation/equipments.
3. The fire suppression / protection arrangements provided in the guest house are to minimize losses, if maintained in good working condition. These systems cannot give any guarantee that there will be no fire or losses in the event of one.
4. Any loss of life and property due to non-functional of fire safety arrangements and other installations shall be the responsibility of the licensee.
5. This report may not in any way be treated as regularization of unauthorized construction, if any.
6. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on WWW.dfs.Delhigovt.nic.in


Issued on...03/05/13...at New Delhi.



(SANTOKH SINGH)
Chief Fire Officer
Delhi Fire Service
Ph: 011-23414250
cfowz.dfire@nic.in

Copy to:

1. The Executive Engineer, (Electrical), PWD EMD M-352, Dr B. R. Ambedkar Hospital, Sec-6, Rohini, Delhi -110085
2. The, Medical Superintendent, Satyawadi Raja Harish Chand Hospital, Narela Delhi

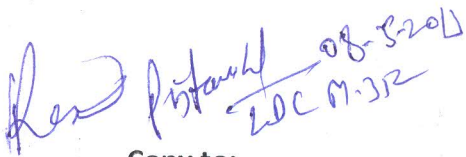
08-5201
2DC M-32

INSPECTION REPORT

1. Name & address of the building : S R H C Hospital, Narela
2. Type of Occupancy : 300 bedded Hospital
3. Type of Case : New Case/ Renewal
4. Details of previous NOC : Letter No. _____ Dated: _____
5. Fire Safety directives letter No : FC/DS/MS/Hospital/2003/1698 dtd 21/07/03 & FC/DS/MS/Hospital/2004/667 dtd 26/03/04
6. Date of inspection : _____
7. Name of the Inspecting Officers : FC/DS/MS/Hospital/99/1043 dtd 30/11/99
8. Name and designation of officers DO NW & DCFo (W2)
from the building side : Sh FC Tyagi AE(E) PWD & Sh R. Vashist JE(E)
9. Year of Construction : 2003
10. Applicant's letter No. : DB(13) PWD/EMD/M-352/2012-13/242 dtd 26/13

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	NBC Requirement	Provided at site	Remarks MR/NMR
1	Access to building			
	<ul style="list-style-type: none"> • Road width • Gate width • Width of internal road 		<u>X1/A</u>	<u>/</u>
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			<u>/</u>
	<ul style="list-style-type: none"> • Upper Floors • Basements 			
	b. Width of staircases			
	<ul style="list-style-type: none"> • Upper Floors • Basements 			
	c. Protection of exits			
	<ul style="list-style-type: none"> • Fire check door • Pressurization 	<u>R</u>	<u>P</u>	<u>M/R</u>
	e. No. of continuous staircases to terrace	<u>-</u>	<u>-</u>	<u>-</u>
	g. Width of Corridor	<u>-</u>	<u>-</u>	<u>-</u>
	h. Door Size	<u>-</u>	<u>-</u>	<u>-</u>
3	Compartmentation.			
	<ul style="list-style-type: none"> • Fire check door • Sealing of electrical shafts • Fire Rating of shaft door • Water Curtain • Fire Dampers 	<u>R</u>	<u>P</u>	<u>M/R</u>
		<u>-</u>	<u>-</u>	<u>-</u>
		<u>-</u>	<u>-</u>	<u>-</u>
		<u>-</u>	<u>-</u>	<u>-</u>
		<u>-</u>	<u>-</u>	<u>-</u>

5	Fire Extinguishers			
	<ul style="list-style-type: none"> Total numbers Types IS marking 	ISI marked		
6	First-Aid Hose Reels.			
	<ul style="list-style-type: none"> Total numbers on each floor Length of hose reel hose Nozzle diameter 	30 m 5 mm		
7	Automatic fire detection and alarming system.			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooters' Location 			
8	MOEFA			
9	Public Address System.			
10	Automatic Sprinkler System.			
	<ul style="list-style-type: none"> Basement Upper Floor Sprinkler above false ceiling 			
11	Internal Hydrants			
	<ul style="list-style-type: none"> Size of riser/down-comer Number of hydrants per floor Hose Box 			
12	Yard Hydrants.			
	<ul style="list-style-type: none"> Total number of hydrants Hose Box 			
13	Pumping Arrangements.			
	<ul style="list-style-type: none"> Ground Level <ul style="list-style-type: none"> ➤ Discharge of main Pump ➤ Head of Main pump ➤ Number of main pumps ➤ Jockey Pump out put ➤ Jockey pump head ➤ Standby Pump out put ➤ Standby Pump Head ➤ Auto Starting/ Manual stopping ➤ Pump House Access Terrace level 			

	<ul style="list-style-type: none"> • Underground tank capacity ➤ Draw-off connection ➤ Fire service inlet ➤ Access to tank • Overhead Tank capacity 			
15	Exit Signage.			
16	Provision of Lifts.			
	<ul style="list-style-type: none"> • Pressurization of Lift Shaft • Pressurization of Lift lobby • Communication In lift Car • Fireman's Grounding Switch • Lift Signage 			
17	Standby power supply			
18	Refuge Area.			
	<ul style="list-style-type: none"> ➤ Total Area ➤ Location 			
19	Fire Control Room			
	<ul style="list-style-type: none"> • Detector System Panel • Flow Switch Panel • PA System Panel • Batter backup • Building Floor Plans 			
20	Special Fire Protection Systems for Protection of special Risks, if any:			

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules 2010/ issue shortcomings as noted at serial numbers.....

Signature of the Inspecting Officer

Name

Designation

DCFO (NW)

Signature of the Inspecting Officer

Name

Designation

[Signature]
17/4/13
DO (NW)