

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE
NEW DELHI- 110001

Ph - 23414333 Fax - 23412593 Email - cfohq.dfire@nic.in

NO. FG/DFS/MS/Cinema/2013/NO2/481

DATED: 27/06/13

FIRE SAFETY CERTIFICATE

Certified that the Supreme Cinema Shahdara, Delhi-32, owned/occupied by Supreme Cinema, comprising of ground plus mezzanine was granted NOC vide letter no. No.F.6/DFS/MS/Cinema/2012/2157 dated 19.06.12. The Cinema building was inspected by the officers concerned of this department on dated 12.06.13 in the presence of joint inspection team along with Mr. O.P. Sharma (Manager) and found that the Cinema building have deemed complied with the fire prevention and fire safety requirements in accordance with the Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and that the building is fit for occupancy Group D "Assembly Building" with effect from 27/06/13 for a period of three years, subject to conditions printed overleaf.

Issued on 27/06/13 at New Delhi by



(Dr. G.C. Misra)

Chief Fire Officer

Delhi Fire Service

Deepak K

To,

Sh. O.P. Sharma (Manager)
Supreme Cinema Shahdara, Delhi-32.

Copy to:-

The Addl. Commissioner of Police (Lic.),

First Floor, Police Station,

Defence Colony, New Delhi.

In reference letter no.19828-35 Addl.CP/Lic. Cinema

Dated 01.05.13

- Conditions -

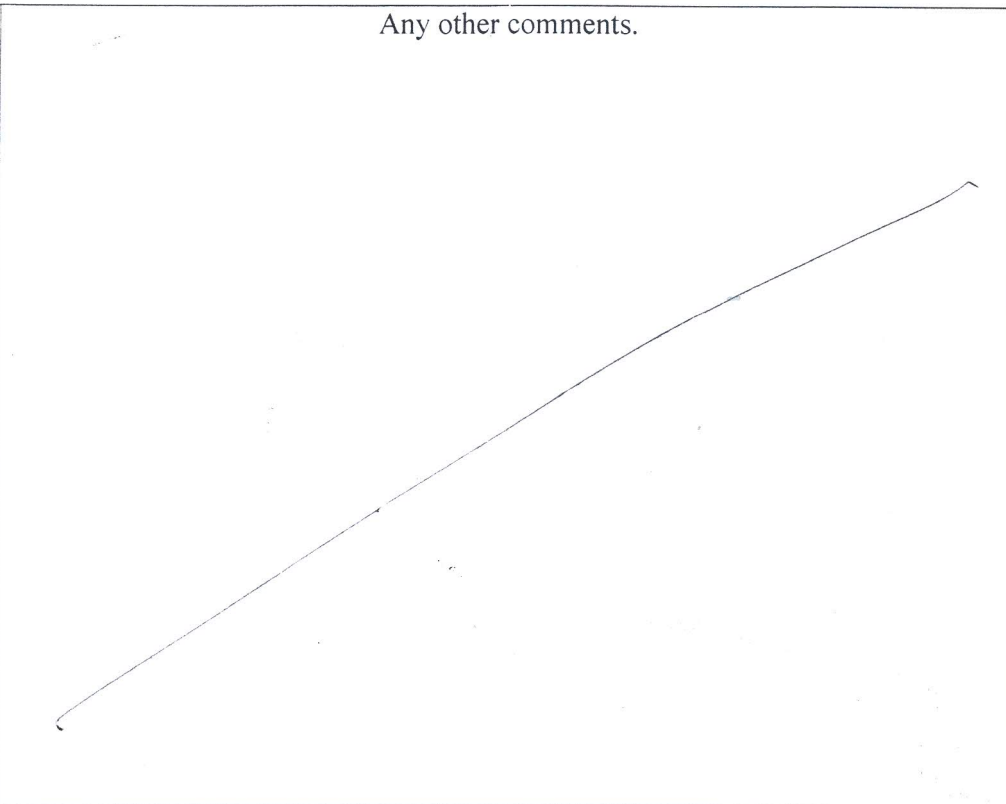
1. All the means of escape shall be kept free of all type of obstruction all the time.
2. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
3. All the fire fighting equipments shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
4. The clarification with regards electrical installation, ventilation, structure stability set back areas, occupancy and constructional deviation in building etc .may be got verified from the authorities concerned.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction unauthorized use of land if any.
6. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in

FIRE SAFETY INSPECTION REPORT

I.

Sl. No.	APPLIANCES	AVAILABILITY	CONDITION
a.	Overhead/ Underground tank	27500 lit	filled
b.	No. of Hydrants	One	functional
c.	No. of Hose Reels	Three	functional
d.	Number of Fire buckets of sand & water: 1) Main Hall 2) Balcony 3) Box 4) Projector Room 5) Elect. Sub-Station 6) Rectifier Room 7) AC Plant-Room 8) Any others	6 No	functional
e.	Number of portable fire extinguishers 1) Main Hall 2) Balcony 3) Box 4) Projector Room 5) Elect. Sub-Station 6) Rectifier Room 7) AC Plant Room 8) Any others	10 2 - 2 2 2	functional
f.	Number of fire extinguishers for Projector Room.	2	Functional
g.	No. of Lightening conductors	Provided	functional
h.	Fire alarm system		
i.	Sprinkler system		
j.	Escape and exit routes: PRSENT	REQUIREMENT	ANY SUGGESTION/ SHORTCOMINGS
	15 No	15 No	
	3 Stair	3 Stair	

II.	Name of trained staff of cinema hall in handling fire safety equipments	Level of Training
a.	Hem Raj	Basic
b.	Bipin Kumar	Basic
c.		
d.		

III.	Any other comments.
	


Signature