

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DLEHI
HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001

No. F6/DFS/MS/2013/W2/1063

Dated: 10/10/13

FIRE SAFETY CERTIFICATE

Certified that the Building at Plot No. C-2, Udyog Nagar, Rohtak Road, New Delhi-110041, comprised of **Basement + Ground Floor** only previously owned / occupied by **Union Chemicals** was issued Fire Safety Certificate **vide letter no. F.6/DFS/MS/ 2005/799 dated 15.04.2005.** The premises was re-inspected by the officer concerned of Fire Service on **05.08.2013** in the presence of **Sh. J.K. Aggarwal** and observed that the premise is now occupied by **Micro Foot wears Pvt. Ltd.** and have no additional construction in the building and have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules 2010 and that the building / premises is fit for occupancy class **Industrial** with effect from **10 / 10 /2013** for a period of three years in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules 2010.

Conditions for the validity of Fire Safety Certificate:

1. All the Fire Safety arrangement provided their in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non-functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the3 concerned building sanctioning agency.
5. The basement shall be used strictly as per the provision of building bye laws.
6. This certificate cannot be treated in any case for regularizations of unauthorized construction.
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010.The form is available on www.dfs.delhigovt.nic.in

Issued on 10/10/13 at New Delhi by.

9/10
(SANTOKH SINGH)

Chief Fire Officer,

Delhi Fire Service,

Phone No.011-23414250

Email: dcfowz.dlfire@nic.in

Copy to:-

Sh. J.K. Aggarwal, Micro Foot wears Pvt. Ltd., C-2, Udyog Nagar, Rohtak Road, New Delhi-110041.

OK
Any

Plot Area = 3006.69 m²
 Covered Area = 1464.69 m² (Basement)
 1464.69 m² (GF)

N/11

GF + Basement

INSPECTION REPORT

1. Name & address of the building: c-2, Udyog Nagar, Rohtak Rd.
Delhi - 110041
2. Type of Occupancy : Industrial
3. Type of Case : Renewal
4. Details of previous NOC : Letter No F.6/DFS/MS/2005/799/15.4.2005
5. Fire Safety directives Letter No. : F.6/DFS/MS/2000/828/9.05.2000
6. Date of inspection : 5/8/2013
7. Name of the Inspecting Officer : A.K. JAISWAL
8. Name and designation of Officer
from the building side : Shri J.K. Aggarwal (Partner)
9. Year of Construction : 2000
10. Applicant's letter No. : Nil dt 10/07/2013

S No	Minimum standards on fire prevention and fire safety U/R 33	BBL / NBC Requirements	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	6 Mtr.	Provided	MR
	• Gate width	5 Mtr.	Provided	MR
	• Width of internal road	NA	NA	NA
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	2	3	MR
	• Basements	2	3	MR
	b. Width of staircases			
	• Upper floors	old case	old case	old case
	• Basements	old case	old case	old case
	c. Protection of exits			
	• Fire check door			
	• Pressurization		NR	
	d. No of continuous staircase to terrace	1	1	MR
	e. Width Of Corridor	old case	old case	old case
	f. Door Size	old case	old case	old case

3.	Compartmentation			
	<ul style="list-style-type: none"> • Fire check door • Sealing of electrical shafts • Fire Rating of shaft door • Water Curtain • Fire Dampers 			NR
4.	Smoke managements System			
	<ul style="list-style-type: none"> • Basements 	30 a/c per hour	Exhaust Fan Provided	MR
	<ul style="list-style-type: none"> • Upper floors 	12 a/c per hour	Exhaust Fan Provided	MR
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> • Total numbers 	15	30	MR
	<ul style="list-style-type: none"> • Types 	ABC/CO ₂ /Foam ISI marked	15+5+10	MR
	<ul style="list-style-type: none"> • IS marking 		Provided	MR
6.	First – Aid Hose Reels			
	<ul style="list-style-type: none"> • Total numbers on each floor 	2	Provided	MR
	<ul style="list-style-type: none"> • Length of hose reel hose 	30 Mtr	Provided	MR
	<ul style="list-style-type: none"> • Nozzle diameter 	5 mm	Provided	MR
7.	Automatic fire detection and alarming system			
	<ul style="list-style-type: none"> • Type of detector • Location of Main Panel • Location of Repeater Panel • Alternate source of power • Hooters' Location 			MR
8.	MOEFA	NR	Provided	MR
9.	Public Address System		NR	
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> • Basements 	Required	Provided	MR
	<ul style="list-style-type: none"> • Upper Floor 			
	<ul style="list-style-type: none"> • Sprinkler above false ceiling 		NR	

Internal Hydrants			
• Size of riser/down- comer	100 mm	Provided	MR
• Number of hydrants per floor	2	Provided	MR
• Hose Box	2	Provided	MR
12. Yard Hydrants			
• Total number of hydrants	4	Provided	MR
• Hose Box	4	Provided	MR
13. Pumping Arrangements			
• Ground Level			
• Discharge of main pump	Not mentioned in guidelines	Provided 22 galpm	MR
➤ Head of main pump	Not mentioned in guidelines	Provided 60 MH	MR
➤ Number of main pumps	1	Provided	MR
➤ Jockey pump out put			
➤ Jockey pump head			
➤ Standby Pump out put		NR	
➤ Standby Pump Head			
➤ Auto Starting/Manual stopping	Required	Provided	MR
➤ Pump House Access	Required	Provided	MR
• Terrace level			
➤ Discharge of pump	Not mentioned in guidelines	Provided 90 galpm	MR
➤ Head of the pump	Not mentioned in guidelines	Provided 40 MH	MR
➤ Power supply	Required	Provided	MR
➤ Auto starting of pump	Required	Provided	MR
14. Captive water Storage for fire fighting			
• Under ground tank capacity	1,00,000 lts	Provided	MR
➤ Draw of connection	NR	Provided	MR
➤ Fire service inlet	NR	Provided	MR
➤ Access to tank	Required	Provided	MR
• Overhead Tank capacity	25,000 lts	Provided	MR


15	Exit Signage	Required	Provided	MR
16.	Provision of Lifts			
	➤ Pressurization of Lift Shaft			
	➤ Pressurization of lift lobby			
	➤ Communication in lift Car		NR	
	➤ Fireman's Grounding Switch			
	➤ Lift Signage			
17.	Standby power supply	Required	Provided	MR
18.	Refuge Area		NR	
	➤ Total area			
	➤ Location		NR	
19.	Fire control room			
	➤ Detector system panel			
	➤ Flow Switch Panel			
	➤ PA System Panel		NR	
	➤ Batter backup			
	➤ Building Floor Plans			
20.	Special Fire Protection Systems for Protection of special Risks, if any;	At DG set, Foam Fire Extinguishers Required	Provided	MR

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

Note

Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules 2010/issue shortcomings as noted at serial numbers

.....

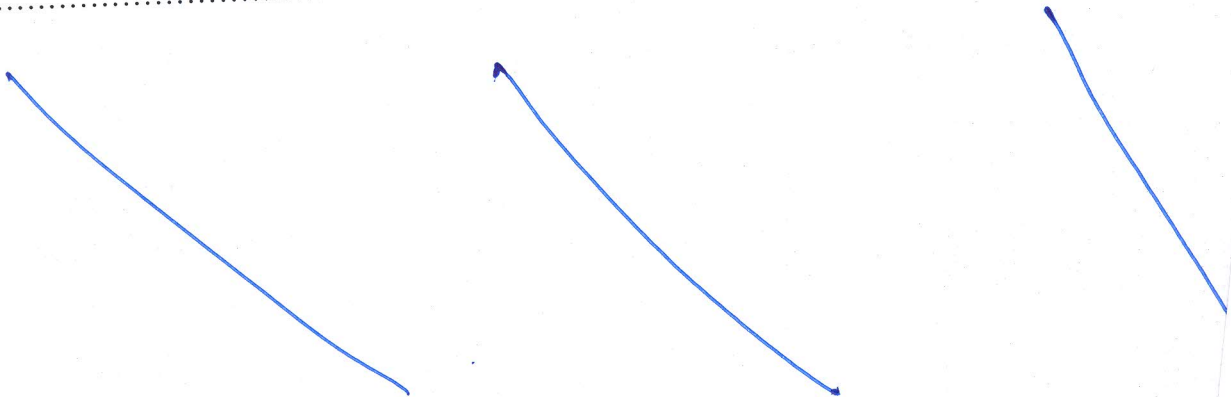

Note! Previous Noc was issued ^{N/15} in favour of
union chemical, now Micro Footwear Pvt Ltd
summing the trade of Footwear manufacturing
and duly allowed by MCS (Copy Attached).

Ak Jaiswal
22/8/13

Signature of the Inspecting Officer

Name

(A.K. JAISWAL)

Designation

ADO/(JWP)

Signature of the Inspecting Officer

Name

Designation

