

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001

No. F61DPS/MS/15(2013)/W2/1168

Dated: 4/11/13

FIRE SAFETY CERTIFICATE

Certified that the **ASM Public School** at **Prem Nagar-1, Station Block, Street No-9 & 11, Kirari Suleman Nagar, Kirari, Delhi-110086** is comprised of **Ground + One upper floor** only owned / occupied by **Anand Swaroop Educational and Social Welfare Society (Regd.)** have complied with the fire prevention and fire safety requirements in accordance with Director of Education **Circular No. F6/Estate/CC/Fire/Safety/2011/3298-3398 dated 01/03/2011** and verified by the officer concerned of Fire Service on **15.10.2013** in presence of **Smt. Rekha Sharma (Principal)** and that the building / premises is fit for occupancy class **Educational** with effect from **4/11/13**.....for a period of 3 (three) years subject to conditions printed below.

Conditions for the validity of Fire Safety Certificate:

1. All the fire safety arrangement provided their in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. The basement shall be used strictly as per the provision of building bye laws.
6. This certificate cannot be treated in any case for regularizations of unauthorized construction.
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on WWW.dfs.Delhigovt.nic.in

Issued on 4/11/13 at New Delhi by.


(SANTOKH SINGH)
CHIEF FIRE OFFICER
DELHI FIRE SERVICE
Phone:-23414250

E-mail: cfowz.dlfire@nic.in

Copy to :-

1. Smt. Rekha Sharma (Principal), ASM Public School, Prem Nagar-1, Station Block, Street No-9 & 11, Kirari Suleman Nagar, Kirari, Delhi-110086.
2. The Director of Education, GNCT of Delhi, Old Secretariat, Delhi-110054.

Rooms = 8,
Students = 150

Plot Area = 3000 yard²
Covered Area = 200 yard²

G+1

INSPECTION REPORT

1. Name & address of the building: ASM Public School, Prem Nagar 1
Stn. Block, Street No-9 & 11, Kirari Sulaman
Ngr, Kirari, Delhi-86
2. Type of Occupancy : Educational
3. Type of Case : New
4. Details of previous NOC : Letter No — Nil
5. Fire Safety directives Letter No. : D.O.E. Circular dated 1/3/11
6. Date of inspection : 15/1/2013
7. Name of the Inspecting Officer : A.K. Jaiswal
8. Name and designation of Officer
from the building side : Rekha Sharma (Principal)
9. Year of Construction : 2001
10. Applicant's letter No. : ASM / CFO / 2013 / Dated 29/8/2013

S No	Minimum standards on fire prevention and fire safety U/R 33	BBL/D.O.E. Cir. dt 1.3.11 Requirements	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	<u>Accessible</u>	<u>Provided</u>	<u>MR</u>
	• Gate width	<u>Accessible</u>	<u>Provided</u>	<u>MR</u>
	• Width of internal road	<u>NA</u>	<u>NA</u>	<u>NA</u>
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	<u>1</u>	<u>2</u>	<u>MR</u>
	• Basements	<u>NA</u>	<u>NA</u>	<u>NA</u>
	b. Width of staircases			
	• Upper floors	<u>1.50 Mtr.</u>	<u>92 cm / 85 cm</u>	<u>MR</u>
	• Basements	<u>NA</u>	<u>NA</u>	<u>NA</u>
	c. Protection of exits			
	• Fire check door		<u>NA</u>	
	• Pressurization			
	d. No of continuous staircase to terrace	<u>1</u>	<u>Provided</u>	<u>MR</u>
	e. Width Of Corridor	<u>NA</u>	<u>NA</u>	<u>NA</u>
	f. Door Size	<u>1.00 Mtr.</u>	<u>Provided</u>	<u>MR</u>

N₂

3.	Compartmentation			
	<ul style="list-style-type: none"> • Fire check door • Sealing of electrical shafts • Fire Rating of shaft door • Water Curtain • Fire Dampers 			
4.	Smoke managements System			
	<ul style="list-style-type: none"> • Basements • Upper floors 	30 a/c per hour		
		12 a/c per hour	open to sky	MR
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> • Total numbers • Types • IS marking 	3 ABC/CO ₂ ISI marked	provided	MR
			provided	MR
			provided	MR
6.	First – Aid Hose Reels			
	<ul style="list-style-type: none"> • Total numbers on each floor • Length of hose reel hose • Nozzle diameter 			
7.	Automatic fire detection and alarming system			
	<ul style="list-style-type: none"> • Type of detector • Location of Main Panel • Location of Repeater Panel • Alternate source of power • Hooters' Location 			
8.	MOEFA			
9.	Public Address System			
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> • Basements • Upper Floor • Sprinkler above false ceiling 			

NA

NA

NR

NR

NR

NR

11.	Internal Hydrants			
	<ul style="list-style-type: none"> • Size of riser/down- comer 			
	<ul style="list-style-type: none"> • Number of hydrants per floor 			
	<ul style="list-style-type: none"> • Hose Box 			
12.	Yard Hydrants			
	<ul style="list-style-type: none"> • Total number of hydrants 			
	<ul style="list-style-type: none"> • Hose Box 			
13.	Pumping Arrangements			
	<ul style="list-style-type: none"> • Ground Level 			
	<ul style="list-style-type: none"> • Discharge of main pump 			
	<ul style="list-style-type: none"> ➤ Head of main pump 			
	<ul style="list-style-type: none"> ➤ Number of main pumps 			
	<ul style="list-style-type: none"> ➤ Jockey pump out put 			
	<ul style="list-style-type: none"> ➤ Jockey pump head 			
	<ul style="list-style-type: none"> ➤ Standby Pump out put 			
	<ul style="list-style-type: none"> ➤ Standby Pump Head 			
	<ul style="list-style-type: none"> ➤ Auto Staring/Manual stopping 			
	<ul style="list-style-type: none"> ➤ Pump House Access 			
	<ul style="list-style-type: none"> • Terrace level 			
	<ul style="list-style-type: none"> ➤ Discharge of pump 			
	<ul style="list-style-type: none"> ➤ Head of the pump 			
	<ul style="list-style-type: none"> ➤ Power supply 			
	<ul style="list-style-type: none"> ➤ Auto starting of pump 			
14.	Captive water Storage for fire fighting			
	<ul style="list-style-type: none"> • Under ground tank capacity 			
	<ul style="list-style-type: none"> ➤ Draw of connection 			
	<ul style="list-style-type: none"> ➤ Fire service inlet 			
	<ul style="list-style-type: none"> ➤ Access to tank 			
	<ul style="list-style-type: none"> • Overhead Tank capacity 			

NR

NR

NR


NR

NA

15	Exit Signage		NR	
16.	Provision of Lifts			
	➤ Pressurization of Lift Shaft			
	➤ Pressurization of lift lobby			
	➤ Communication in lift Car		NR	
	➤ Fireman's Grounding Switch			
	➤ Lift Signage			
17.	Standby power supply			
18.	Refuge Area			
	➤ Total area		NA	
	➤ Location			
19.	Fire control room			
	➤ Detector system panel			
	➤ Flow Switch Panel			
	➤ PA System Panel		NA	
	➤ Batter backup			
	➤ Building Floor Plans			
20.	Special Fire Protection Systems for Protection of special Risks, if any;		NA	

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules 2010/issue ~~shortcomings as noted at serial numbers~~

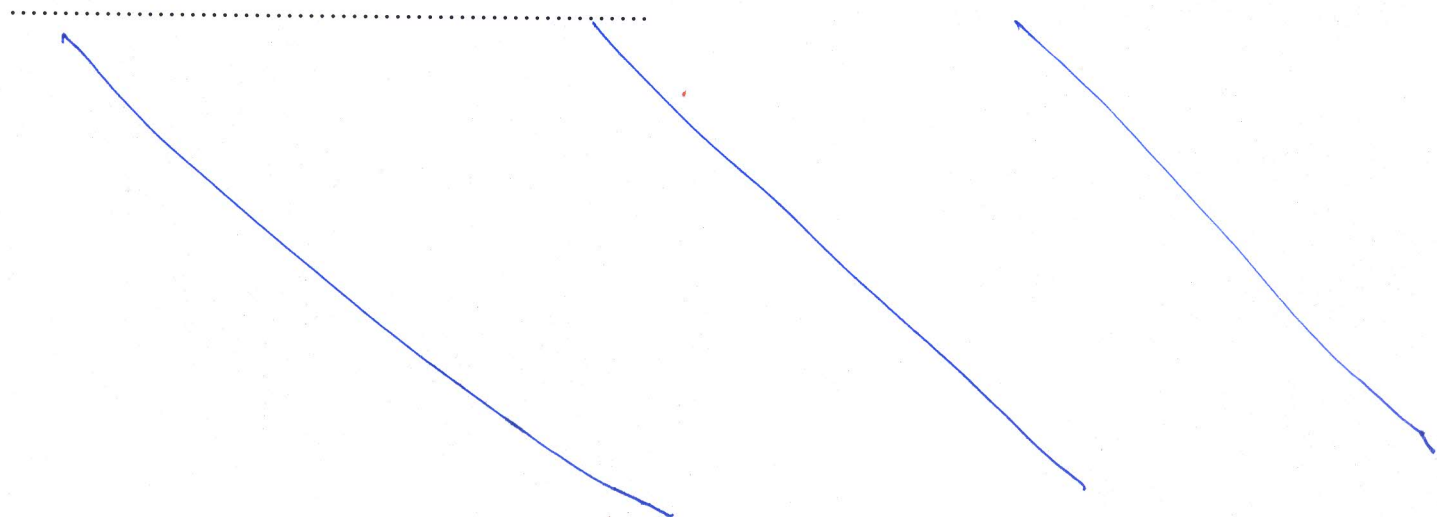

N5

Ak Jaiswal
25/11/13

Signature of the Inspecting Officer

Name

(A. K. JAISWAL)

Designation

ADD/(JWP)

Signature of the Inspecting Officer

Name

Designation