

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001**

No. F6/DFS/MS/School/2013/W2/1177

Dated: 08/11/13

**FIRE SAFETY CERTIFICATE**

Certified that the **R. L. Public School**, at **28/A, Karan / Vihar, Part-V, Kirari Exten, Nangloi, Delhi-110041** comprised of **ground + one upper floor** only owned / occupied by **R. L. Public School** has already been issued FSC by this department vide letter No. **F.6/MS/DFS/2007/2213** dated **13.08.2007**. The premises was re-inspected by the officer concerned of this department on **25.10.2013** in the presence of **Smt. Dayawati (Principal)** and observed that Fire prevention and fire safety arrangements provided in the premises, found in good working condition. The premises have therefore, deemed complied with the fire prevention and fire safety requirements in accordance with the circular issued by **Director of Education, GNCT of Delhi** vide letter No. **262-362** dated **17.01.2005** and that the building / premises is fit for occupancy Educational (Group B) with effect from **08/11/13**.....for a period of 3 (three) years subject to conditions printed below.

**Conditions for the validity of Fire Safety Certificate:**

1. All the fire safety arrangement provided their in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. The basement shall be used strictly as per the provision of building bye laws.
6. This certificate cannot be treated in any case for regularizations of unauthorized construction.
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on [WWW.dfs.Delhigovt.nic.in](http://WWW.dfs.Delhigovt.nic.in)

**Issued on 08/11/13 at New Delhi by.**

**(SANTOKH SINGH)**  
**CHIEF FIRE OFFICER**  
**DELHI FIRE SERVICE**  
**Phone:-23414250**  
**E-mail: cfowz.dlfire@nic.in**

**Copy to :-**

1. Smt. Dayawati (Principal), R. L. Public School, 28/A, Karan / Vihar, Part-V, Kirari Exten, Nangloi, Delhi-110041.
2. The Director of Education, GNCT of Delhi, Old Secretariat, Delhi-110054.

Plot Area = 265 yard<sup>2</sup>  
 covered Area = 265 yard<sup>2</sup> N7 G+1

### INSPECTION REPORT

1. Name & address of the building: R.L. Public School, 28/A, Kaganvihar  
Part V, Kirti Extn, Nangloi, Delhi-41
2. Type of Occupancy : Educational
3. Type of Case : Renewal ✓
4. Details of previous NOC : Letter No F.6/MS/DFS/2007/2213/13-8-07
5. Fire Safety directives Letter No. : D.O.E circular dated 17/01/2005
6. Date of inspection : 25/11/13
7. Name of the Inspecting Officer : A.K. Jaiswal
8. Name and designation of Officer  
 from the building side : Dayawati (Principal)
9. Year of Construction : 2007
10. Applicant's letter No. : RLPS / Renewal / Fire / 09/2013 / dt 13<sup>9</sup>/<sub>13</sub>

S No	Minimum standards on fire prevention and fire safety U/R 33	BBL/DOE Cir. 17.01.05 Requirements	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	Accessible	Provided	MR
	• Gate width	Accessible	Provided	MR
	• Width of internal road	NA	NA	NA
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	2	2	MR
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper floors	old case	old case	old case
	• Basements	NA	NA	NA
	c. Protection of exits			
	• Fire check door	NR	NR	NR
	• Pressurization	NR	NR	NR
	d. No of continuous staircase to terrace	old case	old case	old case
	e. Width Of Corridor	NA	NA	NA
	f. Door Size	old case	old case	old case


3.	Compartmentation			
	<ul style="list-style-type: none"> <li>• Fire check door</li> <li>• Sealing of electrical shafts</li> <li>• Fire Rating of shaft door</li> <li>• Water Curtain</li> <li>• Fire Dampers</li> </ul>		NR	
4.	Smoke managements System			
	<ul style="list-style-type: none"> <li>• Basements</li> </ul>	30 a/c per hour	NR	NR
	<ul style="list-style-type: none"> <li>• Upper floors</li> </ul>	12 a/c per hour	Natural ventilation	NR
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> <li>• Total numbers</li> <li>• Types</li> <li>• IS marking</li> </ul>	4 ABC/CO <sub>2</sub> ISI marked	5 Provided Provided	NR NR NR
6.	First - Aid Hose Reels			
	<ul style="list-style-type: none"> <li>• Total numbers on each floor</li> <li>• Length of hose reel hose</li> <li>• Nozzle diameter</li> </ul>	one 30 Mtr. 5 mm	Provided Provided Provided	NR NR NR
7.	Automatic fire detection and alarming system			
	<ul style="list-style-type: none"> <li>• Type of detector</li> <li>• Location of Main Panel</li> <li>• Location of Repeater Panel</li> <li>• Alternate source of power</li> <li>• Hooters' Location</li> </ul>		NR	
8.	MOEFA		NR	
9.	Public Address System		NR	
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> <li>• Basements</li> <li>• Upper Floor</li> <li>• Sprinkler above false ceiling</li> </ul>		NR	



		Required	Provided	NR
15	Exit Signage			
16.	Provision of Lifts			
	➤ Pressurization of Lift Shaft			
	➤ Pressurization of lift lobby			
	➤ Communication in lift Car			
	➤ Fireman's Grounding Switch			NR
	➤ Lift Signage			
17.	Standby power supply			
18.	Refuge Area			NR
	➤ Total area			
	➤ Location			NR
19.	Fire control room			
	➤ Detector system panel			
	➤ Flow Switch Panel			
	➤ PA System Panel			
	➤ Batter backup			N/A
	➤ Building Floor Plans			
20.	Special Fire Protection Systems for Protection of special Risks, if any;			N/A

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules 2010/~~issue shortcomings as noted at serial numbers~~

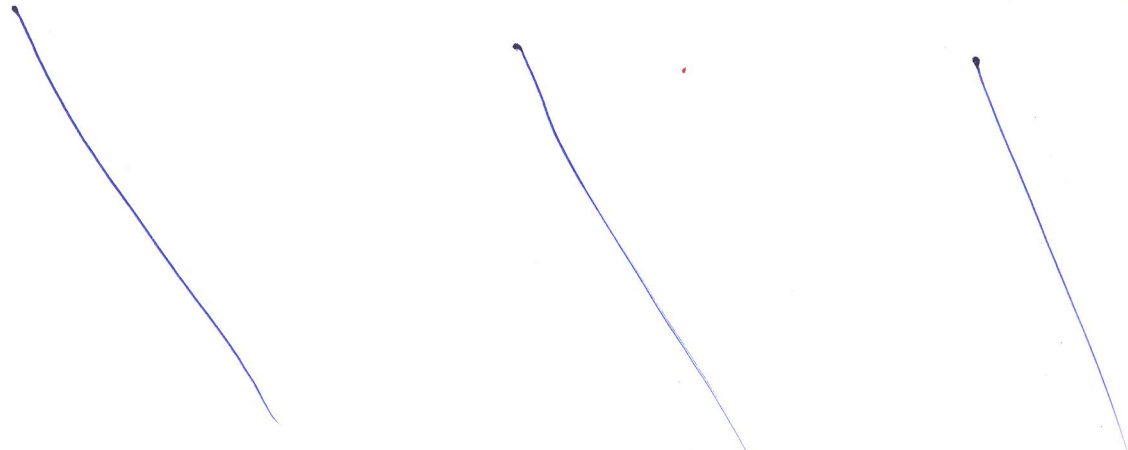

NH

A.K. Jaiswal  
25/10/13

Signature of the Inspecting Officer

Name

(A.K. JAISWAL)

Designation

ADO/(JWP)

Signature of the Inspecting Officer

Name

Designation