

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001

No. F6/DFS/MS/School/2013/W2/1174

Dated: 08/11/13

FIRE SAFETY CERTIFICATE

Certified that the **Nand Bharti Public School**, at 44, Friends Enclave, Sec.-5, Nangloi, Delhi-110041 comprised of **ground + one upper floor** only owned / occupied by **Nand Bharti Educational Society (Regd.)** was earlier issued FSC by this department vide letter No. F.6/MS/DFS/06/3280 dated 07.11.2006. The premises was re-inspected by the officer concerned of this department on **25.10.2013** in the presence of **Smt. Varsha Aroda (Principal)** and observed that Fire prevention and fire safety arrangements provided in the premises, found in good working condition. The premises have therefore, deemed complied with the fire prevention and fire safety requirements in accordance with the circular issued by **Director of Education, GNCT of Delhi vide letter No. 262-362 dated 17.01.2005** and that the building / premises is fit for occupancy Educational (Group B) with effect from ...08/11/13....for a period of 3 (three) years subject to conditions printed below.

Conditions for the validity of Fire Safety Certificate:

1. All the fire safety arrangement provided their in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. The basement shall be used strictly as per the provision of building bye laws.
6. This certificate cannot be treated in any case for regularizations of unauthorized construction.
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on WWW.dfs.Delhigovt.nic.in

Issued on 08/11/13 **at New Delhi by.**

(SANTOKH SINGH)
CHIEF FIRE OFFICER
DELHI FIRE SERVICE

Phone:-23414250

E-mail: cfowz.dlfire@nic.in

Copy to :-

1. Smt. Versha Aroda (Principal), Nand Bharti Public School, 44, Friends Enclave, Sec.-5, Nangloi, Delhi-110041.
2. The Director of Education, GNCT of Delhi, Old Secretariat, Delhi-110054.

Plot Area = 222 sq ft N3

G+1

INSPECTION REPORT

1. Name & address of the building: Nand Bharti Public School, 44 Friends Enclave, Sector-5, Nangloi, Delhi-41
2. Type of Occupancy : Educational
3. Type of Case : Renewal
4. Details of previous NOC : Letter No F.6/MS/DFS/06/3280/dt 7.11.2006
5. Fire Safety directives Letter No. : D.O.E circular dated 17/01/2005
6. Date of inspection : 25/1/13
7. Name of the Inspecting Officer : A.K. Jaiswal
8. Name and designation of Officer Varsha Arora (Principal) from the building side : 2006
9. Year of Construction : -----
10. Applicant's letter No. : Nil dated 16/09/2013

S No	Minimum standards on fire prevention and fire safety U/R 33	BBL / ^{D.O.E circular} 17/01/05 Requirements	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	<u>Accessible</u>	<u>Provided</u>	<u>MR</u>
	• Gate width	<u>Accessible</u>	<u>Provided</u>	<u>MR</u>
	• Width of internal road	<u>NA</u>	<u>NA</u>	<u>NA</u>
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	<u>2</u>	<u>2</u>	<u>MR</u>
	• Basements	<u>NA</u>	<u>NA</u>	<u>NA</u>
	b. Width of staircases			
	• Upper floors	<u>old case</u>	<u>old case</u>	<u>old case</u>
	• Basements	<u>NA</u>	<u>NA</u>	<u>NA</u>
	c. Protection of exits			
	• Fire check door			
	• Pressurization		<u>NR</u>	
	d. No of continuous staircase to terrace	<u>1</u>	<u>Provided</u>	<u>MR</u>
	e. Width Of Corridor	<u>old case</u>	<u>old case</u>	<u>old case</u>
	f. Door Size	<u>old case</u>	<u>old case</u>	<u>old case</u>

Ny

3.	Compartmentation			
	<ul style="list-style-type: none"> • Fire check door • Sealing of electrical shafts • Fire Rating of shaft door • Water Curtain • Fire Dampers 			NR
4.	Smoke managements System			
	<ul style="list-style-type: none"> • Basements 	30 a/c per hour	NA	NA
	<ul style="list-style-type: none"> • Upper floors 	12 a/c per hour	open to sky	MR
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> • Total numbers 	5	Provided	MR
	<ul style="list-style-type: none"> • Types 	ABC/CO ₂	Provided	MR
	<ul style="list-style-type: none"> • IS marking 	ISI marked	Provided	MR
6.	First – Aid Hose Reels			
	<ul style="list-style-type: none"> • Total numbers on each floor 	one	Provided	MR
	<ul style="list-style-type: none"> • Length of hose reel hose 	30 Mtr.	Provided	MR
	<ul style="list-style-type: none"> • Nozzle diameter 	5 mm	Provided	MR
7.	Automatic fire detection and alarming system			
	<ul style="list-style-type: none"> • Type of detector • Location of Main Panel • Location of Repeater Panel • Alternate source of power • Hooters' Location 			NR
8.	MOEFA			NR
9.	Public Address System			NR
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> • Basements • Upper Floor • Sprinkler above false ceiling 			NR


11.	Internal Hydrants			
	<ul style="list-style-type: none"> • Size of riser/down-comer 			NR
	<ul style="list-style-type: none"> • Number of hydrants per floor 			
	<ul style="list-style-type: none"> • Hose Box 			
12.	Yard Hydrants			
	<ul style="list-style-type: none"> • Total number of hydrants 			NR
	<ul style="list-style-type: none"> • Hose Box 			
13.	Pumping Arrangements			
	<ul style="list-style-type: none"> • Ground Level 			NR
	<ul style="list-style-type: none"> • Discharge of main pump 			
	<ul style="list-style-type: none"> ➤ Head of main pump 			
	<ul style="list-style-type: none"> ➤ Number of main pumps 			
	<ul style="list-style-type: none"> ➤ Jockey pump out put 			
	<ul style="list-style-type: none"> ➤ Jockey pump head 			
	<ul style="list-style-type: none"> ➤ Standby Pump out put 			
	<ul style="list-style-type: none"> ➤ Standby Pump Head 			
	<ul style="list-style-type: none"> ➤ Auto Starting/Manual stopping 			
	<ul style="list-style-type: none"> ➤ Pump House Access 			
	<ul style="list-style-type: none"> • Terrace level 			
	<ul style="list-style-type: none"> ➤ Discharge of pump 	220 lpm	Provided	NR
	<ul style="list-style-type: none"> ➤ Head of the pump 	40 MTH	Provided	NR
	<ul style="list-style-type: none"> ➤ Power supply 	Required	Provided	NR
	<ul style="list-style-type: none"> ➤ Auto starting of pump 	Required	Provided	NR
14.	Captive water Storage for fire fighting			
	<ul style="list-style-type: none"> • Under ground tank capacity 			NR
	<ul style="list-style-type: none"> ➤ Draw of connection 			
	<ul style="list-style-type: none"> ➤ Fire service inlet 			
	<ul style="list-style-type: none"> ➤ Access to tank 			
	<ul style="list-style-type: none"> • Overhead Tank capacity 	2500 lts	Provided	NR

		Required	Provided	MR
15	Exit Signage			MR
16.	Provision of Lifts			
	➤ Pressurization of Lift Shaft			
	➤ Pressurization of lift lobby			
	➤ Communication in lift Car		NA	
	➤ Fireman's Grounding Switch			
	➤ Lift Signage			
17.	Standby power supply		MR	
18.	Refuge Area			
	➤ Total area			
	➤ Location		NA	
19.	Fire control room			
	➤ Detector system panel			
	➤ Flow Switch Panel			
	➤ PA System Panel		NA	
	➤ Batter backup			
	➤ Building Floor Plans			
20.	Special Fire Protection Systems for Protection of special Risks, if any;		NA	

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules 2010/issue ~~shortcomings as noted at serial numbers~~

.....

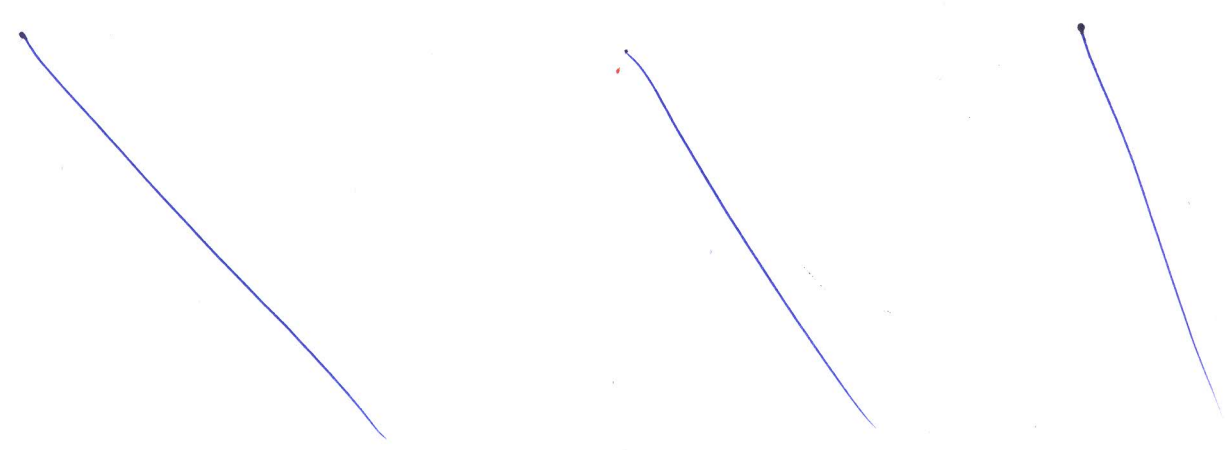

N7

~~A.K. Jaiswal~~
25/10/13

Signature of the Inspecting Officer

Signature of the Inspecting Officer

Name

(A.K. JAISWAL)

Name

Designation

ADO / (JWP)

Designation