

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001**

No. F6/DFS/MS/SCHOOL/2013/ W2 /1238

Dated: 27/11/13

**FIRE SAFETY CERTIFICATE**

Certified that the **Adarsh Public School** at **A-63, Adhyapak Nagar, Peer Baba Road, Nangloi, Delhi-41** is comprised of **Ground floor** only owned / occupied by **Lala Gyani Ram Garg Educational Society** have complied with the fire prevention and fire safety requirements in accordance with Director of Education **Circular No. F6/Estate/CC/Fire/Safety/2011/3298-3398 dated 01/03/2011** and verified by the officer concerned of Fire Service on **14.11.2013** in presence of **Smt. Savita** and that the building / premises is fit for occupancy class **Educational** with effect from **27/11/13**.....for a period of 3 (three) years subject to conditions printed below.

**Conditions for the validity of Fire Safety Certificate:**

1. All the fire safety arrangement provided their in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. The basement shall be used strictly as per the provision of building bye laws.
6. This certificate cannot be treated in any case for regularizations of unauthorized construction.
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on [WWW.dfs.Delhigovt.nic.in](http://WWW.dfs.Delhigovt.nic.in)

**Issued on 27/11/13 at New Delhi by.**

  
(SANTOKH SINGH)

**CHIEF FIRE OFFICER  
DELHI FIRE SERVICE**

**Phone:-23414250**

**E-mail: cfowz.dfire@nic.in**

**Copy to :-**

1. The Manager, Adarsh Public School, A-63, Adhyapak Nagar, Peer Baba Road, Nangloi, Delhi-41.
2. The Director of Education, GNCT of Delhi, Old Secretariat, Delhi-110054.

N<sub>1</sub> Plot Area = 320 yard<sup>2</sup>  
 Covered Area = 280 yard<sup>2</sup> (G, F only)

**INSPECTION REPORT**

1. Name & address of the building: Adarsh Public School  
A-63, Peer Baba Road, Adhyapak
2. Type of Occupancy : Educational Nagar, Ngl, DLIA
3. Type of Case : New
4. Details of previous NOC : Letter No Nil
5. Fire Safety directives Letter No. : D.O.E. circular dated 1/3/11
6. Date of inspection : 14/11/2013
7. Name of the Inspecting Officer : ADO A.K. JAISWAL
8. Name and designation of Officer  
 from the building side : Savita (Teacher)
9. Year of Construction : 2009
10. Applicant's letter No. : Nil dated Nil

S No	Minimum standards on fire prevention and fire safety U/R 33	BBL / DOE or Requirements	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	<u>Accessible</u>	<u>Provided</u>	<u>MR</u>
	• Gate width	<u>Accessible</u>	<u>Provided</u>	<u>MR</u>
	• Width of internal road	<u>NA</u>	<u>NA</u>	<u>NA</u>
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors			
	• Basements			
	b. Width of staircases			
	• Upper floors			
	• Basements			
	c. Protection of exits			
	• Fire check door			
	• Pressurization			
	d. No of continuous staircase to terrace			
	e. Width Of Corridor	<u>NA</u>	<u>NA</u>	<u>NA</u>
	f. Door Size	<u>1.00 Mtr.</u>	<u>Provided</u>	<u>MR</u>

N<sub>2</sub>

3.	Compartmentation			
	<ul style="list-style-type: none"> <li>• Fire check door</li> <li>• Sealing of electrical shafts</li> <li>• Fire Rating of shaft door</li> <li>• Water Curtain</li> <li>• Fire Dampers</li> </ul>			
4.	Smoke managements System			
	<ul style="list-style-type: none"> <li>• Basements</li> <li>• Upper floors</li> </ul>	30 a/c per hour		
		12 a/c per hour		
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> <li>• Total numbers</li> <li>• Types</li> <li>• IS marking</li> </ul>	2 ABC / Co <sub>2</sub> ISI marked	Provided	NR
			Provided	NR
			Provided	NR
6.	First – Aid Hose Reels			
	<ul style="list-style-type: none"> <li>• Total numbers on each floor</li> <li>• Length of hose reel hose</li> <li>• Nozzle diameter</li> </ul>			
7.	Automatic fire detection and alarming system			
	<ul style="list-style-type: none"> <li>• Type of detector</li> <li>• Location of Main Panel</li> <li>• Location of Repeater Panel</li> <li>• Alternate source of power</li> <li>• Hooters' Location</li> </ul>			
8.	MOEFA			
9.	Public Address System			
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> <li>• Basements</li> <li>• Upper Floor</li> <li>• Sprinkler above false ceiling</li> </ul>			

NA

NA

NR

NR

NR

NR

NR

11.	Internal Hydrants			
	<ul style="list-style-type: none"> <li>• Size of riser/down- comer</li> <li>• Number of hydrants per floor</li> <li>• Hose Box</li> </ul>			NR

12.	Yard Hydrants			
	<ul style="list-style-type: none"> <li>• Total number of hydrants</li> <li>• Hose Box</li> </ul>			NR

13.	Pumping Arrangements			
	<ul style="list-style-type: none"> <li>• Ground Level</li> <li>• Discharge of main pump</li> <li>➤ Head of main pump</li> <li>➤ Number of main pumps</li> <li>➤ Jockey pump out put</li> <li>➤ Jockey pump head</li> <li>➤ Standby Pump out put</li> <li>➤ Standby Pump Head</li> <li>➤ Auto Staring/Manual stopping</li> <li>➤ Pump House Access</li> <li>• Terrace level</li> <li>➤ Discharge of pump</li> <li>➤ Head of the pump</li> <li>➤ Power supply</li> <li>➤ Auto starting of pump</li> </ul>			NA

14.	Captive water Storage for fire fighting			
	<ul style="list-style-type: none"> <li>• Under ground tank capacity</li> <li>➤ Draw of connection</li> <li>➤ Fire service inlet</li> <li>➤ Access to tank</li> <li>• Overhead Tank capacity</li> </ul>			NR


N4

N

15	Exit Signage		NR	
16.	Provision of Lifts			
	➤ Pressurization of Lift Shaft			
	➤ Pressurization of lift lobby			
	➤ Communication in lift Car			
	➤ Fireman's Grounding Switch			
	➤ Lift Signage			
17.	Standby power supply		NR	
18.	Refuge Area			
	➤ Total area			
	➤ Location		NA	
19.	Fire control room			
	➤ Detector system panel			
	➤ Flow Switch Panel			
	➤ PA System Panel			
	➤ Batter backup			
	➤ Building Floor Plans		NA	
20.	Special Fire Protection Systems for Protection of special Risks, if any;		NA	

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules 2010/issue ~~shortcomings as noted at serial numbers~~ .....

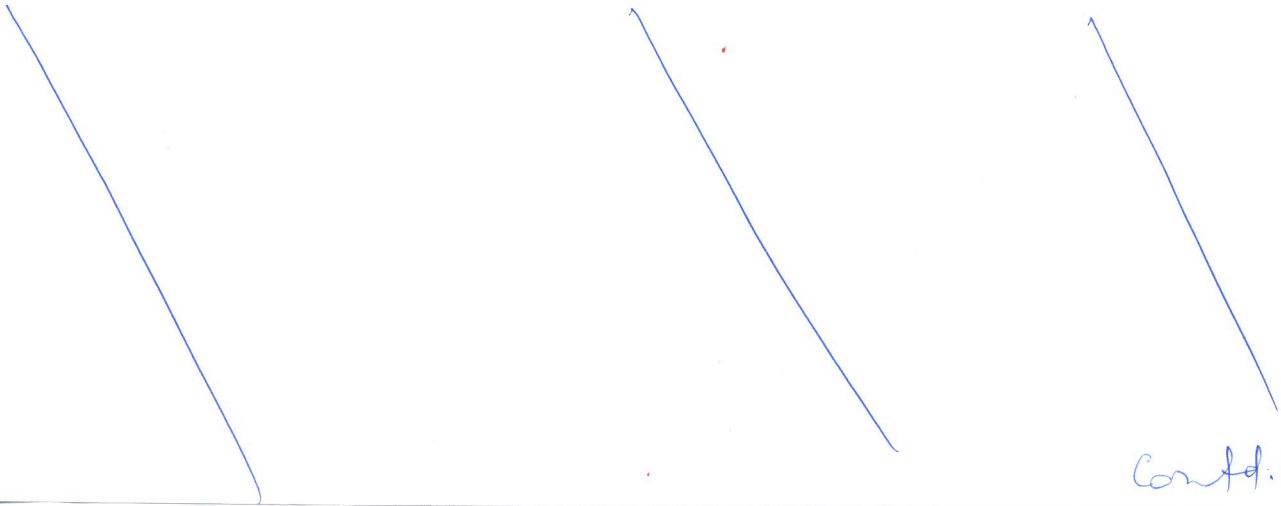

Contd. on N5

Adarsh Public School A-63  
Adhyapak Nagar, Mangli, Delhi-41

A. K. Jaiswal  
14/11/13

Signature of the Inspecting Officer

Signature of the Inspecting Officer

Name

(A.K. JAISWAL)  
A.D.O. (JWP)

Name

Designation

D.O. (W) d

Designation