

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001

No. F6/DFS/MS/SCHOOL/2013/ W2 /1237

Dated: 27 /11 /13


FIRE SAFETY CERTIFICATE

Certified that **R.P.M. Public School** located at Shyam Colony, Gali No. – 19 Budh Vihar Phase - II, Delhi, comprised of Ground floor only owned / occupied by **R.P.M. Public School**, have complied with the fire prevention and fire safety requirements in accordance with circular issued by Director of Education, Govt. of NCT vide letter no. F16/Estate/CC/Fire/Safety/2011/3298 to 3398 dated 01/03/2011 and verified by the officer concerned of Fire Service on 11.11.2013 in presence of Sh. Manoj (Teacher) and that the building / premises is fit for occupancy class Educational (Group B) with effect from27/11/13.....for a period of 3 (three) years subject to conditions printed below.

Conditions for the validity of Fire Safety Certificate:

1. All the fire safety arrangement provided their in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. The basement shall be used strictly as per the provision of building bye laws.
6. This certificate cannot be treated in any case for regularizations of unauthorized construction.
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on WWW.dfs.Delhigovt.nic.in

Issued on 27/11/13 at New Delhi by.


(SANTOKH SINGH)
CHIEF FIRE OFFICER
DELHI FIRE SERVICE

Phone:-23414250

E-mail: cfowz.dlfire@nic.in

Copy to :-

1. The Manager, R.P.M. Public School, Shyam Colony, Gali No.-19, Budh Vihar, Phase-II, Delhi.
2. The Director of Education, GNCT of Delhi, Old Secretariat, Delhi-110054.

INSPECTION REPORT

Plot Area = 200 yard²
 covered Area = 160 yard²
 Ground Floor only

1. Name & address of the building: R.P.M. Public School, Shyam Colony
Gali No 19, Budh Vihar, Phase II, Delhi
2. Type of Occupancy : Educational
3. Type of Case : New
4. Details of previous NOC : Letter No Nil
5. Fire Safety directives Letter No. : DOE circular 1/3/2011
6. Date of inspection : 11/11/2013
7. Name of the Inspecting Officer : A.K. Jaiswal
8. Name and designation of Officer
 from the building side : Manoj (Teacher)
9. Year of Construction : 2006
10. Applicant's letter No. : R.P.M/PS/BV/13/10 Dated 8/10/2013


S No	Minimum standards on fire prevention and fire safety U/R 33	BBL/DOE Cir. 1/3/11 Requirements	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	Accessible	Provided	MR
	• Gate width	Accessible	Provided	MR
	• Width of internal road	NA	NA	NA
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors			
	• Basements			
	b. Width of staircases			
	• Upper floors			
	• Basements			
	c. Protection of exits			
	• Fire check door			
	• Pressurization			
	d. No of continuous staircase to terrace			
	e. Width Of Corridor	NA	NA	NA
	f. Door Size	1.00 Mtr	Provided	MR

3.	Compartmentation			
	<ul style="list-style-type: none"> • Fire check door • Sealing of electrical shafts • Fire Rating of shaft door • Water Curtain • Fire Dampers 		NR	
4.	Smoke managements System			
	<ul style="list-style-type: none"> • Basements • Upper floors 	30 a/c per hour 12 a/c per hour	NA	
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> • Total numbers • Types • IS marking 	2 ABC/CO2 ISI marked	Provided Provided Provided	MR MR MR
6.	First - Aid Hose Reels			
	<ul style="list-style-type: none"> • Total numbers on each floor • Length of hose reel hose • Nozzle diameter 		NA	
7.	Automatic fire detection and alarming system			
	<ul style="list-style-type: none"> • Type of detector • Location of Main Panel • Location of Repeater Panel • Alternate source of power • Hooters' Location 		NA	
8.	MOEFA		NA	
9.	Public Address System			
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> • Basements • Upper Floor • Sprinkler above false ceiling 		NA	

15	Exit Signage		NR	
16.	Provision of Lifts			
	➤ Pressurization of Lift Shaft			
	➤ Pressurization of lift lobby			
	➤ Communication in lift Car		NA	
	➤ Fireman's Grounding Switch			
	➤ Lift Signage			
17.	Standby power supply		NR	
18.	Refuge Area			
	➤ Total area			
	➤ Location		NA	
19.	Fire control room			
	➤ Detector system panel			
	➤ Flow Switch Panel			
	➤ PA System Panel		NA	
	➤ Batter backup			
	➤ Building Floor Plans			
20.	Special Fire Protection Systems for Protection of special Risks, if any;		NA	

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules 2010/~~issue shortcomings as noted at serial numbers~~

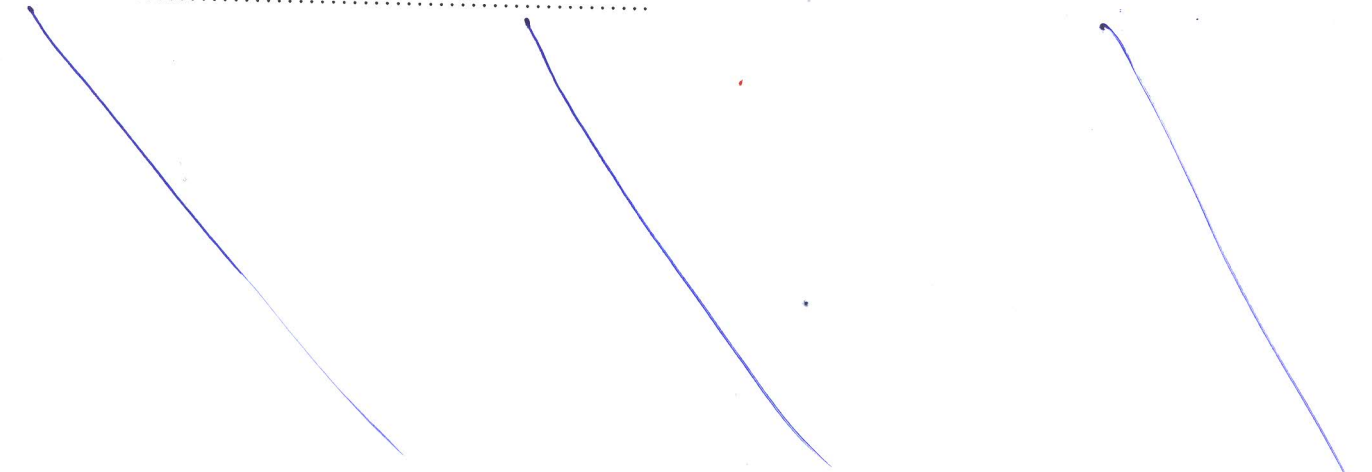

RPM Public School ^{N5}, Shyam colony, Gali No-19
Buddh vihar phase II, Delhi
(Ground Floor only)

A. K. Jaiswal
11/11/13

Signature of the Inspecting Officer

Signature of the Inspecting Officer

Name

(A.K. JAISWAL)

Name

ADD (JWP)

Designation

Designation

D.O. (w), ds