


NO. F6/DFS/MS/Ind./ 2014/SZ/ 20

DATED: 07/01/14

**FIRE SAFETY CERTIFICATE**

Certified that the M/s Sonu Exim Pvt. Ltd., Plot No. B-6/2, Okhla Industrial Area, Phase-2, New Delhi-110020 comprised of ground plus one upper floor owned/occupied by M/s Sonu Exim Pvt. Ltd have complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and verified by the officers concerned of this department on 13.11.2013 in the presence of Sh. Ved Parkash (Director), of the Industrial and that the building is fit for occupancy class G "Industrial building" with effect from...07./01./14 for a period of **three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rule, 2010, subject to condition as mentioned below.

Issued on .....07./01./14.... at New Delhi by



(Dr. G.C. Misra)  
Chief Fire Officer  
Delhi Fire Service  
Ph. 011-23414333



**Copy to,**

1. The Executive Engineer (Bldg) HQ, Building Department, SDMC, 8<sup>th</sup> floor, Civic Centre, Minto Road, New Delhi 110002.
2. Sh. Ved Parkash (Director), M/s Sonu Exim Pvt. Ltd., Plot No. B-6/2, Okhla Industrial Area, Phase-2, New Delhi-110020.

**Conditions for the validity of fire safety certificate**

- a. All the fire safety and means of escape facilities shall be maintained in good working conditions at all time. Any lapse rendering fire safety or means of evacuation facilities rendering non-functional shall be the responsibility of the management.
- b. Building Sanctioning authority may verify any deviation with regard to the construction/occupancy in the building. In case of any deviation, the fire safety certificate stands null and void.
- c. The staffs shall be trained for operating fire fighting system and mock evacuation drills be conducted at regular intervals and record be maintained.
- d. The basement shall be used strictly as per the provisions of Building Bye laws.
- e. The owner/occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules-2010. The form is available on [www.dfs.delhiacvt.nic.in](http://www.dfs.delhiacvt.nic.in)

### INSPECTION REPORT

1	Name & address of the building	M/s Sonu Exim Pvt. Ltd. , Plot No. B-6/2, Okhla Industrial Area, Phase-2, New Delhi-110020.		
2	Type of Occupancy	Industrial building "G"		
3	Type of case	New		
4	Details of previous NOC	No		
5	Fire safety directives letter No	F6/DFS/MS/BP/2013/2704 dated 20.12.13		
6	Date of inspection	31.12.2013		
7	Name of the inspecting Officers	DO Dharampal Bhardwaj & ADO D.B. Mukherjee		
8	Name and designation of officers from the building side	Sh. Ved Parkash (Director)		
9	Year of construction			
10	Applicant's letter No.	Nil	17.12.2013	ground plus one upper floor

S. NO.	Minimum Standards on fire prevention and fire safety U/R 33	NBC Requirement	Provided at site	Remarks MR / NMR
1	<b>Access to building</b>			
	1) Road width	Required	12 Mtr Provided	MR
	2) Gate width	Required	5 Mtr Provided	MR
	3) Width of internal road	N/A	N/A	N/A
2	<b>Number, width Type &amp; arrangement of exits</b>			
	<b>a. Number of staircases</b>			
	1. Upper floors	Two	Provided	MR
	2. basements	N/A	N/A	N/A
	<b>b. Width of staircase</b>			
	1. Upper floors	1.25 Mtr	1.25 & 1.20 Mtr Provided	MR
	2. basements	N/A	N/A	N/A
	<b>c. Protection of exits</b>			
	1. Fire check door	Required	Provided	MR
	2. Pressurization	N/A	N/A	N/A
	<b>d. No. of continuous staircase to terrace</b>	Required	One Provided	MR
	e. Width of corridor	N/A	N/A	N/A
	f. Door size	Required	1 Mtr	N/A
3	<b>Compartmentation.</b>			
	1. Fire check door	N/A	N/A	N/A
	2. Sealing of electrical shafts	Required	Provided	MR
	3. Fire Rating of shaft door	N/A	N/A	N/A
	4. water curtain	N/A	N/A	N/A
	5. Fire dampers	N/A	N/A	N/A
4	<b>Smoke Management system.</b>			
	basement	30 a/c per hour	12 N/A	N/A
	upper floors	a/c per hour	Natural Ventilation	MR
5	<b>Fire Extinguishers</b>			
	total numbers		12 Nos. Provided	MR
	Types		ABC, CO2 & Water Co2	MR
	ISI marking	ISI	Provided	MR
6	<b>First-Aid Hose Reels.</b>			
	total numbers on each floor	One	Provided	MR
	Length of Hose reel hose	30 Mtr	Provided	MR
	Nozzle Diameter	5mm	Provided	MR

7	<b>Automatic fire detection and alarming system</b>			
	Type of detectors	N/A	Smoke Provided	MR
	location of Main Panel	N/A	Ground Floor Provided	MR
	location of Repeater panel	N/A	N/A	N/A
	Alternate source of power	N/A	Battery Provided	MR
	hooter's location	N/A	Staircase Provided	MR
8	<b>MOEFA</b>	Required	Provided	MR
9	<b>Public Address System.</b>	N/A	N/A	N/A
10	<b>Automatic Sprinkler System.</b>			
	basement	N/A	N/A	N/A
	upper floors	Required	Provided	MR
	sprinkler above false ceiling	N/A	N/A	N/A
11	<b>Internal Hydrants</b>			
	Size of riser/down-corner	150 MM	Provided	MR
	Number of Hydrants per floor	Required	One Provided	MR
	hose Box	Required	One Provided	MR
12	<b>Yard Hydrants.</b>			
	total number of hydrants	N/A	N/A	N/A
	house box	N/A	N/A	N/A
13	<b>Pumping arrangements</b>			
	<b>1. Ground level</b>			
	a. Discharge of main Pump	N/A	N/A	N/A
	b. Head of main pump	N/A	N/A	N/A
	c. Number of main pumps	N/A	N/A	N/A
	d. jockey pump out put	N/A	N/A	N/A
	e. jockey pump head	N/A	N/A	N/A
	f. Standby Pump output	N/A	N/A	N/A
	g. Stanby Pump head	N/A	N/A	N/A
	h. Auto Starting/Manual stopping	N/A	N/A	N/A
	pump house access	N/A	N/A	N/A
	<b>2. Terrace level</b>			
	a. Discharge of pump	900 LPM	900 LPM Provided	MR
	b. head of the pump	35 Mtr	35 Mtr	MR
	c. Power supply	Required	Provided	MR
	d. Auto starting of pump	Required	Provided	MR
14	<b>Captive water storage for fire fighting</b>			
	1. Underground tank capacity	N/A	N/A	N/A
	a. Draw-off connection	N/A	N/A	N/A
	b. fire service inlet	N/A	Provided	MR
	c. Access to tank	N/A	N/A	N/A
	d. Over head tank Capacity	10,000 Ltr	Provided	MR
15	<b>Exit Signage.</b>	Required	Provided	MR
16	<b>Provision of lifts.</b>			
	Not Provided			
	a. Pressurization of lift shaft	N/A	N/A	N/A
	b. Pressurization of lift lobby	N/A	N/A	N/A
	c. Communication in lift car	N/A	N/A	N/A
	d. Fireman's grounding switch	N/A	N/A	N/A
	e. Lift signage	N/A	N/A	N/A
17	<b>Standby power supply</b>	Required	Provided	MR

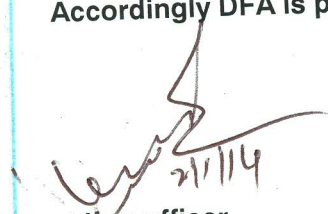
N/7

18*	Refuge Area.	Not Required		
	total area			
	location			
19	Fire control room			
	a. Detector system Panel	N/A	N/A	N/A
	b. Flow switch Panel	N/A	N/A	N/A
	c. PA system Panel	N/A	N/A	N/A
	d. Batter backup	N/A	N/A	N/A
	e. Building floor plans	N/A	N/A	N/A
20	Special Fire Protection systems for protection of special risks, if any: Co2 Fire Extinguishers Provi			

The fire protection systems provided in the building were checked and found functional at the time of inspection.

Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rule it is recommended to grant of Fire Safety Certificate under rules 35 of the Delhi Fire Service Rules 2010/


Accordingly DFA is put up for your approval and signature please.

  
21/1/14

Signature of the inspecting officer

Name Dharampall Bhardwaj

Designation : Divisional Officer

  
21/1/2014

Signature of the inspecting officer

Name D.B. Mukherjee

Designation : ADO (BCP)