

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS, DELHI FIRE SERVICE, NEW DELHI-110001**  
Fax : 011-23412593 E-mail : [cfohq.dlfire@nic.in](mailto:cfohq.dlfire@nic.in) Ph. 011-23414333.


No.F6/DFS/MS/2014/52/232

Dated : 14/2/14

**FIRE SAFETY CERTIFICATE**

Certified that the **Jindal Stainless Ltd.** located at **Plot No.12, Bhikaji Cama Place, New Delhi.** comprised of **Basement, Lower Ground Floor, Upper Ground Floor + 2 Upper Floors** was granted NOC by this department vide letter No./F6/DFS/MS/96/BP/1176 dated 25/09/96. The premises was re-inspected by the officer concerned of this department on 10/02/14 in the presence of **Mr. Aggarwal** and found that the said premises have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the premises fit for occupancy class **Business Building Group** – with effect from 14/2/14 for period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010 subject to conditions printed below.

Issued 14/2/14 at New Delhi by.

  
(Dr. G.C. Misra)  
Chief Fire Officer  
Delhi Fire Service

Copy to:- (1) The Dy. Director (Bldg.),  
Building Section, DDA,  
Vikas Sadan, INA, New Delhi.

(2) Jindal Stainless Ltd.,  
Plot No.12, Bhikaji Cama Place, New Delhi.

Following fire safety directives must be adhered to:-

1. All the fire safety arrangements provided therein shall be maintained in good working conditions at all times.
2. Any loss of life or property due to non functional fire safety measures shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation w.r.t. construction etc. shall be verified by the concerned building sanctioning authority.
5. The basement shall be used as per the provisions of BBL.
6. This fire safety certificate may not be treated in any case for regularization of unauthorized construction, if any.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)

-MIS-

**INSPECTION REPORT**

1. Name & address of the building:- Jindal Stainless Ltd. ,Plot No.12,Bhikaji Cama Place,New Delhi.
2. Type of occupancy:- Business Building Group – E.
3. Type of case:- Renewal
4. Details of previous NOC:-No./F6/DFS/MS/96/BP/1176 dated 25/09/96
5. Fire safety directives No.- F6/DFS/MS/BP/94/770 dated 17/05/94.
6. Date of inspection:- 10/02/14.
7. Name of the inspecting officer:- D.O. Dharampal Bharadwaj & A.D.O. S.S. Kaushik
8. Name & designation of officer  
From the building side:- Mr. Aggarwal.
9. Year of construction:- 1996.
10. Applicant's letter No:- Nil. dated 19/12/13 Basement, Lower Ground Floor,Upper Ground Floor + 2 Upper Floors

S.No.	Minimum Standards on fire Prevention and fire safety U/R 33	NBC /BBL Requirement	Provided at site	Remarks Old case MR/NMR
<b>1.</b>	<b>Access to Building</b>			
	1) Road width	12 mtr.	Provided	MR
	2) Gate width	Required	Provided	MR
	3)Width of internal road	N/A	N/A	N/A
<b>2.</b>	<b>Number, Width Type &amp; Arrangement of Exits</b>			
	<b>A. Number of staircases</b>			
	1. Upper floors	Required	2 Nos.	MR
	2. Basements	Required	2 Nos.	MR
	<b>B. Width of staircase</b>			
	1. Upper floors	Required 1.2 mtr	1.30 mtr. & 1.55 mtr. each	MR
	2. Basements	Required 1.2 mtr	1.30 mtr. & 1.55 mtr. each	MR
	<b>C. Protection of exits</b>			
	1. Fire check door	Required	Provided	MR
	2. Pressurization	N/A	N/A	N/A
	D. No. of continuous staircase to terrace	Required	one	MR
	E. Width of corridor	1.20 mtr.	Provided	MR
	F. Door size	1 mtr.	Provided	MR
<b>3.</b>	<b>Compartmentation</b>			
	1) Fire check door	Required	Provided	MR
	2) Sealing of electrical shafts	N/A	N/A	N/A
	3) Fire rating of shaft door	N/A	N/A	N/A
	4) Water curtain	N/A	N/A	N/A
	5) Fire Dampers	N/A	N/A	N/A
<b>4.</b>	<b>Smoke Management System</b>			
	1) Basements	30 a/c per hour	Exhaust fan	MR
	2) Upper floors	12 a/c per hour	Exhaust fan	MR
<b>5.</b>	<b>Fire Extinguishers</b>			

*Handwritten signature*

21/6

	1) Total numbers	ISI Marked	50 Nos.	MR
	2) Types		ABC & W.Co2	MR
	3) ISI marking		Yes	MR
<b>6.</b>	<b>First-Aid Hose Reel</b>			
	1) Total number of each floor	Yes	2 Nos. at each floor	MR
	2) Length of hose reel hose	30 m	Yes	MR
	3) Nozzle diameter	5 mm	Yes	MR
<b>7.</b>	<b>Automatic Fire Detection &amp; Alarming System</b>			
	1) Type of detectors	smoke	smoke	MR
	2) Location of main panel	Required	Provided	MR
	3) Location of repeater panel	N/A	N/A	N/A
	4) Alternate source of power	Required	Provided	MR
	5) Hooter's Location	Every floor	Provided	MR
<b>8.</b>	<b>MOEFA</b>	Yes	Provided	MR
<b>9.</b>	<b>Public Address System</b>	N/A	N/A	N/A
<b>10.</b>	<b>Automatic Sprinkler System</b>			
	1) Basement	Required	Provided	MR
	2) Upper floors	N/A	N/A	N/A
	3) Sprinkler above false ceiling	N/A	N/A	N/A
<b>11.</b>	<b>Internal Hydrants</b>			
	1) Size of riser/down-comer	Required	100 mm.	MR
	2) Number of hydrants per floor	Required	2 Nos.	MR
	3) Hose box	Required	2 Nos.	MR
<b>12.</b>	<b>Yard Hydrants</b>			
	1) Total number of hydrants	N/A	N/A	N/A
	2) Hose box	N/A	N/A	N/A

<b>13.</b>	<b>Pumping Arrangement</b>			
	1) Ground level.			
	a) Discharge of main pump	2280 LPM	2280 LPM	MR
	b) Head of main pump	50 mtr.	50 mtr.	MR
	c) Number of main pump	1 Nos.	1 Nos.	MR
	d) Jockey pump out put	180 LPM	180 LPM	MR
	e) Jockey pump head	50 mtr.	50 mtr.	MR
	f) Stand by pump output	N/A	N/A	N/A
	g) Stand by pump head	N/A	N/A	N/A
	h) Auto starting/Manual stopping	N/A	N/A	N/A
	2) Terrace level			
	a) Discharge of pump	900 LPM	900 LPM	MR
	b) Head of pump	40 mtr.	40 mtr.	MR
	c) Power supply	yes	Provided	MR
	d) Auto starting of pump	yes	Provided	MR
<b>14.</b>	<b>Captive Water Storage for Fire Fighting</b>			
	1) Under ground tank capacity	50,000 Ltrs.	50,000 ltrs.	MR
	a) Draw-off connection	Yes	Provided	MR
	b) Fire service inlet	Yes	Provided	MR
	c) Access to tank	Yes	Provided	MR

*Rawley*

A/2-

	d) Over head tank capacity	Yes	10,000 Ltr.	MR
15.	Exit Signage.	Yes	Provided	MR
	a) Pressurization of lift shaft	Yes	Provided	MR
	b) Pressurization of lift lobby	N/A	N/A	N/A
	c) Communication in lift car	N/A	N/A	N/A
	d) Fireman's switch	Yes	Provided	MR


	e) Lift signage	Yes	Provided	MR
17.	Stand by Power Supply	Yes	Provided	MR
18.	Refuge Area	N/A	N/A	N/A
	Total area location	N/A	N/A	N/A
19.	Fire Control Room	N/A	N/A	N/A
	a) Detector system panel	N/A	N/A	N/A
	b) Flow switch panel	N/A	N/A	N/A
	c) PA system panel	N/A	N/A	N/A
	d) Battery backup	N/A	N/A	N/A
	e) Building floor plan	N/A	N/A	N/A
20.	Special Fire Protection System for Protection of special Risk, if any:			N/A

The fire protection system provided in the building were tested, checked and found functional at the time of inspection.

In view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules the NOC issued vide letter No.F6/DFS/MS/96/BP/1176 dated 25/09/96. renewal under rule 35 of the Delhi Fire Service rules 2010 is recommended.

Accordingly DFA is put up please

Signature of the inspecting officer




11/21/14

Name:- Dharampal Bharadwaj

Designation:- Divisional Officer

Signature of the inspecting officer

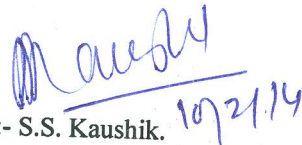

10/21/14

Name:- S.S. Kaushik.

Designation:- Assistant Divisional Officer