

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001**

Fax: 23412593, E-mail: cfosz.dlfire@nic.in, Tel:- 011-23414250


No. F6/DFS/ms/school/2014/SZ/276

Dated: 28/02/14

**FIRE SAFETY CERTIFICATE**

Certified that **Nehru Public School located at 167, Preet Mohalla, Aali village, Sarita Vihar, New Delhi** is running at ground & first floor of a building comprised of ground & two upper floors was inspected by the officer concerned of this department on 29.01.2014 in presence of Mr. Lalan Kumar Misra, principal of the school and found that the School building have complied with the fire prevention and fire safety requirements in accordance with the Directorate of Education circular No. F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01-03-2011 issued by Directorate of Education dated 01.03.2011 and that the school building is fit for occupancy class "Educational" with effect from the date of issue of this certificate for a period of three years, subject to compliance of the under mentioned conditions.

Issued on 28/02/14 at New Delhi by.

  
(SANTOKH SINGH)  
CHIEF FIRE OFFICER  
DELHI FIRE SERVICE

Copy to: -

1. The Principal, Nehru Public School 167, Preet Mohalla, Aali village, Sarita Vihar, New Delhi.
2. The Directorate of Education, Old Secretariat, NewDelhi-110006.

**Conditions for the validity of fire safety certificate**

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non-functional fire safety measures shall be at the risk & responsibility of the management.
3. The trained staff should be available round the clock.
4. Any deviation w.r.t. construction shall be verified by the concerned building sanctioning agency.
5. The certificate may not be treated in any case for regularization of unauthorized construction, if any.
6. The owner/occupier shall submit a declaration every year in form 'K' Provided in the first schedule of Delhi Fire Service Rules 2010, form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)

INSPECTION REPORT

1. Name & address of the building : Nehru Public School, Preet Mohalla, Aali village, Sarita Vihar, New Delhi.
2. Type of Occupancy : Educational
3. Type of Case : New Case
4. Details of previous NOC : N/A
5. Fire Safety directives letter No : Circular No.F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01-03-2011.
6. Date of inspection : 29.01.2014
7. Name of the Inspecting Officers : M.K Chattopadhyay, ADO(Mathura Road)
8. Name and designation of officers  
from the building side : Mr. Lalan Ku. Pandey, Principal
9. Year of Construction : 2013
10. Applicant's letter No. : Nil dated 29.10.2013.

**The school is running on ground & first floor of a building comprised of ground & two upper floors. Second floor was sealed. Photograph & affidavit are enclosed.**

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	NBC Requirement / <i>Edn. Circular</i>	Provided at site	Remarks MR/NMR
1	<b>Access to building</b>			
	• Road width	06 mts	Provided	MR
	• Gate width	03 mts	Provided	MR
	• Width of internal road	N/A	N/A	N/A
2	<b>Number, Width, Type &amp; Arrangement of Exits</b>			
	a. Number of staircases	-----	-----	-----
	• Upper Floors	02	02	MR
	• Basements	N/A	N/A	N/A
	b. Width of staircases	-----	-----	-----
	• Upper Floors	1.50 mts or less & 0.75 mts	1.10, 1.0 mts	MR
	• Basements	N/A	N/A	N/A
	c. Protection of exits	----	----	-----
	• Fire check door	N/A	N/A	N/A
	• Pressurization	N/A	N/A	N/A
	e. No. of continuous staircases to terrace	01	01	MR
	g. Width of Corridor	N/A	N/A	N/A
	h. Door Size	N/A	N/A	N/A

*lp*

N/2

3	<b>Compartmentation.</b>	<b>Not required</b>		
	<ul style="list-style-type: none"> <li>• Fire check door</li> <li>• Sealing of electrical shafts</li> <li>• Fire Rating of shaft door</li> <li>• Water Curtain</li> <li>• Fire Dampers</li> </ul>	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
4	<b>Smoke Management System.</b>			
	<ul style="list-style-type: none"> <li>• Basements</li> <li>• Upper floors</li> </ul>	30 a/c per hour	N/A	N/A
		12 a/c per hour	N/A	N/A
5	<b>Fire Extinguishers</b>			
	<ul style="list-style-type: none"> <li>• Total numbers</li> <li>• Types</li> <li>• IS marking</li> </ul>	08 nos. ABC type ISI marked	Provided Provided Provided	MR MR MR
6	<b>First-Aid Hose Reels.</b>			
	<ul style="list-style-type: none"> <li>• Total numbers on each floor</li> <li>• Length of hose reel hose</li> <li>• Nozzle diameter</li> </ul>	_____	N/A	N/A
		30 m	N/A	N/A
		5 mm	N/A	N/A
7	<b>Automatic fire detection and alarming system.</b>	<b>Not required</b>		
	<ul style="list-style-type: none"> <li>• Type of detectors</li> <li>• Location of Main Panel</li> <li>• Location of Repeater Panel</li> <li>• Alternate source of power</li> <li>• Hooters' Location</li> </ul>	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
8	<b>MOEFA</b>	N/A	N/A	N/A
9	<b>Public Address System.</b>	N/A	N/A	N/A
10	<b>Automatic Sprinkler System</b>			
	<ul style="list-style-type: none"> <li>• Basement</li> <li>• Upper Floor</li> <li>• Sprinkler above false ceiling</li> </ul>	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
11	<b>Internal Hydrants</b>			

	<ul style="list-style-type: none"> <li>• Size of riser/down-comer</li> <li>• Number of hydrants per floor</li> <li>• Hose Box</li> </ul>	N/A	N/A	N/A
12	<b>Yard Hydrants.</b>			
	<ul style="list-style-type: none"> <li>• Total number of hydrants</li> <li>• Hose Box</li> </ul>	N/A	N/A	N/A
13	<b>Pumping Arrangements</b>			
	<ul style="list-style-type: none"> <li>• Ground Level <ul style="list-style-type: none"> <li>➤ Discharge of main Pump</li> <li>➤ Head of Main pump</li> <li>➤ Number of main pumps</li> <li>➤ Jockey Pump out put</li> <li>➤ Jockey pump head</li> <li>➤ Standby Pump out put</li> <li>➤ Standby Pump Head</li> <li>➤ Auto Starting/ Manual stopping</li> <li>➤ Pump House Access</li> </ul> </li> <li>• Terrace level <ul style="list-style-type: none"> <li>➤ Discharge of pump</li> <li>➤ Head of the pump</li> <li>➤ Power Supply</li> <li>➤ Auto Starting of pump</li> </ul> </li> </ul>	-----	-----	-----
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
14	<b>Captive Water Storage for fire fighting</b>			
	<ul style="list-style-type: none"> <li>• Underground tank capacity</li> <li>➤ Draw-off connection</li> <li>➤ Fire service inlet</li> <li>➤ Access to tank</li> <li>• Overhead Tank capacity</li> </ul>	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
15	<b>Exit Signage.</b>	Required	Provided	MR
16	<b>Provision of Lifts. Not Applicable</b>			
	<ul style="list-style-type: none"> <li>• Pressurization of Lift Shaft</li> </ul>	N/A	N/A	N/A


JP


	<ul style="list-style-type: none"> <li>• Pressurization of Lift lobby</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>• Communication In lift Car</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>• Fireman's Grounding Switch</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>• Lift Signage</li> </ul>	N/A	N/A	N/A
17	<b>Standby power supply</b>	N/A	N/A	N/A
18	<b>Refuge Area.</b>			
	➤ Total Area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19	<b>Fire Control Room</b>			
	<ul style="list-style-type: none"> <li>• Detector System Panel</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>• Flow Switch Panel</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>• PA System Panel</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>• Batter backup</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>• Building Floor Plans</li> </ul>	N/A	N/A	N/A
20	Special Fire Protection Systems for Protection of special Risks, if any:	Required	01 ABC type fire extinguisher is provided near elect. Panel.	MR

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required as per Directorate of Education Circular No.F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01-03-2011, it is recommended to grant fire safety certificate in accordance with the rules.

Accordingly DFA is put up for signature please.

  
 Signature of the Inspecting Officer  
 Name (M.K Chattopadhyay)  
 Designation: - A.D.O (Mathura Road)

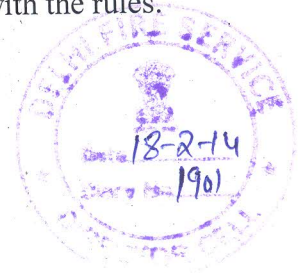

DO (SZ)  
 A.D.O. MR  
 spoken necessary