

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001

No. F6/DFS/MS/SCHOOL/2014/w2/659

Dated: 30/05/14

FIRE SAFETY CERTIFICATE

Certified that the **Rajender Lakra Model (Sr. Sec.) School at Mundka, Delhi-41** is running at **Ground Floor** only in a building comprised of **Ground + 1 upper floor** only owned / occupied by **Rajender Lakra Model (Sr. Sec.) School** have complied with the fire prevention and fire safety requirements in accordance with Director of Education **Circular No. F6/Estate/CC/Fire/Safety/2011/3298-3398 dated 01/03/2011** and verified by the officer concerned of Fire Service on **26/05/2014** in presence of **Sh. Prem Prakash Bhatt** and that the building / premises is fit for occupancy class **Educational** with effect from **30/05/14**.....for a period of 3 (three) years subject to conditions printed below.

Conditions for the validity of Fire Safety Certificate:

1. All the fire safety arrangement provided their in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. The basement shall be used strictly as per the provision of building bye laws.
6. This certificate cannot be treated in any case for regularizations of unauthorized construction.
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on WWW.dfs.Delhigovt.nic.in

Issued on 30/05/14 at New Delhi by.


((SANTOKH SINGH)
CHIEF FIRE OFFICER.
Phone:-23414250

o/c/CSK

Copy to :-

1. The Principal, Rajender Lakra Model (Sr. Sec.) School, Mundka, Delhi-41.
2. The Director of Education, GNCT of Delhi, Old Secretariat, Delhi-110054.

Plot Area = 3150 yrd² N/3
 Covered Area (GF) = 1500 yrd²

G, F only

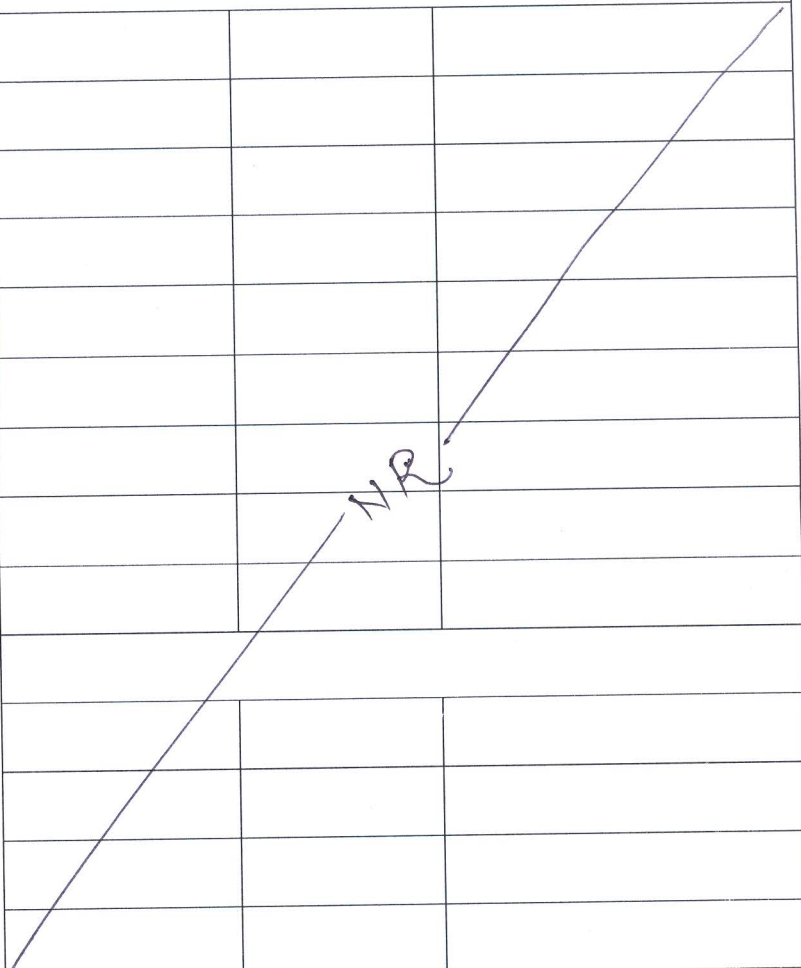
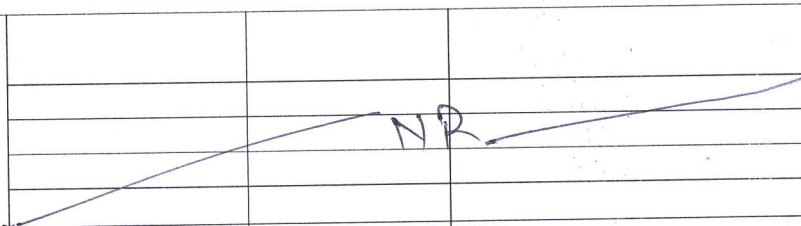

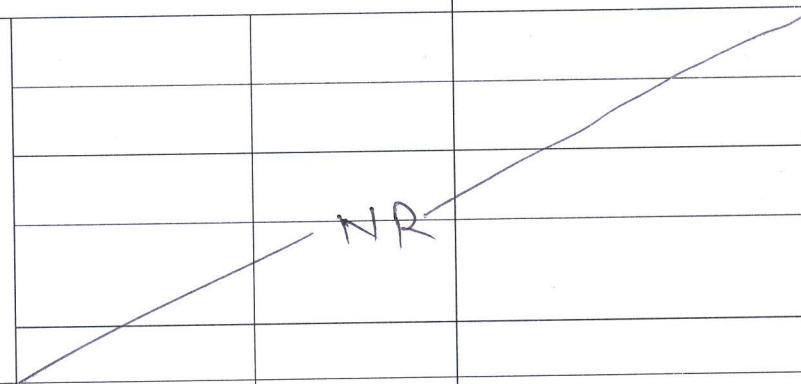

INSPECTION REPORT

1. Name & address of the building: Rajender Lakshya Model School
(Sr. Secondary), Mundka, Delhi-41
2. Type of Occupancy : Educational
3. Type of Case : New
4. Details of previous NOC : Letter No Nil
5. Fire Safety directives Letter No. : DOE circular 262-362
6. Date of inspection : 26/05/2014
7. Name of the Inspecting Officer : Ashok Kumar Jaiswal
8. Name and designation of Officer
 from the building side : Prem Prakash Bhatt
9. Year of Construction : 1982
10. Applicant's letter No. : Nil dt 30/4/2014

S No	Minimum standards on fire prevention and fire safety U/R 33	BBL/DOE Cir. 1.3.11 Requirements	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	Accessible	Provided	MR
	• Gate width	Accessible	Provided	MR
	• Width of internal road	NA	NA	NA
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	NA	NA	NA
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper floors	NA	NA	NA
	• Basements	NA	NA	NA
	c. Protection of exits			
	• Fire check door	NA	NA	NA
	• Pressurization	NA	NA	NA
	d. No of continuous staircase to terrace	NA	NA	NA
	e. Width Of Corridor	1.00 Mtr.	Provided	MR
	f. Door Size	1.00 Mtr.	Provided	MR
3.	Compartmentation			
	• Fire check door			NR
	• Sealing of electrical shafts			
	• Fire Rating of shaft door			
	• Water Curtain			
	• Fire Dampers			

N/A

4.	Smoke managements System			
	<ul style="list-style-type: none"> Basements 	30 a/c per hour		
	<ul style="list-style-type: none"> Upper floors 	12 a/c per hour		NA
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> Total numbers 	6	6	
	<ul style="list-style-type: none"> Types 	ABC/CO ₂	Provided	
	<ul style="list-style-type: none"> IS marking 	ISI marked		
6.	First - Aid Hose Reels			
	<ul style="list-style-type: none"> Total numbers on each floor 			
	<ul style="list-style-type: none"> Length of hose reel hose 			NR
	<ul style="list-style-type: none"> Nozzle diameter 			
7.	Automatic fire detection and alarming system			
	<ul style="list-style-type: none"> Type of detector 			
	<ul style="list-style-type: none"> Location of Main Panel 			
	<ul style="list-style-type: none"> Location of Repeater Panel 			NR
	<ul style="list-style-type: none"> Alternate source of power 			
	<ul style="list-style-type: none"> Hooters' Location 			
8.	MOEFA			NR
9.	Public Address System			NR
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basements 			
	<ul style="list-style-type: none"> Upper Floor 			
	<ul style="list-style-type: none"> Sprinkler above false ceiling 			NA
11.	Internal Hydrants			
	<ul style="list-style-type: none"> Size of riser/down- comer 			
	<ul style="list-style-type: none"> Number of hydrants per floor 			NA
	<ul style="list-style-type: none"> Hose Box 			
12.	Yard Hydrants			
	<ul style="list-style-type: none"> Total number of hydrants 			
	<ul style="list-style-type: none"> Hose Box 			NA

13. Pumping Arrangements		
<ul style="list-style-type: none">• Ground Level		
<ul style="list-style-type: none">• Discharge of main pump		
<ul style="list-style-type: none">➤ Head of main pump		
<ul style="list-style-type: none">➤ Number of main pumps		
<ul style="list-style-type: none">➤ Jockey pump out put		
<ul style="list-style-type: none">➤ Jockey pump head		
<ul style="list-style-type: none">➤ Standby Pump out put		
<ul style="list-style-type: none">➤ Standby Pump Head		
<ul style="list-style-type: none">➤ Auto Staring/Manual stopping		
<ul style="list-style-type: none">➤ Pump House Access		
<ul style="list-style-type: none">• Terrace level		
<ul style="list-style-type: none">➤ Discharge of pump		
<ul style="list-style-type: none">➤ Head of the pump		
<ul style="list-style-type: none">➤ Power supply		
<ul style="list-style-type: none">➤ Auto starting of pump		
14. Captive water Storage for fire fighting		
<ul style="list-style-type: none">• Under ground tank capacity		
<ul style="list-style-type: none">➤ Draw of connection		
<ul style="list-style-type: none">➤ Fire service inlet		
<ul style="list-style-type: none">➤ Access to tank		
<ul style="list-style-type: none">• Overhead Tank capacity		
15. Exit Signage		
16. Provision of Lifts		
<ul style="list-style-type: none">➤ Pressurization of Lift Shaft		
<ul style="list-style-type: none">➤ Pressurization of lift lobby		
<ul style="list-style-type: none">➤ Communication in lift Car		
<ul style="list-style-type: none">➤ Fireman's Grounding Switch		
<ul style="list-style-type: none">➤ Lift Signage		
17. Standby power supply		

18.	Refuge Area			
	➤ Total area			
	➤ Location	NA		
19.	Fire control room			
	➤ Detector system panel			
	➤ Flow Switch Panel			
	➤ PA System Panel	NR		
	➤ Batter backup			
	➤ Building Floor Plans			
20.	Special Fire Protection Systems for Protection of special Risks, if any;	NR		

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules 2010/~~issue shortcomings as noted at serial numbers~~

Note : on 1st Floor of this building, a separate institute namely Marathwada Institute of Technology is running. There are 2 No. Staircases provided from G Floor to 1st Floor. Technical Institute also provided sufficient No. of Fire Extinguishers.

Ak Jaiswal
26/5/2014

Signature of the Inspecting Officer

Signature of the Inspecting officer

OFFICER

Name :- Ashok Kumar Jaiswal

Name

Designation :- A.D.O. (Jwalapuri)

Designation

CFO/590
28/5/14
30/5/14