

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001

NO.F.6/DFS/MS/school/2014/w2/1135

Dated: 05/09/2014

FIRE SAFETY CERTIFICATE

Certified that Sarvodaya Kanya Vidyalaya, Q-block, Mangol Puri, Delhi-110083 comprised of Two Block Ground Floor + First Floor owned/occupied by Sarvodaya Kanya Vidyalaya have complied with the fire prevention and fire safety requirements in accordance with the Circular No F.16/Estate/CC/Fire Safety/2011/3298-3398 dated 01/03/2011 issued by Director of Education and verified by the officer concerned of Fire Service on 27/08/2014 in the presence of Mrs. S. Batra (Head of School) and that the building / premises is fit for occupancy of Educational building with effect from 05 / 09 /2014 for a period of three years, subject to compliance of the conditions mentioned below:

Conditions for the validity of Fire Safety Certificate:

- 1 All the fire safety arrangement provided their in shall be maintained in good working conditions at all times.
- 2 Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
- 3 The trained fire fighting staff should be available round the clock.
- 4 Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
- 5 This certificate cannot be treated in any case for regularizations of unauthorized construction
- 6 The S Block in school is declared dangerous by PWD & the same shall not be used for any purposes.
- 7 The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director of Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry
- 8 The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on WWW.dfs.Delhigovt.nic.in

Issued on 05/09/14 at New Delhi


(Dr. G.C. Mishra)
Chief Fire Officer
Ph: 011-23414333

Copy to:

1. The Principal, Sarvodaya Kanya Vidyalaya, Q-block, Mangol Puri, Delhi-110083
2. The Director of Education, Old Secretariate, Delhi

Total Three Blocks - All GF + FF.

N-7

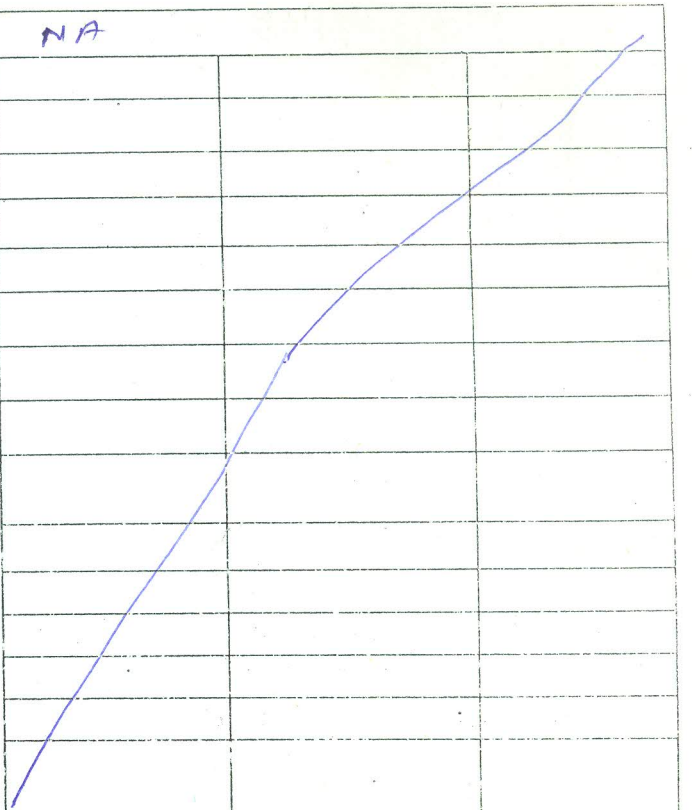
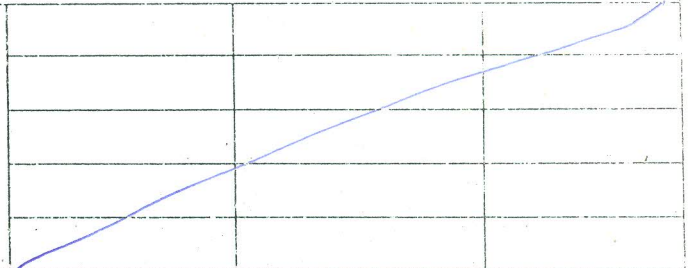
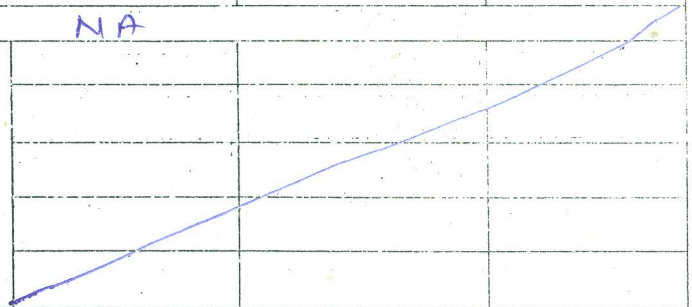
INSPECTION REPORT

1. Name & address of the building: Sarvodaya Kanya Vidyalaya, A-Block
Mangol Puri - Delhi-83
2. Type of Occupancy: Educational
3. Type of Case: New Case / Renewal
4. Details of previous NOC: _____
5. Fire Safety directives letter No: Circular of the Director of Edn dt 01-311
6. Date of inspection: 27-8-14
7. Name of the Inspecting Officers: ADO R1
8. Name and designation of officers
from the building side: Mrs S. Batra Head of School
9. Year of Construction: 1976, 2007
10. Applicant's letter No: 1976 SKV A Blk - 13-8-14

PA. 17130m². CA-6982m². Noh S-2635 Noh CR-51

	Minimum Standards on fire prevention and fire safety U/R 33	cls NBC of Requirement Dn- of Edn	Provided at site	Remarks MR/NMR
1.	Access to building			
	• Road width	Accessible	Accessible	MR
	• Gate width	-	-	-
	• Width of internal road	-	-	-
2.	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases	R	P	MR
	• Upper Floors <u>old Block -</u>	02	02	MR ✓
	<u>New Block</u>	03	03	MR ✓
	• Basements <u>S-Block</u>	03	03	MR ✓
	b. Width of staircases			
	• Upper Floors <u>old Block</u>	1.5mtr x 2	P	MR ✓
	<u>New Block</u>	1.5mtr x 3	P	MR ✓
	• Basements <u>S-Block</u>	1.5mtr x 3	P	MR ✓
	c. Protection of exits			
	• Fire check door	-	-	-
	• Pressurization	-	-	-
	e. No. of continuous staircases to terrace	-	-	-
	g. Width of Corridor	-	-	-
	h. Door Size <u>All CR have two exit of one meter each.</u>	One meter x 2	P	MR ✓
3.	Compartmentation.			
	• Fire check door	-	-	-

	<ul style="list-style-type: none"> Sealing of electrical shafts Fire Rating of shaft door Water Curtain Fire Dampers 				
4	Smoke Management System.	NA			
	<ul style="list-style-type: none"> Basements Upper floors 	30 a/c per hour			
		12 a/c per hour			
5	Fire Extinguishers				
	<ul style="list-style-type: none"> Total numbers Types IS marking 	me @ 30m ² 26 ISI marked	39 ABC + CO2 yes	MR MR MR	✓ ✓ ✓
6	First-Aid Hose Reels.	NA			
	<ul style="list-style-type: none"> Total numbers on each floor Length of hose reel hose Nozzle diameter 	30 m 5 mm			
7	Automatic fire detection and alarming system.	NA			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooters' Location 				
8	MOEFA				
9	Public Address System.				
10	Automatic Sprinkler System.	NA			
	<ul style="list-style-type: none"> Basement Upper Floor Sprinkler above false ceiling 				
11	Internal Hydrants	NA			
	<ul style="list-style-type: none"> Size of riser/down-comer Number of hydrants per floor Hose Box 				
12	Yard Hydrants.	NA			
	<ul style="list-style-type: none"> Total number of hydrants Hose Box 				

13	Pumping Arrangements. <ul style="list-style-type: none"> • Ground Level <ul style="list-style-type: none"> ➤ Discharge of main Pump ➤ Head of Main pump ➤ Number of main pumps ➤ Jockey Pump out put ➤ Jockey pump head ➤ Standby Pump out put ➤ Standby Pump Head ➤ Auto Starting/ Manual stopping ➤ Pump House Access • Terrace level <ul style="list-style-type: none"> ➤ Discharge of pump ➤ Head of the pump ➤ Power Supply ➤ Auto Starting of pum 	NA 		
14	Captive Water Storage for fire fighting.	NA		
	<ul style="list-style-type: none"> • Underground tank capacity <ul style="list-style-type: none"> ➤ Draw-off connection ➤ Fire service inlet ➤ Access to tank • Overhead Tank capacity 			
15	Exit Signage.	— — —		
16	Provision of Lifts. <ul style="list-style-type: none"> • Pressurization of Lift Shaft • Pressurization of Lift lobby • Communication In lift Car • Fireman's Grounding Switch • Lift Signage 	NA 		
17	Standby power supply	— — —		
18	Refuge Area.	NA		
	<ul style="list-style-type: none"> ➤ Total Area ➤ Location 	— — —		
19	Fire Control Room	NA		
	<ul style="list-style-type: none"> • Detector System Panel 	— — —		

N-10

	<ul style="list-style-type: none"> • Flow Switch Panel • PA System Panel • Batter backup • Building Floor Plans 	✓	✓	✓
20	Special Fire Protection Systems for Protection of special Risks, if any:	✓	✓	✓

* S-Block in the school is declared dangerous is not in use for students:

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules 2010/ issue shortcomings as noted at serial numbers.....

Signature of the Inspecting Officer NPS 25/8/14

Name N.P. Sharma

Designation APO R,

Signature of the Inspecting Officer

Name

Designation