

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001

NO. FG/DFS/ms/school/2014/w2/1266 Dated: 07/10/2014
FIRE SAFETY CERTIFICATE

Certified that **Dr. Bright Foundation Academy, A-Block, Agar Nagar, Prem Nagar-III, Kirari Suleman Nagar, Delhi-110086** comprised of **Ground + Two upper floors** owned / occupied by **Dr. Bright Foundation Academy** have complied with the fire prevention and fire safety requirements in accordance with the **Circular No F.16/Estate/CC/Fire Safety/2011/3298-3398 dated 01/03/2011** issued by Director of Education and verified by the officer concerned of Fire Service on **22/09/2014** in the presence of **Dr. Mohd. Motiullah (Manager)** and that the building / premises is fit for occupancy of **Educational** building with effect from **07/10/2014** for a period of **three years**, in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Conditions for the validity of Fire Safety Certificate:

- 1 All the fire safety arrangement provided their in shall be maintained in good working conditions at all times.
- 2 Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
- 3 The trained fire fighting staff should be available round the clock.
- 4 Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
- 5 This certificate cannot be treated in any case for regularizations of unauthorized construction
- 6 The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director of Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry".
- 7 The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on **WWW.dfs.Delhigovt.nic.in**

Issued on 07/10/14 at New Delhi


(SANTOKH SINGH)
Chief Fire Officer
Ph: 011-23414250
pc

Copy to:

1. The Principal, Dr. Bright Foundation Academy, A-Block, Agar Nagar, Prem Nagar-III, Kirari Suleman Nagar, Delhi-110086
2. The Director of Education, Old Sectt. Delhi for information

INSPECTION REPORT

1. Name & address of the building : Dr's Bright Foundation Academy, A-Block,
2. Type of Occupancy : Agar Nagar, Pram Nagar - III
3. Type of Case : New Case/ Renewal Kurahi Sulaman Nagar
4. Details of previous NOC : Letter No. Dated: Selhi-86
5. Fire Safety directives letter No : Dir. of Edu. Cir. 01.3.2011
6. Date of inspection : 22. 9. 14
7. Name of the Inspecting Officers : ADD (B W)
8. Name and designation of officers from the building side : Dr. Mohd. Motiullah, manager
9. Year of Construction : 2008
10. Applicant's letter No. : Dr No Nil dt. 8. 9. 14

PA-1043 Sq. yards CA-756 Sq. yards NOS-102 NOCR-8, 3 room for other purpose.

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	Dir. Of Edu/ NBC	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	<u>Accessable</u>	<u>Accessable</u>	<u>MR</u>
	• Gate width	<u>—</u>	<u>—</u>	<u>—</u>
	• Width of internal road	<u>—</u>	<u>—</u>	<u>—</u>
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases	<u>—</u>	<u>—</u>	<u>—</u>
	• Upper Floors	<u>01</u>	<u>02</u>	<u>MR</u>
	• Basements	<u>—</u>	<u>—</u>	<u>—</u>
	b. Width of staircases	<u>—</u>	<u>—</u>	<u>—</u>
	• Upper Floors	<u>1.50 mtr</u>	<u>1.35 + 1.52 mtr</u>	<u>MR</u>
	• Basements	<u>—</u>	<u>—</u>	<u>—</u>
	c. Protection of exits	<u>—</u>	<u>—</u>	<u>—</u>
	• Fire check door	<u>—</u>	<u>—</u>	<u>—</u>
	• Pressurization	<u>—</u>	<u>—</u>	<u>—</u>
	e. No. of continuous staircases to terrace	<u>R</u>	<u>D</u>	<u>MR</u>
	g. Width of Corridor	<u>—</u>	<u>—</u>	<u>—</u>
	h. Door Size	<u>1 mtr</u>	<u>1 mtr</u>	<u>MR</u>
		<u>—</u>	<u>—</u>	<u>—</u>

3	Compartmentation.				
	<ul style="list-style-type: none"> • Fire check door • Sealing of electrical shafts • Fire Rating of shaft door • Water Curtain • Fire Dampers 				
4	Smoke Management System.				
	<ul style="list-style-type: none"> • Basements • Upper floors 	30 a/c per hour 12 a/c per hour			
5	Fire Extinguishers				
	<ul style="list-style-type: none"> • Total numbers • Types • IS marking 	7 ABC ISI marked	7 ABC YES	MR ✓ MR ✓ MR ✓	
6	First-Aid Hose Reels.				
	<ul style="list-style-type: none"> • Total numbers on each floor • Length of hose reel hose • Nozzle diameter 	one 30 m 5 mm	P ✓ P P	MR ✓ MR ✓ MR ✓	
7	Automatic fire detection and alarming system.				
	<ul style="list-style-type: none"> • Type of detectors • Location of Main Panel • Location of Repeater Panel • Alternate source of power • Hooters' Location 				
8	MOEFA				
9	Public Address System.				
10	Automatic Sprinkler System.				
	<ul style="list-style-type: none"> • Basement • Upper Floor • Sprinkler above false ceiling 				

11	Internal Hydrants	<ul style="list-style-type: none"> • Size of riser/down-comer • Number of hydrants per floor • Hose Box 			
12	Yard Hydrants.	<ul style="list-style-type: none"> • Total number of hydrants • Hose Box 	N/A		
13	Pumping Arrangements.	<ul style="list-style-type: none"> • Ground Level <ul style="list-style-type: none"> ➤ Discharge of main Pump ➤ Head of Main pump ➤ Number of main pumps ➤ Jockey Pump out put ➤ Jockey pump head ➤ Standby Pump out put ➤ Standby Pump Head ➤ Auto Starting/ Manual stopping ➤ Pump House Access • Terrace level <ul style="list-style-type: none"> ➤ Discharge of pump ➤ Head of the pump ➤ Power Supply ➤ Auto Starting of pump 	N/A		
14	Captive Water Storage for fire fighting.	<ul style="list-style-type: none"> • Underground tank capacity ➤ Draw-off connection ➤ Fire service inlet ➤ Access to tank • Overhead Tank capacity 	N/A		
15	Exit Signage.				

450 LPM

P

MR

40M

P

MR

10,000 lts

10,000 lts

MR

14-10

16	Provision of Lifts.			
	• Pressurization of Lift Shaft			
	• Pressurization of Lift lobby			
	• Communication In lift Car			
	• Fireman's Grounding Switch			
	• Lift Signage			
17	Standby power supply			
18	Refuge Area.			
	➤ Total Area			
	➤ Location			
19	Fire Control Room			
	• Detector System Panel			
	• Flow Switch Panel			
	• PA System Panel			
	• Batter backup			
	• Building Floor Plans			
20	Special Fire Protection Systems for Protection of special Risks, if any:			

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules 2010/ issue shortcomings as noted at serial numbers.....NIL.....

Signature of the Inspecting Officer

Name

Designation


20/Jan/15
Deep
22/9/14

Signature of the Inspecting Officer

Name

Designation

Ahluwalia
22/9/14
ADD (BIO)

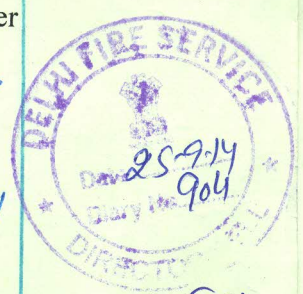

606/DCHO (C02)