

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001

NO. F.6/DFS/MS/2014/school/w2/1332

Dated: 24/10/2014


FIRE SAFETY CERTIFICATE

Certified that M C Primary Girls School, Madan pur Dabas, Delhi-110081 comprised of Ground + One Upper Floor owned/occupied by M C Primary Girls School has already been issued fire safety certificate vide letter no. F-6/DFS/MS/School/2011/3295 dated 01/12/2011. The premises was re-inspected by the officer from this department on dated 22/09/2014 in the presence of Smt. Ved Kumari (Principal) and observed that all the fire prevention & fire safety arrangements as provided in the premises found in good working condition. The premises have therefore deemed complied with the requirements of Circular No F.16/Estate/CC/Fire Safety/2011/3298-3398 dated 01/03/2011 issued by Director of Education and the building / premise is fit for occupancy of Group Class B (Educational) with effect from 24/10/2014 for a period of three years, subject to compliance of the conditions mentioned below:

Conditions for the validity of Fire Safety Certificate:

1. All the fire safety arrangement provided there-in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director of Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry".
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on WWW.dfs.Delhigovt.nic.in

Issued on 24/10/14 at New Delhi by


(SANTOKH SINGH)
Chief Fire Officer
Ph: 011-23414250



Copy to:

1. The Principal, M C Primary Girls School, Madan pur Dabas, Delhi-110081
2. The Addl. Director of Education, NMCD, Civic Centre, New Delhi.

14-11

Gr. + one floor

INSPECTION REPORT

1. Name & address of the building : *M.C. Primary Girls school, Madambika Sabas Delhi-81*
 2. Type of Occupancy : *Educational*
 3. Type of Case : *New case/ Renewal*
 4. Details of previous NOC : *F-6/DPB/MS/School(2011)3295 dt. 1.12.11*
 5. Fire Safety directives letter No : *Dt. of Edu. Cir. 01.3.2011*
 6. Date of inspection : *22.9.14*
 7. Name of the Inspecting Officers : *AAO (BWS)*
 8. Name and designation of officers from the building side : *Smt. Ved Kumari, Principal*
 9. Year of Construction : *2009*
 10. Applicant's letter No. : *Atx No Nil dt. 12.9.14*
- Plot area- *3324 m²* Covered area- *1026 m²* No's of student- *319* No's of class room- *09*
one office.

	Minimum Standards on fire prevention and fire safety U/R 33	Dir. of Edu. Requirement	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	<i>Accessible</i>	<i>Accessible</i>	<i>MR</i> ✓
	• Gate width	<i>"</i>	<i>"</i>	<i>MR</i> ✓
	• Width of internal road	<i>"</i>	<i>"</i>	<i>MR</i> ✓
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases	<i>—</i>	<i>—</i>	<i>—</i>
	• Upper Floors	<i>01</i>	<i>02</i>	<i>MR</i> ✓
	• Basements	<i>—</i>	<i>—</i>	<i>—</i>
	b. Width of staircases	<i>—</i>	<i>—</i>	<i>—</i>
	• Upper Floors	<i>1.50 mtr</i>	<i>2x 1.60 mtr</i>	<i>MR</i> ✓
	• Basements	<i>—</i>	<i>—</i>	<i>—</i>
	c. Protection of exits	<i>—</i>	<i>—</i>	<i>—</i>
	• Fire check door	<i>—</i>	<i>—</i>	<i>—</i>
	• Pressurization	<i>—</i>	<i>—</i>	<i>—</i>
	e. No. of continuous staircases to terrace	<i>—</i>	<i>—</i>	<i>—</i>
	g. Width of Corridor	<i>—</i>	<i>—</i>	<i>—</i>
	h. Door Size	<i>1 mtr</i>	<i>2x 1 mtr</i>	<i>MR</i> ✓
3	Compartmentation.			
	• Fire check door			
	• Sealing of electrical shafts			
	• Fire Rating of shaft door			
	• Water Curtain			
	• Fire Dampers			
4	Smoke Management System.			
	• Basements	30 a/c per hour		
	• Upper floors	12 a/c per hour		

N/A

N/A

9. Year of Construction

10. Applicant's letter No.

Atxlo Nic Dt 12.9.14

Plot area-

3324 m²

Covered area-

1026 m²

No's of student-

318

No's of class room-

09


enc. office.

	Minimum Standards on fire prevention and fire safety U/R 33	Dir. of Edu. Requirement	Provided at site	Remarks MR/NMR
1	Access to building			
	• Road width	Accessable	Accessable	MR ✓
	• Gate width	"	"	MR ✓
	• Width of internal road	"	"	MR ✓
2	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases	—	—	—
	• Upper Floors	01	02	MR ✓
	• Basements	—	—	—
	b. Width of staircases	—	—	—
	• Upper Floors	1.50mts	2x1.60mts	MR ✓
	• Basements	—	—	—
	c. Protection of exits	—	—	—
	• Fire check door	—	—	—
	• Pressurization	—	—	—
	e. No. of continuous staircases to terrace	—	—	—
	g. Width of Corridor	—	—	—
	h. Door Size	1m ²	2x1.0m ²	MR ✓
3	Compartmentation.			
	• Fire check door			
	• Sealing of electrical shafts			
	• Fire Rating of shaft door			
	• Water Curtain			
	• Fire Dampers			
4	Smoke Management System.			
	• Basements	30 a/c per hour		
	• Upper floors	12 a/c per hour		
5	Fire Extinguishers			
	• Total numbers	5	5	MR ✓
	• Types	ABC	ABC	MR ✓
	• IS marking	ISI marked	yes	MR ✓
6	First-Aid Hose Reels.			
	• Total numbers on each floor	One at each floor	—	—

N-12

	<ul style="list-style-type: none"> Length of hose reel hose Nozzle diameter 	30 m			
		5 mm			
7	Automatic fire detection and alarming system.				
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooters' Location 				
8	MOEFA				
9	Public Address System.				
10	Automatic Sprinkler System.				
	<ul style="list-style-type: none"> Basement Upper Floor Sprinkler above false ceiling 				
11	Internal Hydrants				
	<ul style="list-style-type: none"> Size of riser/down-comer Number of hydrants per floor Hose Box 				
12	Yard Hydrants.				
	<ul style="list-style-type: none"> Total number of hydrants Hose Box 				
13	Pumping Arrangements.				
	<ul style="list-style-type: none"> Ground Level <ul style="list-style-type: none"> Discharge of main Pump Head of Main pump Number of main pumps Jockey Pump out put Jockey pump head Standby Pump out put Standby Pump Head Auto Starting/ Manual stopping Pump House Access Terrace level <ul style="list-style-type: none"> Discharge of pump Head of the pump Power Supply Auto Starting of pump 				
14	Captive Water Storage for fire fighting.				

	<ul style="list-style-type: none"> • Basement • Upper Floor • Sprinkler above false ceiling 				
11	Internal Hydrants				
	<ul style="list-style-type: none"> • Size of riser/down-comer • Number of hydrants per floor • Hose Box 				
12	Yard Hydrants.				
	<ul style="list-style-type: none"> • Total number of hydrants • Hose Box 				
13	Pumping Arrangements.				
	<ul style="list-style-type: none"> • Ground Level <ul style="list-style-type: none"> ➤ Discharge of main Pump ➤ Head of Main pump ➤ Number of main pumps ➤ Jockey Pump out put ➤ Jockey pump head ➤ Standby Pump out put ➤ Standby Pump Head ➤ Auto Starting/ Manual stopping ➤ Pump House Access • Terrace level <ul style="list-style-type: none"> ➤ Discharge of pump ➤ Head of the pump ➤ Power Supply ➤ Auto Starting of pump 				
14	Captive Water Storage for fire fighting.				
	<ul style="list-style-type: none"> • Underground tank capacity <ul style="list-style-type: none"> ➤ Draw-off connection ➤ Fire service inlet ➤ Access to tank • Overhead Tank capacity 				
15	Exit Signage.				
16	Provision of Lifts.				
	<ul style="list-style-type: none"> • Pressurization of Lift Shaft 				

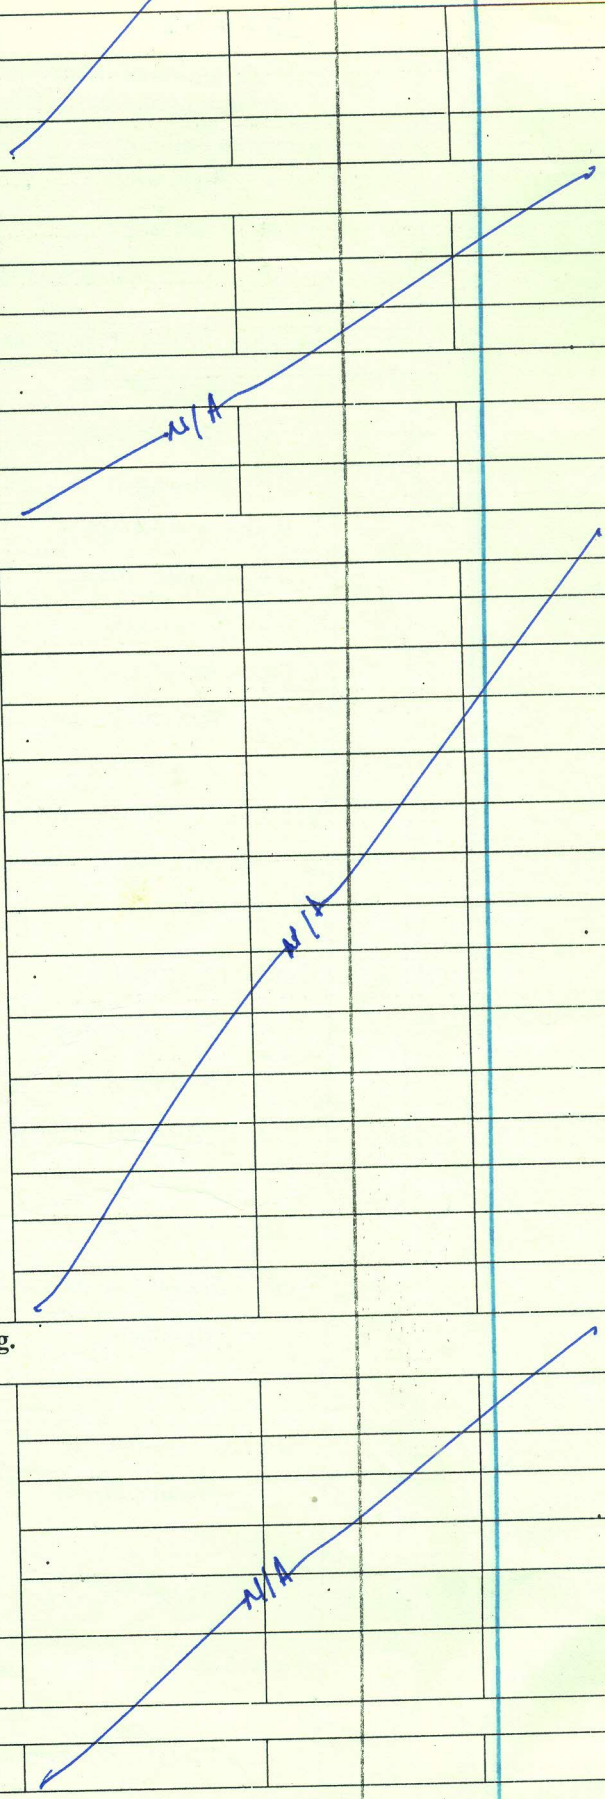

M-13

	<ul style="list-style-type: none"> • Pressurization of Lift lobby • Communication In lift Car • Fireman's Grounding Switch • Lift Signage 			
17	Standby power supply			
18	Refuge Area.			
	➤ Total Area			
	➤ Location			
19	Fire Control Room			
	<ul style="list-style-type: none"> • Detector System Panel • Flow Switch Panel • PA System Panel • Batter backup • Building Floor Plans 			
20	Special Fire Protection Systems for Protection of special Risks, if any:			

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

In view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules the NOC issued vide letter no. F-6/DFR/MS/School/2011/3295 dated 01.12.2011 Renewal under rule 35 of the Delhi Fire Service rules 2010 is recommended.

Signature of the Inspecting Officer

Name

Designation

[Handwritten Signature]
[Handwritten Signature]
 25/9/14

Signature of the Inspecting Officer

Name

Designation

[Handwritten Signature]
 24/9/15
 HAO(BW)