

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**

**HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110 001**

NO.

FG (DFSI NS) EN/2014/SZ/1272

Dated:

10/10/14

**FIRE SAFETY CERTIFICATE**

Certified that M/S "SCHENGEN" Restaurant (A Unit of Nehra Exports Imports Pvt. Ltd) located at, 22/48, Commercial Complex, Malcha Marg, Chankyapuri, New Delhi, comprises of basement (Storage only), ground plus two upper floors owned/occupied by Nehra Exports Imports Pvt. Ltd, have complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and verified by the officer concerned of this department on dated 23.09.14 in the presence of Sh. Bhanu Partap Singh Nehra and that the building is fit for occupancy class "Eating House" with effect from .....10.10.14 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of Delhi Fire Service Rules, 2010.

Issued on .....10/10/14..... at New Delhi by

  
( Dr. G.C. Misra)  
Chief Fire Officer  
Delhi Fire Service



Copy to:-

1. Director Monitoring, (Licensing Officer),  
New Delhi Municipal Council, Palika Kendra, New Delhi-110001.
2. Sh. Bhanu Partap Singh Nehra, M/S "SCHENGEN" Restaurant)  
(A Unit of Nehra Exports Imports Pvt. Ltd), 22/48, Commercial Complex,  
Malcha Marg, Chankyapuri, New Delhi .

**Conditions for the validity of fire safety certificate are overleaf:-**

## CONDITIONS

1. All the means of escape shall be kept free of all type of obstruction all the time.
2. The employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
3. All fire fighting equipments shall be maintained in perfect working condition all time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
4. Any deviation, with regards to construction, ventilation, occupancy, electric installation etc. may be got verified from the concerned authorities.
5. This Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction unauthorized use of land if any.
6. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on [www.dfs.delhi.govt.nic.in](http://www.dfs.delhi.govt.nic.in).
7. The owner/occupier shall apply for renewal of this Fire Safety Certificate, six month prior to its expiry.

### INSPECTION REPORT

1. Name & address of the building : M/S "SCHENGEN" Restaurant (A Unit of Nehra Exports Imports Pvt. Ltd)  
22/48, Commercial Complex, Malcha Marg, Chankyapuri, New Delhi.
2. Building is comprised of : B+G+2.
3. Type of Occupancy : Eating House.
4. Type of Case : New Case
5. Details of Previous NOC : Nil.
6. Fire Safety direction letter No : Nil.
7. Date of Inspection : 23.09.2014
8. Name of the Inspecting Officers: : Vedpal (ADO)
9. Name and designation of Officer  
from the building side : Sh. Bhanu Partap Singh Nehra (Owner).
10. Year of Construction : 1982.
11. Applicant's letter No : No.D-288/Dir(Mon)/Licensing, dated 12.09.14.

S.No	Minimum Standards on fire prevention and fire safety U/R33	Requirements	Provided at Site	Remarks
1	Access to building			
	Road width	6m	9 m	MR
	Gate width	2m	2m & 1.25m	MR
	Width of internal road	N.A.	N.A.	N.A.
2	Number, Width, Type and Arrangement of Exits.			
	a. Number of Staircases			
	Upper Floor	01no.	02nos+1no from 1 <sup>st</sup> Floor to 2 <sup>nd</sup> floor.	MR
	Basement	01no.	02nos	MR
	B. Width of Staircases			
	Upper Floor	1.5m	1.5, 1m & 1m from 1 <sup>st</sup> To 2 <sup>nd</sup> floor.	MR
	Basement	1.5m	1.5m & 90cm	MR
	c. Protection of exits	N.A.	N.A.	N.A.
	Fire check door	N.A.	N.A.	N.A.
	Pressurization	N.A.	N.A.	N.A.
	e. No. of continuous staircases to terrace	01no.	01no.	MR
g. Width of Corridor	N.A.	N.A.	N.A.	
h. Door Size	2m	2m & 1,25m	MR	
3	Compartmentation			
	Fire check door	N.A.	N.A.	N.A.
	Sealing of electrical shafts	N.A.	N.A.	N.A.
	Fire rating of shaft door	N.A.	N.A.	N.A.
	Water curtain	N.A.	N.A.	N.A.
	Fire Dampers	N.A.	N.A.	N.A.
4	Smoke Management System.			
	Basement	30a/c per hour	Exhaust fan provided	MR
	Upper floor	12 a/c per hour	Exhaust fan provided	MR
5	Fire Extinguisher			
	Total numbers	08 nos.	08 nos.	MR
	types	CO <sub>2</sub> & ABC	CO <sub>2</sub> & ABC	MR
	IS marking	ISI marked	ISI marked	MR


	Total numbers on each floor	01no.	Provided at ground & 1 <sup>st</sup> floor only (cover All areas)	MR
	Length of hose reel hose	30m.	30m.	MR
	Nozzle diameter	5mm	5mm	MR
7	Automatic fire detection and alarming system.			
	Type of detectors	Heat & Smoke	Heat & Smoke	MR
	Location of main panel	Reception	Reception	MR
	Location of repeater panel	N.A.	N.A.	N.A.
	Alternate source of power	Required	Provided	MR
	Hooters	Required	Provided	MR
8	MOEFA	Required	Provided	MR
9	Public address System.	N.A.	N.A.	N.A.
10	Automatic Sprinkler System.			
	Basement	Required	Provided	MR
	upper floor	Required	Provided	MR
	sprinkler above false ceiling	N.A.	N.A.	N.A.
11	Internal Hydrants			
	size of riser/down-comer	100mm	100mm	MR
	Number of hydrants per floor	01no.	Provided at ground & 1 <sup>st</sup> floor only (cover All areas)	MR
	Hose Box	01no.	Provided at ground & 1 <sup>st</sup> floor only	MR
12	Yard Hydrants.			
	Total number of hydrants	N.A.	N.A.	N.A.
	Hose Box	N.A.	N.A.	N.A.
13	Pumping Arrangements.			
	• Ground Level	N.A.	N.A.	N.A.
	➤ Discharge of main Pump	N.A.	N.A.	N.A.
	➤ Head of Main Pump	N.A.	N.A.	N.A.
	➤ Number of main pumps	N.A.	N.A.	N.A.
	➤ Jockey pump out put	N.A.	N.A.	N.A.
	➤ Jockey pump head	N.A.	N.A.	N.A.
	➤ Standby pump out put	N.A.	N.A.	N.A.
	➤ Standby pump Head	N.A.	N.A.	N.A.
	➤ Auto Starting /Manual stopping	N.A.	N.A.	N.A.
	➤ Pump House Access	N.A.	N.A.	N.A.
	• Terrace Level	N.A.	N.A.	N.A.
	➤ Discharge of pump	Required	Provided	MR
	➤ Head of the Pump	900LPM	900LPM	MR
	➤ Power supply	40m	40m	MR
	➤ Auto Starting of pump	Required	Provided	MR
14	Captive Water Storage for Fire Fighting.			
	On ground tank capacity	N.A	N.A	N.A.
	Draw-off connection	N.A.	N.A.	N.A.
	Fire service inlet	N.A.	N.A.	N.A.
	Access to tank	N.A.	N.A.	N.A.
	Overhead Tank capacity	10000Liters.	10000Liters.	MR
15	Exit Signage.	Required	Provided	MR

H/3  
Schengen Restaurant 22/48 Commercial Complex Ch...

16	Provision of Lifts.			
	Pressurization of Lift Shaft	N.A.	N.A.	N.A.
	Pressurization of Lift lobby	N.A.	N.A.	N.A.
	Communication in lift car	N.A.	N.A.	N.A.
	Firemen's grounding switch	N.A.	N.A.	N.A.
	Lift Signage	N.A.	N.A.	N.A.
17	Standby power supply	Required	Provided 10Kva Generator set	MR
18	Refuge Area.			
	Total area	N.A.	N.A.	N.A.
	Location	N.A.	N.A.	N.A.
19	Fire Control Room			
	Detector system panel	N.A.	N.A.	N.A.
	Flow switch panel	N.A.	N.A.	N.A.
	PA system panel	N.A.	N.A.	N.A.
	Batter backup	N.A.	N.A.	N.A.
	Building Floor Plans	N.A.	N.A.	N.A.
20	Special Fire Protection systems for of special Risks, if any:	N.A.	N.A.	N.A.

The fire protection systems provided in the building were test checked at random and found functional at the time of inspection.

Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules 2010.

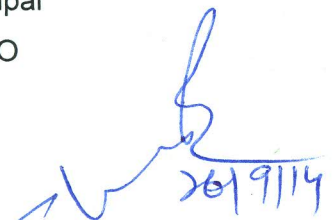
 26/19

Signature of the Inspecting Officer

Name Vedpal

Designation ADO

D.O. (South)

 26/9/14