

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001
Fax: 23412593, Email: director.dfire@nic.in, Tel:- 011-23414000


No.F6/ DFS/ MS/Mall/SZ/2015/ 52/232

Dated: 18/02/15

FIRE SAFETY CERTIFICATE

Certified that the M/s Select City Walk Mall building at Plot No-A-3, District Centre, Saket, New Delhi-110017 comprised of three tier basement, ground plus seven upper floor and projection room was granted FSC by this department vide letter no. F.6/DFS/ MS/ 2011/3114 dated 22.11.2011. The premises was re-inspected by the officer concerned of this department on 27.01.2015 in the presence of Mr. Shashi Sharma (Sr. Vice President), of the mall and observed that the said mall building have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the premises is fit for occupancy class- Group- F (Mercantile Building) with effect from 18/02/15.....for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules 2010.

Issued on ...18/02/15..... at New Delhi by



(Dr. G.C. Misra)
CHIEF FIRE OFFICER
DELHI FIRE SERVICE
Tel:- 011-23414333

Copy to,

1. The Jt. Director (Bld), DDA, Building Section INA, Vikas Sadan, New Delhi.
2. Mr. Shashi Sharma
Sr. Vice President, Select City Walk,
Plot No-3, Plot No-A-3, Distt Centre, Saket, New Delhi-110017.

Conditions for the validity of fire safety certificate

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non-functional fire safety measures shall be at the risk & responsibility of the management.
3. The trained staff should be available round the clock.
4. The basement shall be used as per the provisions of National Building Code.
5. Any deviation w.r.t. construction shall be verified by the concerned building sanctioning agency.
6. The certificate may not be treated in any case for regularization of unauthorized construction, if any.
7. The owner/occupier shall submit a declaration every year in form 'K' Provided in the first schedule of Delhi Fire Service Rules 2010; form is available on www.dfs.delhigovt.nic.in
8. The owner / occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form "J" [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry. The form is available on www.dfs.delhigovt.nic.in

INSPECTION REPORT

1	Name & address of the building	M/s Select City Walk (Select Infrastructure Pvt Ltd) at A-3, Distt Centre Saket New Delhi-110017		
2	Type of Occupancy	Mixed occupancy (Mercantile & Assembly)		
3	Type of case	Renewal		
4	Details of previous NOC	F6/DFS/MS/2011/3114 Dated:22.11.2011		
5	Fire safety directives letter No	F6/MS/DFS/BP/2006/1141 Dated: 18.05.2006		
6	Date of inspection	27.01.2014		
7	Name of the inspecting Officers :	Dy. CFO (SZ) Atul Garg,D.O. (South) D.P. Bhardwaj & ADO(BCP) D.B.Mukherjee		
8	Name and designation of officers from the building side	Mr.Shashi Sharma (Vice President) & Mr. Iqbal (Mall Fire Officer)		
9	Year of construction	2007		
10	Applicant's letter No.	SIPL/Engg/14-15/25 Dated: 20/10/2014		
The mall building is comprised of Three basements, ground plus 7 upper floor				
Sl. NO.	Minimum Standards on fire prevention and fire safety U/R 33	NBC Requirement	Provided at site	Remarks MR / NMR
1	Access to building			
	1) Road width	20 mtrs	Provided	MR
	2) Gate width	5mtrs	Provided	MR
	3) Width of internal road	6 mtrs	Provided	MR
2	Number, width Type & arrangement of exits			
	a. Number of staircases			
	1. Upper floors	30 Nos	Provided	MR
	2. basements	27 Nos. + Ramp	Provided	MR
	b. Width of staircase			
	1. Upper floors	1.5 Mtrs	Provided	MR
	2. basements	1.5 Mtrs	Provided	MR
	c. Protection of exits			
	1. Fire check door	Required	Provided	MR
	2. Pressurization	Required	Provided	MR
	d. No. of continubus staircase to terrace	7 Nos.	Provided	MR
	e. Width of corridor	1.5m	Provided	MR
	f. Door size	2mtr	Provided	MR
3	Compartmentation.			
	1. Fire check door	Required	Provided	MR
	2. Sealing of electrical shafts	Required	Provided	MR
	3. Fire Rating of shaft door	Required	Provided	MR
	4. water curtain	Required	Provided	MR
	5. Fire dampers	Required	Provided	MR
4	Smoke Management system.			
	basement	30 a/c per hour	Mechanical Ventilation	MR
	upper floors	12 a/c per hour	Mechanical Ventilation	MR
5	Fire Extinguishers			
	total numbers		933 Nos	MR
	Types		ABC, Co2,Water Co2,	MR
	ISI marking	ISI	Yes	MR
6	First-Aid Hose Reels.			
	total numbers on each floor	102 Nos. Total	Provided	MR
	Length of Hose reel hose	30 m	Provided	MR
	Nozzle Diameter	5 mm	Provided	MR

7	Automatic fire detection and alarming system			
	Type of detectors	Smoke & Heat	Provided	MR
	location of Main Panel	Required	Provided (Ground Floor)	MR
	location of Repeater panel	Required	Ground & Basement	MR
	Alternate source of power	Required	Battery Backup	MR
	hooter's location	Required	Provided	MR
8	MOEFA	Required	Provided	MR
9	Public Address System.	Required	Provided	MR
10	Automatic Sprinkler System.			
	basement	Required	Provided	MR
	upper floors	Required	Provided	MR
	sprinkler above false ceiling	Required	Provided	MR
11	Internal Hydrants			
	Size of riser/down-corner	150 mm	Provided	MR
	Number of Hydrants per floor	Required (99 Nos Total)	Provided	MR
	hose Box	Required	Provided	MR
12	Yard Hydrants.			
	total number of hydrants	18 Nos	Provided	MR
	hose box	18 Nos.	Provided	MR
13	Pumping arrangements			
	1. Ground level			
	a. Discharge of main Pump	4500 LPM	Provided	MR
	b. Head of main pump	88 Mtr	Provided	MR
	c. Number of main pumps	Two	Provided	MR
	d. jockey pump out put	180 LPM	Provided	MR
	e. jockey pump head	88 Mtr	Provided	MR
	f. Standby Pump output	4500 LPM	Provided	MR
	g. Stanby Pump head	88 Mtr	Provided	MR
	h. Auto Starting/Manual stopping	Required	Provided (Both)	MR
	pump house access	Required	Provided	MR
	2. Terrace level			
	a. Discharge of pump	180 LPM	Provided	MR
	b. head of the pump	88 mtr	Provided	MR
	c. Power supply	Required	Provided + DG	MR
	d. Auto starting of pump	Required	Provided	MR
14	Captive water storage for fire fighting			
	1. Underground tank capacity	500000 Ltrs	Provided	MR
	a. Draw-off connection	Required	Provided	MR
	b. fire service inlet	Required	Provided	MR
	c. Access to tank	Required	Provided	MR
	Over head tank Capacity	30,000 ltr	Provided	MR
15	Exit Signage.	Required	Provided	MR
16	Provision of lifts.			
	a. Pressurization of lift shaft	Required	Provided	MR
	b. pressurization of lift lobby	Required	Provided	MR
	c. communication in lift car	Required	Provided	MR
	d. Fireman's grounding switch	Required	Provided	MR
	e. Lift signage	Required	Provided	MR
17	Standby power supply	Required	Provided	MR
18	Refuge Area.			
	total area	958.78 m ²	Provided	MR
	location	Fourth & Sixth Floor	Provided	MR


19	Fire control room			
	a. detector system Panel	Required		Provided MR
	b. Flow switch Panel	Required		Provided MR
	c. PA system Panel	Required		Provided MR
	d. Batter backup	Required		Provided MR
	e. Building floor plans	Not Required		Not Required MR
20	Special Fire Protection systems for protection of special risks, if any:			

1. Co2 flooding system for LT HT Panel. 2 FM200 for Server Cabind


The fire protection systems provided in the building were checked and found functional at the time of inspection. Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules it is recommended to renew the Fire safety Certificate issued vide letter no.F6/DFS/MS/2011/3114, dtd. 22/11/2011 under rules 35 of the Delhi Fire Service Rules 2010.



Signature of the inspecting officer
Name Atul Garg
Designation : Dy. Chief Fire Officer (SZ)

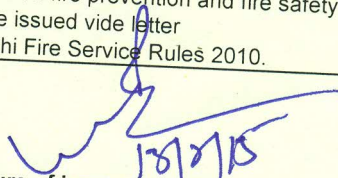

Signature of inspecting officer
Name D.P.Bhardwaj
Designation: DO (South)



Signature of the Inspecting Officer
Name D.B.Mukherjee
Designation: ADO (BCP)