

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110 001

No. F6/DFS/MS/EH/2015/SZ/439

Dated: 27/3/15

FIRE SAFETY CERTIFICATE

Certified that the M/S Narangs International Hotels Pvt. Ltd. Unit:- The Ambassador's Sky Chef located at IGI Airport Complex, New Delhi-110037, comprised of basement and ground floor only, was granted NOC by this department vide letter No. F6/DFS/MS/EH/2012/1192, dated 02-04-12. The premises was re-inspected by the officer concerned of this department on 10-03-2015 in the presence of Sh. D.S.Dogra.(Chief Security Officer) and found that the said eating house building have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the premises is fit for occupancy class Eating House (Assembly Building) with effect from 27/03/2015 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.


Issued on, 27/03/2015 at New Delhi by.



(Dr.G.C.Misra)

Chief Fire Officer

T.No.011-23414333



Copy to:-

Sh. Murali Krishnan, Vice President, M/S Narangs International Hotels Pvt.

Ltd. Unit:- The Ambassador's Sky Chef, IGI Airport Complex, New Delhi-110037.

Conditions for the validity of fire safety certificate are overleaf:-

CONDITIONS:

1. All the means of escape shall be kept free of all type of obstruction all the time.
2. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
3. All the fire fighting equipments shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
4. Any deviation, with regards to construction, ventilation, occupancy, electric installation etc. may be got verified from the concerned authorities.
5. This Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction unauthorized use of land if any.
6. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in.
7. The owner/occupier shall apply for renewal of this Fire Safety Certificate on form J, six month prior to its expiry.

INSPECTION REPORT

1. Name & address of the building : M/S Narangs International Hotels Pvt. Ltd. Unit:- The Ambassador's Sky Chef located at IGI Airport Complex, New Delhi-110037.
2. Building comprises of : B+G only.
3. Type of Occupancy : Eating House (Sky Kitchen).
4. Type of Case : Renewal.
5. Details of Previous NOC :No.F6/DFS/MS/EH/2012/1192, dated 02.04.12.
6. Fire Safety direction letter No : Nil.
7. Date of Inspection : 10.03.15.
8. Name of the Inspecting Officers: : Vedpal (ADO).
9. Name and designation of Officer from the building side : Sh. D.S.Dogra (Chief Security Officer).
10. Year of Construction : 1983.
11. Applicant's letter No :Nil, dated 13.02.15.

S.No	Minimum Standards on fire prevention and fire safety as per Rule 33.	Requirement	Provided at Site	Remarks MR/NMR
1	Access to building			
	Road width	6 m	10m	MR
	Gate width	5m.	5m.	MR
	Width of internal road	8m	8m	MR
2	Number, Width, Type and Arrangement of Exits.			
	a. Number of Staircases	.		
	Upper Floor	N.A.	N.A.	N.A.
	Basement	3nos.+1ramp	3nos.+1ramp	MR
	B. Width of Staircases	.		
	Upper Floor	N.A.	N.A.	N.A.
	Basement	1.5m	1.8m,2.6m,1.2m & ramp=2m	MR
	c. Protection of exits	Required	Provided	MR
	Fire check door	Required	Provided in basement	MR
	Pressurization	N.A.	N.A.	N.A.
	e. No. of continuous staircases to terrace	01no.	01no.	MR
g. Width of Corridor	N.A.	N.A.	N.A.	
h. Door Size	N.A.	N.A.	N.A.	
3	Compartmentation			
	Fire check door	Required	Provided	MR
	Sealing of electrical shafts	Required	Provided	MR
	Fire rating of shaft door	N.A.	N.A.	N.A.
	Water curtain	N.A.	N.A.	N.A.
	Fire Dampers	N.A.	N.A.	N.A.
4	Smoke Management System.			
	Basement	30a/c per hour	Exhaust fan provided	MR
	Upper floor	15 a/c per hour	Exhaust fan provided	MR

M/S The Ambassador's Sky Chef, IGI Airport Complex, New Delhi-110037.

5.	Fire Extinguisher			
	Total numbers	16 nos.	50 nos.	MR
	Types	ABC&WCO ₂	ABC&WCO ₂	MR
	IS marking	ISI marked	ISI marked	MR
6	First-aid-Hose Reels.			
	Total numbers of each floor	04nos.	04nos.	MR.
	Length of hose reel hose	30m	30m	MR.
	Nozzle diameter	5cm	5cm	MR.
7	Automatic fire detection and alarming system.			
	Type of detectors	Required	Smoke & heat Provided	MR
	Location of main panel	Required	Provided at ground floor	MR
	Location of repeater panel	N.A.	N.A.	N.A.
	Alternate source of power	Required	Provided	MR
	Hooters	Required	Provided	MR
8	MOEFA	Required	Provided	M R
9	Public address System.	Required	Provided	MR
10	Automatic Sprinkler System.			
	Basement	Required	Provided	MR
	upper floor	N.A.	N.A.	N.A.
	sprinkler above false ceiling	N.A.	N.A.	N.A.
11	Internal Hydrants			
	size of riser/down-comer	100mm	100mm	M R
	Number of hydrants per floor	04Nos.	04nos.	M R
	Hose Box	04Nos.	04nos.	M R
12	Yard Hydrants.			
	Total number of hydrants	10nos.	10nos.	MR
	Hose Box	10nos.	10nos.	MR
13	Pumping Arrangements.			
	➤ Ground Level	Required	Provided	MR
	➤ Discharge of main Pump	1800LPM	1800LPM	MR
	➤ Head of Main Pump	40m	56m	MR
	➤ Number of main pumps	02nos.	02nos.	MR
	➤ Jockey pump out put	180 LPM	180LPM	MR
	➤ Jockey pump head	40 m	56m	MR
	➤ Standby pump out put	N.A.	N.A.	N.A.
	➤ Standby pump Head	N.A.	N.A.	N.A.
	➤ Auto Starting /Manual stopping	Required	Provided	MR
	➤ Pump House Access	Required	Provided	MR
	➤ Terrace Level	N.A.	N.A.	N.A.
	➤ Discharge of pump	N.A.	N.A.	N.A.
	➤ Head of the Pump	N.A.	N.A.	N.A.
	➤ Power supply	N.A.	N.A.	N.A.
	➤ Auto Starting of pump	N.A.	N.A.	N.A.

- Fire pumps panel is connected to DG Set through dedicated supply line.


M/10

M/S The Ambassador's Sky Chef, IGI Airport Complex, New Delhi-110037.

14	Captive Water Storage for Fire Fighting.			
	Underground tank capacity	150000Liters	150000Liters	MR
	Draw-off connection	Required	Provided	MR
	Fire service inlet	Required	Provided	MR
	Access to tank	Required	Provided	MR
	Overhead Tank capacity	N.A.	N.A.	N.A.
15	Exit Signage.	Required	Provided	M R
16	Provision of Lifts.			
	Pressurization of Lift Shaft	N.A.	N.A.	N.A.
	Pressurization of Lift lobby	N.A.	N.A.	N.A.
	Communication in lift car	N.A.	N.A.	N.A.
	Firemen's grounding switch	N.A.	N.A.	N.A.
	Lift Signage	N.A.	N.A.	N.A.
17	Standby power supply	Required	Provided (500KVA DG Set)	M R
18	Refuge Area.			
	Total area	N.A.	N.A.	N.A.
	Location	N.A.	N.A.	N.A.
19	Fire Control Room			
	Detector system panel	N.A.	N.A.	N.A.
	Flow switch panel	N.A.	N.A.	N.A.
	PA system panel	N.A.	N.A.	N.A.
	Battery backup	N.A.	N.A.	N.A.
	Building Floor Plans	N.A.	N.A.	N.A.
20	Special Fire Protection systems for protection of special Risks, if any:	Required	Co2 system is Provided in HT, LT Panels	MR

The fire protection systems provided in the building were test checked randomly and found functional at the time of inspection. In view of the deemed compliance of the minimum standards on fire prevention and fire safety required under the rules the NOC issued vide letter No.F.6/DFS/MS/EH/2012/1192, dated 02.04.12, renewal under rule 35 of the Delhi Fire Service Rule 2010 is recommended.

Accordingly DFA is put up for kind consideration please.

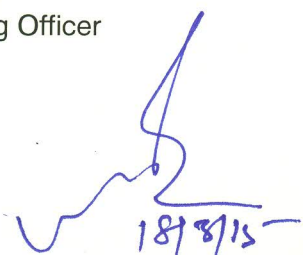
 16/3

Signature of the Inspecting Officer

Name Vedpal

Designation ADO

D.O. (South)

 18/8/15