

NO.F6/DFS/MS/School/2015/SZ/ 588

DATED: 22/04/15

FIRE SAFETY CERTIFICATE

Certified that Pushpanjali Public School at A-2/B, Pushpanjali Farms, Bijwasan, New Delhi-110061 comprised of ground plus one upper floor was granted NOC by this department vide letter no. F6/MS/DFS/School/2006/2434 dated 11.09.2006. The premises re-inspected by the officers concerned of Fire Service on 06.04.2015 in the presence of Sh. Shilender Singh (Owner) of the school and found that the school management have deemed complied with the prevention and fire safety requirements in accordance with the Directorate of Education circular No. F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011 and that the school building is fit for occupancy class B "Educational building" with effect from the dated of issue of this certificate for a period of **three years**, subject to conditions as mentioned below.

Issued on 22/04/15 at New Delhi by


Dr. G.C. Misra
Chief Fire Officer

Copy to,

1. The Director, Education, G. N.C.T Delhi, Old Secretariat, New Delhi
2. The Head Mistress, Pushpanjali Public School at A-2/B, Pushpanjali Farms, Bijwasan, New Delhi-110061.

Conditions for the validity of fire safety certificate

- a. All the fire safety and means of escape facilities shall be maintained in good working conditions at all time. Any lapse rendering fire safety or means of evacuation facilities rendering non-functional shall be the responsibility of the management.
- b. Building Sanctioning authority may verify any deviation with regard to the construction/occupancy in the building. In case of any deviation, the fire safety certificate stands null and void.
- c. The staffs shall be trained for operating fire fighting system and mock evacuation drills be conducted at regular intervals and record be maintained.
- d. The basement shall be used strictly as per the provisions of Building Bye laws.
- e. The owner/occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules-2010. The form is available on www.dfs.delhigovt.nic.in.
- f. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form "J" [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry. The form is available on www.dfs.delhigovt.nic.in.

Conditions

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. The staff should be trained available round the clock.
4. Any deviation w.r.t. construction etc shall be verified the concerned building sanctioning agency.
5. This certificate may not be treated in any case for regularization of unauthorized construction, if any.

INSPECTION REPORT

1	Name & address of the building	Pushpanjali Public School at A-2/B, Pushpanjali Farms, Bijwasan, New Delhi-110061.		
2	Type of Occupancy	Educational Building "B"		
3	Building Comprised of	Ground floor plus one upper floor		
4	Type of case	Renewal		
5	Details of previous NOC	F6/MS/DFS/School/2006/2434 dated 11.09.2006		
6	Fire safety directives letter No	As per education circular		
7	Date of inspection	06.04.2015		
8	Name of the inspecting Officers :	D.O. (South) D.P. Bhardwaj, ADO Vedpal		
9	Name and designation of officers from the building side	Sh. Shilender Singh		
10	Year of construction	2005 before		
11	Applicant's letter No.	Nil, 25.03.2015		
			Old Case	
S. NO.	Minimum Standards on fire prevention and fire safety U/R 33	Old Case/ As per education circular	Provided at site	Remarks MR / NMR
1	Access to building			
	1) Road width	Approachable	6 Mtr Provided	MR
	2) Gate width	4.5 Mtr	Provided	MR
	3) Width of internal road	N/A	N/A	N/A
2	Number, width Type & arrangement of exits			
	a. Number of staircases			
	1. Upper floors	3 Nos	Provided	MR
	2. basements	N/A	N/A	N/A
	b. Width of staircase			
	1. Upper floors	1.25 Mtr	2.1, 2.1 & 2.5 Mtr Provided	MR
	2. basements	N/A	N/A	N/A
	c. Protection of exits			
	1. Fire check door	N/A	N/A	N/A
	2. Pressurization	N/A	N/A	N/A
	d. No. of continuous staircase to terrace	N/A	N/A	N/A
	e. Width of corridor	1.25 Mtr	Provided	MR
	f. Door size	1 Mtr	Provided	MR
3	Compartmentation.			
	1. Fire check door	N/A	N/A	N/A
	2. Sealing of electrical shafts	N/A	N/A	N/A
	3. Fire Rating of shaft door	N/A	N/A	N/A
	4. water curtain	N/A	N/A	N/A
	5. Fire dampers	N/A	N/A	N/A
4	Smoke Management system.			
	basement	30 a/c per hour 12 a/c per hour	N/A	N/A
	upper floors		Natural Ventilation Provided	MR
5	Fire Extinguishers			
	total numbers		16 Nos	MR
	Types		ABC, & Co2	MR
	ISI marking	ISI	Yes	MR

6	First-Aid Hose Reels.			
	total numbers on each floor	2 Nos	Provided	MR
	Length of Hose reel hose	30 Mtr	Provided	MR
	Nozzle Diameter	5 MM	Provided	MR
7	Automatic fire detection and alarming system			
	Type of detectors	N/A	N/A	N/A
	location of Main Panel	N/A	N/A	N/A
	location of Repeater panel	N/A	N/A	N/A
	Alternate source of power	N/A	N/A	N/A
	hooter's location	N/A	N/A	N/A
8	MOEFA	N/A	N/A	N/A
9	Public Address System.	Required	Provided	MR
10	Automatic Sprinkler System.			
	basement	N/A	N/A	N/A
	upper floors	N/A	N/A	N/A
	sprinkler above false ceiling	N/A	N/A	N/A
11	Internal Hydrants			
	Size of riser/down-corner	N/A	N/A	N/A
	Number of Hydrants per floor	N/A	N/A	N/A
	hose Box	N/A	N/A	N/A
12	Yard Hydrants.			
	total number of hydrants	N/A	N/A	N/A
	hose box	N/A	N/A	N/A
13	Pumping arrangements			
	1. Ground level			
	a. Discharge of main Pump	N/A	N/A	N/A
	b. Head of main pump	N/A	N/A	N/A
	c. Number of main pumps	N/A	N/A	N/A
	d. jockey pump out put	N/A	N/A	N/A
	e. jockey pump head	N/A	N/A	N/A
	f. Standby Pump output	N/A	N/A	N/A
	g. Stanby Pump head	N/A	N/A	N/A
	h. Auto Starting/Manual stopping	N/A	N/A	N/A
	pump house access	N/A	N/A	N/A
	2. Terrace level			
	a. Discharge of pump	180 LPM	Provided	MR
	b. head of the pump	35 Mtr	Provided	MR
	c. Power supply	Required	Provided	MR
	d. Auto starting of pump	Required	Provided	MR
14	Captive water storage for fire fighting			
	1. Underground tank capacity	N/A	N/A	N/A
	a. Draw-off connection	N/A	N/A	N/A
	b. fire service inlet	N/A	N/A	N/A
	c. Access to tank	N/A	N/A	N/A
	Over head tank Capacity	5000 Ltr	Provided	MR
15	Exit Signage.	N/A	N/A	N/A
16	Provision of lifts.			
	a. Pressurization of lift shaft	N/A	N/A	N/A
	b. pressurization of lift lobby	N/A	N/A	N/A
	c. communication in lift car	N/A	N/A	N/A
	d. Fireman's grounding switch	N/A	N/A	N/A
	e. Lift signage	N/A	N/A	N/A

02/9

17	Standby power supply	N/A	N/A	N/A
18	Refuge Area.	Not Required		
	total area			
	location			
19	Fire control room			
	a. detector system Panel	N/A	N/A	N/A
	b. Flow switch Panel	N/A	N/A	N/A
	c. PA system Panel	N/A	N/A	N/A
	d. Batter backup	N/A	N/A	N/A
	e. Building floor plans	N/A	N/A	N/A
20	Special Fire Protection systems for protection of special risks, if any: N/A			

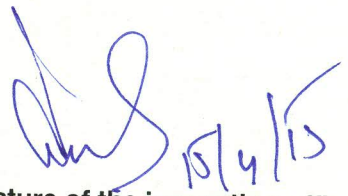
The fire protection systems provided in the building were checked and found functional at the time of inspection.

In view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules of NOC issued vide letter no. **F6/MS/DFS/School/2006/2434 dated 11.09.2006** renewal under the Directorate of Education circular No. F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011 is recommended.

Accordingly DFA is put up for your approval and signature please.


15/4/15

Signature of the inspecting officer
Name D. P. Bhardwaj
Designation : Divisional Officer (South)


15/4/15

Signature of the inspecting officer
Name Vedpal
Designation : ADO (SJ)