

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS: DELHI FIRE SERVICE: CANNAUGHT PLACE NEW DELHI-01**

No. FG/DFS/MS/2015/799

Dated: 19/05/15

**FIRE SAFETY CERTIFICATE**

Certified that M/S Celebi Delhi Cargo Terminal Management India Private Ltd. Building at IGI Airport, New Delhi 110037, comprised of ground and first floor only, owned/occupied by M/S Celebi Delhi Cargo Terminal Management India Private Limited was granted Fire Safety Certificate by this department vide letter No. F6/DFS/MS/2012/3296, dated 10-09-2012. The premises was re-inspected by the officers concerned of this department on 09-05-2015 in the presence of Sh. Amit Chhikara (Fire Officer) and found that the said building have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, and that the building is fit for occupancy class "Storage Occupancy" with effect from .....19/05/.....2015 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of Delhi Fire Service Rules,2010. Issued on.....19/05/.....2015 at New Delhi by



(Dr.G.C.Misra)  
Chief Fire Officer  
T.No.011-23414333

- Copy to:-1. M/S Celebi Delhi Cargo Terminal Management India Private Limited, IGI Airport, New Delhi-110037. o/c  
k
2. Sh. Anil Dhawan, Executive Vice President, Delhi International Airport (P) Ltd. New Udaan Bhawan, Terminal-3, IGI Airport, New Delhi-37.

**Conditions for the validity of fire safety certificate are under:-**

1. All the means of escape shall be kept free of all type of obstruction all the time.
2. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
3. All the fire fighting equipments shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
4. Any deviation, with regards to construction, ventilation, occupancy, electric installation etc. may be got verified from the concerned authorities.
5. This Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction unauthorized use of land if any.
6. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).
7. The owner/occupier shall apply for renewal of this Fire Safety Certificate in form J, six month prior to its expiry.

## INSPECTION REPORT

1. Name & address of the building: M/S Celebi Delhi Cargo Terminal Management India Private Ltd. at IGI Airport, New Delhi 110037.
2. Building comprised of : G+ one upper floor.
3. Type of Occupancy : Storage Building.
4. Type of Case : Renewal.
5. Details of previous NOC : No.6/DFS/MS/2012/3296, Dated 10.09.2012
6. Fire Safety directives Letter No. : F6/DFS/MS/BP/380, dated 20.02.1998.
7. Date of inspection : 09.05.2015.
8. Name of the Inspecting Officer : Atul Garg(DCFO), D.P.Bhardwaj (D.O) and Vedpal (ADO).
9. Name and designation of Officer  
from the building side : Sh. Amit Chhikara (Fire Officer).
10. Year of Construction : 1998
11. Applicant's letter No. : Nil, dated 21.04.2015.

S No	Minimum standards on fire prevention and fire safety U/R 33	Requirements	Provided at site	Remarks MR/NMR
1.	Access of building			
	<ul style="list-style-type: none"> <li>• Road width</li> <li>• Gate width</li> <li>• Width of internal road</li> </ul>	9 M 5 M 6 M	12M >5M > 6 M	MR MR MR
2.	Number, width, Type & Arrangements of exits			
	g. Number of staircases			
	<ul style="list-style-type: none"> <li>• Upper floors</li> <li>• Basements</li> </ul>	14nos. N.A.	14nos. N.A.	MR N.A.
	h. Width of staircases			
	<ul style="list-style-type: none"> <li>• Upper floors</li> <li>• Basements</li> </ul>	1.25m(each) N.A.	3=1.5m, 2=1.7, 6=1.3, 1.4, 1.12 & 1.25 N.A.	MR(old case) N.A.
	i. Protection of exits			
	<ul style="list-style-type: none"> <li>• Fire check door</li> <li>• Pressurization</li> </ul>	Required N.A.	Provided N.A.	MR N.A.
	j. No of continuous staircase to terrace	01no.	01no.	MR
	k. Width Of Corridor	2.5m	2.5m	MR
	l. Door Size	1.25m	1.25m	MR



3.	Compartmentation			
	<ul style="list-style-type: none"> <li>• Fire check door</li> </ul>	Required	Provided	MR
	<ul style="list-style-type: none"> <li>• Sealing of electrical shafts</li> </ul>	Required	Provided	MR
	<ul style="list-style-type: none"> <li>• Fire Rating of shaft door</li> </ul>	Required	Provided	MR
	<ul style="list-style-type: none"> <li>• Water Curtain</li> </ul>	N.A.	N.A.	N.A.
	<ul style="list-style-type: none"> <li>• Fire Dampers</li> </ul>	N.A.	N.A.	N.A.
4.	Smoke managements System			
	<ul style="list-style-type: none"> <li>• Basements</li> </ul>	N.A.	N.A.	N.A.
	<ul style="list-style-type: none"> <li>• Upper floors</li> </ul>	12 a/c per hour	Exhaust fans provided.	MR
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> <li>• Total numbers</li> </ul>	3000nos.	300 nos.	MR
	<ul style="list-style-type: none"> <li>• Types</li> </ul>	Water CO <sub>2</sub> , DCP, CO <sub>2</sub> , Foam	Water CO <sub>2</sub> , DCP, CO <sub>2</sub> , Foam type	MR
	<ul style="list-style-type: none"> <li>• IS marking</li> </ul>	ISI marked	ISI marked.	MR
6.	First – Aid Hose Reels			
	<ul style="list-style-type: none"> <li>• Total numbers on each floor</li> </ul>	GF=70nos. FF=20nos.	GF=70nos. FF=20nos.	MR
	<ul style="list-style-type: none"> <li>• Length of hose reel hose</li> </ul>	30m	30m	MR
	<ul style="list-style-type: none"> <li>• Nozzle diameter</li> </ul>	6mm	6mm	MR
7.	Automatic fire detection and alarming system			
	<ul style="list-style-type: none"> <li>• Type of detectors</li> </ul>	Heat, Smoke & Beam detector	Heat, Smoke & Beam Detector	MR
	<ul style="list-style-type: none"> <li>• Location of Main Panel</li> </ul>	Ground floor	Ground floor	MR
	<ul style="list-style-type: none"> <li>• Location of Repeater Panel</li> </ul>	FCC	FCC	MR
	<ul style="list-style-type: none"> <li>• Alternate source of power</li> </ul>	Required	UPS/Generator/Batteries	MR
	<ul style="list-style-type: none"> <li>• Hooters' Location</li> </ul>	Required	All Corridor, Exit gate	MR
8.	MOEFA	Required	Provided	MR
9.	Public Address System	Required	Provided	MR
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> <li>• Basements</li> </ul>	N.A.	N.A.	N.A.
	<ul style="list-style-type: none"> <li>• Upper Floor</li> </ul>	Required	Provided	MR
	<ul style="list-style-type: none"> <li>• Sprinkler above false ceiling</li> </ul>	Required	All area protected with sprinkler	MR
11.	Internal Hydrants			
	<ul style="list-style-type: none"> <li>• Size of riser</li> </ul>	150 mm	150 mm	MR
	<ul style="list-style-type: none"> <li>• Number of hydrants per floor</li> </ul>	GF=70nos, 1 <sup>st</sup> =20nos.	GF=70nos. & 1 <sup>st</sup> =20nos.	MR
	<ul style="list-style-type: none"> <li>• Hose Box</li> </ul>	GF=70nos. 1 <sup>st</sup> =20nos.	GF=70nos & 1 <sup>st</sup> =20nos.	MR




12.	Yard Hydrants			
	• Total number of hydrants	16nos.	16nos.	MR
	• Hose Box	16nos.	16nos.	MR
13.	Pumping Arrangements		HYDRANT	SPRINKLER
	• Ground Level			
	• Discharge of main pump	4500LPM	4500LPM	MR
	➤ Head of main pump	88meters(Each)	88 Meters(Each)	MR
	➤ Number of main pumps	02nos.	02nos.	MR
	➤ Jockey pump out put	450 LPM	450LPM	MR
	➤ Jockey pump head	88m(Each)	88m(Each)	MR
	➤ Standby Pump out put	4500LPM	4500LPM	MR
	➤ Standby Pump Head	88m	88m	MR
	➤ Auto Staring/Manual stopping	Required	Provided	MR
	➤ Pump House Access	Required	Provided	MR
	• Terrace level	N.A.	N.A.	N.A.
	➤ Discharge of pump	N.A.	N.A.	N.A.
	➤ Head of the pump	N.A.	N.A.	N.A.
	➤ Power supply	N.A.	N.A.	N.A.
	➤ Auto starting of pump	N.A.	N.A.	N.A.
14.	Captive water Storage for fire fighting			
	• Underground tank capacity	7.5Lakh Liters	7.5Lakh Liters	MR
	➤ Draw off connection	Required	Provided	MR
	➤ Fire service inlet	Required	Provided	MR
	➤ Access to tank	Required	Provided	MR
	• Overhead Tank capacity	N.A.	N.A.	N.A.
15	Exit Signage	Required	Provided	MR
16.	Provision of Lifts			
	➤ Pressurization of Lift Shaft	N.A.	N.A.	N.A.
	➤ Pressurization of lift lobby	N.A.	N.A.	N.A.
	➤ Communication in lift Car	N.A.	N.A.	N.A.
	➤ Fireman's Grounding Switch	N.A.	N.A.	N.A.
	➤ Lift Signage	N.A.	N.A.	N.A.
17.	Standby power supply	Required	Provided (UPS/ DG Set)	MR

18.	Refuge Area			
	➤ Total area	N.A.	N.A.	N.A.
	➤ Location	N.A.	N.A.	N.A.
19.	Fire control room			
	➤ Detector system panel	Required	Provided	MR
	➤ Flow Switch Panel	Required	Provided	MR
	➤ PA System Panel	Required	Provided	MR
	➤ Batter backup	Required	Provided	MR
	➤ Building Floor Plans	Required	Provided	MR
20.	Special Fire Protection Systems for Protection of special Risks, if any;	Required	High Velocity Water Spray system provided in transformer and ABC type fire extinguishers in HT & LT panels.	MR

The fire protection systems provided in the building were test checked at random and found functional at the time of inspection. In view of the deemed compliance of the minimum standards on fire prevention and fire safety required under the rules the FSC issued vide letter No.F.6/DFS/MS/2012/3296, dated 10.09.2012 renewal under rule 35 of the Delhi Fire Service Rule 2010 is recommended.


Accordingly DFA is put up for kind consideration please.

  
12/5/15

Signature of the Inspecting Officer

Name :Atul Garg

Designation :Dy.CFO

  
12/5/15

Signature of the Inspecting Officer

Name : D.P.Bhardwaj

Designation: D.O.

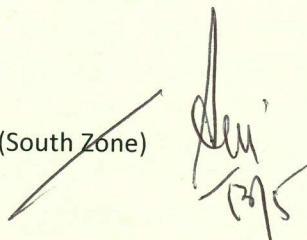


Signature of the Inspecting Officer

Name:Vedpal

Designation : ADO

CFO(South Zone)

  
12/5

