

FORM 'H'
FORM FOR ISSUING FIRE SAFETY CERTIFICATE
[Refer sub - rule (1) of rule 35]
GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE
NEW DELHI

No.

FG/DFS/MS/EH/2016/WZ/1658

Dated:

11/11/16

FIRE SAFETY CERTIFICATE

Certified that the M/s **Barshala (A Unit of Indo Spirit Bars Pvt. Ltd.)** located at **1st Floor 23-A First Floor Road No. 44, NN Towers, Community Centre, Pitampura, Delhi – 110034** in a building comprised of G + 1 Upper Floor was issued FSC vide Letter No. F6/DFS/MS/EH/2015/WZ/394 dated 20-03-2015 (for **Gola Sizzlers Restaurant & Bar**). The premises was re inspected by the officers concerned of this department on 31-10-2016 in the presence of **Mr. Vijay Kumar** and found that the said building have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rule, 2010 and that the premises is fit for occupancy class "Assembly" Group D with effect from 11-11-16 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 11-11-16 at New Delhi by.


(Atul Garg)

Chief Fire Officer
Ph: 011-23414250

Copy to:

1. Vijay Kumar,
M/s Barshala (A Unit of Indo Spirit Bars Pvt. Ltd.)
23-A First Floor Road No. 44, NN Towers, Community Centre,
Pitampura, Delhi – 110034.

Following fire safety directives must be adhered to:-

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
3. The trained staff should be available round the clock.
4. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
5. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
6. Basement shall be used as per building bye laws.
7. The owner/ occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry.
8. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.

INSPECTION REPORT

1. Name & address of the building: M/s Barshala (A Unit of Indo Spirit Bars Pvt. Ltd.) located at 23-A First Floor Road No. 44, NN Towers, Community Centre, Pitampura, Delhi – 110034
2. Type of Occupancy : Assembly (1st Floor)
3. Type of Case : Renewal
4. Details of previous NOC : Letter No. F6/DFS/MS/EH/2015/WZ/394 dated 20-03-2015 (For Gola Sizzlers Restaurant & Bar)
5. Fire Safety directives Letter No. : Nil
6. Date of inspection : 31-10-2016
7. Name of the Inspecting Officer : ADO (WP)
8. Name and designation of Officer
from the building side : Sh. Vijay Kumar
9. Year of Construction : 2005
10. Applicant's letter No. : DHO/RZ/2016/1122 dated 31-08-2016

S No	Minimum standards on fire prevention and fire safety U/R 33	BBL Requirements	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	6 m	Provided	MR
	• Gate width	NA	NA	NA
	• Width of internal road	NA	NA	NA
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	2	Provided	MR
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper floors	2 m	2m & 87	MR (old case)
	• Basements	NA	NA	NA
	c. Protection of exits			
	• Fire check door	NA	NA	NA
	• Pressurization	NA	NA	NA
	d. No of continuous staircase to terrace	NA	NA	NA
	e. Width Of Corridor	2 m	2 m	MR
	f. Door Size	1x2m & 1x1 m	1x2m & 1x1 m	MR
3.	Compartmentation			
	• Fire check door	Required in Kitchen	Provided	MR
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4.	Smoke managements System			
	• Basements	30 a/c per hour	NA	NA
	• Upper floors	12 a/c per hour	Provided	MR

	Fire Extinguishers			
	• Total numbers	06 nos.	Provided	MR
	• Types	ABC & CO ₂	Provided	MR
	• IS marking	ISI marked	Provided	MR
6.	First – Aid Hose Reels			
	• Total numbers on each floor	1	Provided	MR
	• Length of hose reel hose	30 m	Provided	MR
	• Nozzle diameter	6.5 mm	Provided	MR
7.	Automatic fire detection and alarming system			
	• Type of detectors	NR	NR	NR
	• Location of Main Panel	NR	NR	NR
	• Location of Repeater Panel	NR	NR	NR
	• Alternate source of power	NR	NR	NR
	• Hooters' Location	NR	NR	NR
8.	MOEFA	Required	Provided	MR
9.	Public Address System	NR	Provided	NR
10.	Automatic Sprinkler System			
	• Basements	NA	NA	NA
	• Upper Floor	Required	Provided	MR
	• Sprinkler above false ceiling	NR	NR	NR
11.	Internal Hydrants:			
	• Size of riser/down-comer	100 mm	Provided	MR
	• Number of hydrants per floor	1	Provided	MR
	• Hose Box	Required	Provided	MR
12.	Yard Hydrants			
	• Total number of hydrants	NA	NA	NA
	• Hose Box	NA	NA	NA
13.	Pumping Arrangements:			
	• Ground Level			
	• Discharge of main pump	NA	NA	NA
	➤ Head of main pump	NA	NA	NA
	➤ Number of main pumps	NA	NA	NA
	➤ Jockey pump out put	NA	NA	NA
	➤ Jockey pump head	NA	NA	NA
	➤ Standby Pump out put	NA	NA	NA
	➤ Standby Pump Head	NA	NA	NA
	➤ Auto Staring/Manual stopping	NA	NA	NA
	➤ Pump House Access	NA	NA	NA
	• Terrace level			
	➤ Discharge of pump	450 lpm, 180 lpm	Provided	MR
	➤ Head of the pump	36 m	Provided	MR
	➤ Power supply	Required	Provided	MR
	➤ Auto starting of pump	Required	Provided	MR
14.	Captive water Storage for fire fighting:			
	• Under ground tank capacity	NA	NA	NA
	➤ Draw off connection	NA	NA	NA
	➤ Fire service inlet	NA	NA	NA
	➤ Access to tank	NA	Provided	MR
	• Ground Tank capacity	5000 litres	Provided	MR

15	Exit Signage	Required	Provided	MR
16.	Provision of Lifts			
	➤ Pressurization of Lift Shaft	NA	NA	NA
		NA	NA	NA
	➤ Pressurization of lift lobby	NA	NA	NA
		NA	NA	NA
	➤ Communication in lift Car	NA	NA	NA
	➤ Fireman's Grounding Switch			
	➤ Lift Signage			
17.	Standby power supply	Required	Provided	MR
18.	Refuge Area			
	➤ Total area	NA	NA	NA
	➤ Location	NA	NA	NA
19.	Fire control room			
	➤ Detector system panel	NA	NA	NA
	➤ Flow Switch Panel	NA	NA	NA
	➤ PA System Panel	NA	NA	NA
	➤ Battery backup	NA	NA	NA
	➤ Building Floor Plans	NA	NA	NA
20.	Special Fire Protection Systems for Protection of special Risks, if any;	NA	NA	NA


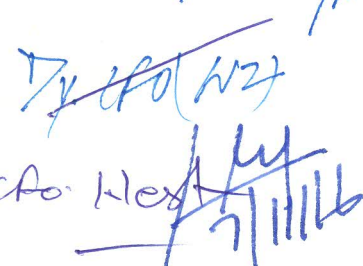

The fire protection systems provided in the building were test checked and found functional at the time of inspection,

In view of the deemed compliance of minimum standards on fire prevention and fire safety as required under the rules the NOC issued vide letter no. F6/DFS/MS/EH/2015/WZ/394 dated 20-03-2015 renewal under rule 35 of the Delhi Fire Service Rules 2010 is recommended.

Signature of the Inspecting Officer

Name Udai Vir Singh

Designation ADO WP


 22/10/16

 ADO WP
 27/11/16

 4/11/16