

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE
NEW DELHI- 110001


No. F6/DFS/MS/2015/Ehad/ND2/2154

Dated: 10/12/15

FIRE SAFETY CERTIFICATE


Certified that the New Bal Vikas Vidyalaya running at ground & first floor of building comprised of ground plus three upper floors at D-56 B& D-56B/1, Mandawali Unhepar, Delhi-92, owned/occupied by New Bal Vikas Vidyalaya was granted NOC vide letter no. No.F.6/DFS/MS/2006/1519 dated 07.07.2006. The school building was inspected by the officer concerned of this department on 10.10.2015 in the presence of Sh. Vikrant (Manager) of the school and found that the school building have deemed complied with the fire prevention and fire safety requirements in accordance with the circular no.262-362 Dated 17.01.2005 issued by the Director of Education and found that the GF+FF of building is fit for occupancy class B "Educational Building" with effect from 10/12/15 for a period of three years, subject to conditions printed overleaf.

Issued on 10/12/15 at New Delhi by

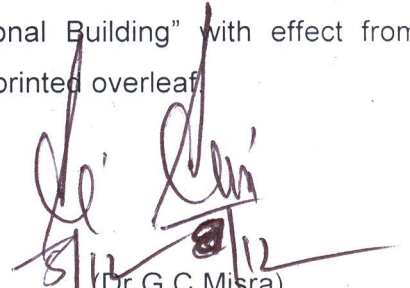
(Dr. G. C. Misra)
Chief Fire Officer
Ph.011-23414333

To,
The Manager
New Bal Vikas Vidyalaya
D-56 B& D-56B/1, Mandawali Unhepar,
Delhi-92,

Copy to:-
The Dy. Director of Education (E.D.M.C),
Udyog Sadan, Plot No.419,
FIE, Patpargang, Delhi-110092.



1. Name & address of the building : New Bal Vikas Vidyalaya At GF & First floor, D-56B & D-56b/1, Mandawali Unchepar, Delhi-92
2. Building is comprised of : **G+3**
3. Type of Occupancy : Educational
4. Type of Case : Renewal
5. Details of Previous FSC : F.6/MS/DFS/06/1519 dated 07.07.2006
6. Fire Safety direction letter No : Circular No.262-362 Dated 17.01.2005
7. Date of Inspection : 10.10.2015
8. Name of the Inspecting Officers: : R.K.Yadav (ADO)
9. Name of the designation of Officer
from the building side : Sh.Vikrant (Manager)
10. Year of Construction : 2004
11. Applicant's letter No : Dated 15.09.2015


S.No	Minimum Standards on fire prevention and fire safety U/R33	Requirement	Provided at Site	Remarks MR/NMR
1	Access to building			
	Road width	06 m	06 m	MR
	Gate width	N.A.	N.A.	N.A.
	Width of internal road	N.A.	N.A.	N.A.
2	Number, Width, Type and Arrangement of Exits			
	a. Number of Staircases			
	Upper Floor	01 no.	02 no.	MR
	Basement	N.A.	N.A.	N.A.
	B. Width of Staircases			
	Upper Floor	1.5 M	1.2 m & 70 cm	MR
	Basement	N.A.	N.A.	N.A.
	c. Protection of exits			
	Fire check door	N.A.	N.A.	N.A.
	Pressurization	N.A.	N.A.	N.A.
	e. No. of continuous staircases to terrace	N.A.	N.A.	N.A.
	g. Width of Corridor	1.5 m	1.5 m	MR
	h. Door Size	1 m	1 m	MR
3	Compartmentation			
	Fire check door	N.A.	N.A.	N.A.
	Sealing of electrical shafts	N.A.	N.A.	N.A.
	Fire rating of shaft door	N.A.	N.A.	N.A.
	Water curtain	N.A.	N.A.	N.A.
	Fire Dampers	N.A.	N.A.	N.A.
4	Smoke Management System.			
	Basement	N.A.	N.A.	N.A.
	Upper floor	N.A.	N.A.	N.A.

5.	Fire Extinguisher			
	Total numbers	04 no.	08 no.	MR
	types	CO ₂ & ABC	CO ₂ & ABC	MR
	IS marking	ISI marked	ISI marked	MR
6	First-aid-Hose Reels.			
	Total numbers of each floor	01 no.	01 no.	MR
	Length of hose reel hose	30 m	30 m	MR
	Nozzle diameter	5 mm	5 mm	MR
7	Automatic fire detection and alarming system.			
	Type of detectors	N.A.	N.A.	N.A.
	Location of main panel	N.A.	N.A.	N.A.
	Location of repeater panel	N.A.	N.A.	N.A.
	Alternate source of power	N.A.	N.A.	N.A.
	Hooters's location	N.A.	N.A.	N.A.
8	MOEFA	N.A.	NA	NA
9	Public address System.	N.A.	Provided	MR
10	Automatic Sprinkler System.			
	Basement	N.A.	N.A.	N.A.
	upper floor	N.A.	N.A.	N.A.
	sprinkler above false ceiling	N.A.	N.A.	N.A.
11	Internal Hydrants			
	size of riser/down-comer	N.A.	N.A.	N.A.
	Number of hydrants per floor	N.A.	N.A.	N.A.
	Hose Box	N.A.	N.A.	N.A.
12	Yard Hydrants.			
	Total number of hydrants	N.A.	N.A.	N.A.
	Hose Box	N.A.	N.A.	N.A.
13	Pumping Arrangements.			
	• Ground Level	N.A.	N.A.	N.A.
	➤ Discharge of main Pump	N.A.	N.A.	N.A.
	➤ Head of Main Pump	N.A.	N.A.	N.A.
	➤ Number of main pumps	N.A.	N.A.	N.A.
	➤ Jockey pump out put	N.A.	N.A.	N.A.
	➤ Jockey pump head	N.A.	N.A.	N.A.
	➤ Standby pump out put	N.A.	N.A.	N.A.
	➤ Standby pump Head	N.A.	N.A.	N.A.
	➤ Auto Starting /Manual stopping	N.A.	N.A.	N.A.
	➤ Pump House Access	N.A.	N.A.	N.A.
	• Terrace Level			
	➤ Discharge of pump	220 LPM	450 LPM	MR
	➤ Head of the Pump	40 m	40 m	MR
	➤ Power supply	Required	Provided	MR
	➤ Auto Starting of pump	Required	Provided	MR

14	Captive Water Storage for Fire Fighting.			
	Underground tank capacity	N.A.	N.A.	N.A.
	Draw-off connection	N.A.	N.A.	N.A.
	Fire service inlet	N.A.	N.A.	N.A.
	Access to tank	N.A.	N.A.	N.A.
	Overhead Tank capacity	2,500 Liters	5,000 Liters	MR
15	Exit Signage.	N/A	Provided	MR
16	Provision of Lifts.			
	Pressurization of Lift Shaft	N.A.	N.A.	N.A.
	Pressurization of Lift lobby	N.A.	N.A.	N.A.
	Communication in lift car	N.A.	N.A.	N.A.
	Firemen's grounding switch	N.A.	N.A.	N.A.
	Lift Signage	N.A.	N.A.	N.A.
17	Standby power supply	N.A.	N.A.	N.A.
18	Refuge Area.			
	Total area	N.A.	N.A.	N.A.
	Location	N.A.	N.A.	N.A.
19	Fire Control Room			
	Detector system panel	N.A.	N.A.	N.A.
	Flow switch panel	N.A.	N.A.	N.A.
	PA system panel	N.A.	N.A.	N.A.
	Batter backup	N.A.	N.A.	N.A.
	Building Floor Plans	N.A.	N.A.	N.A.
20	Special Fire Protection systems for protection of special Risks, if any:	N.A.	N.A.	N.A.

The fire protection systems provided in the building were tested/ checked and found functional at the time of inspection.

In view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules. The NOC issued vide letter no.F.6/DFS/MS/2006/1519 dated 07/07/2006 renewal under the circular no.262-362 dated 17.01.2005 is recommended for fire safety certificate.


 Signature of the Inspecting Officer
 Name:-R.K.Yadav
 Designation:-ADO (LN)

DO(ED)

Submitted for approval please.

Mugh