

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CANNAUGHT PLACE
NEW DELHI- 110 001

No. FG/DFS/MS/School/2016/ND2/207

Dated : 04/02/16

FIRE SAFETY CERTIFICATE

Certified that the EDMC Primary Adrash Girls School at Block-28, Trilok Puri, Delhi-91, owned/occupied by EDMC Primary School is comprised of ground plus one upper floor was issued Fire Safety Certificate vide letter no.F6/DFS/MS/School/2012/3311 dated 11.09.2012.The school building was inspected by the officer concerned of this department on 20.01.16 the presence of Smt. Kamlesh Kumari, Principal of the school and found that the building have deemed complied with the fire prevention and fire safety requirements in accordance with the circular no. F.16/Estate/CC/Fire safety/2011/3298 to 3398 dated 01.03.11 issued by the Director of Education and found that the GF+FF of building is fit for occupancy class 'B' Educational Building' with effect from04/02/16. for a period of **three** years, subject to conditions printed overleaf.

Issued on.....04/02/16.....at New Delhi by


(Dr.G.C.Misra)
Chief Fire Officer
Ph.011-23414333

To,
The Principal
M.C.Primary Adrash Girls School
Block-28,Trilok Puri , Delhi-91

Copy to:-

1. The Director of Education
MCD,Nigam Bhawan,
Kashmiri Gate,Delhi.
2. The Principal
M.C.Primary Adrash Boys School
Block-28, Trilok Puri, Delhi-91

9/02/16

CONDITIONS :

1. All the means of escape shall be kept free of all type of obstruction all the time.
2. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
3. All the fire fighting equipments shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
4. Any deviation, with regards to construction, ventilation, occupancy, electric installation etc. may be got verified from the concerned authorities.
5. This Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction unauthorized use of land if any.
6. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in

1. Name & address of the building :EDMC Primary Adrash School at Block-28, Trilok Puri, Delhi-91.
2. Building is comprised of : G+1
3. Type of Occupancy : Educational
4. Type of Case : Renewal
5. Details of Previous FSC : F6/DFS/MS/School/2012/3311 dated 11.09.2012
6. Fire Safety direction letter No : F.16/Estate/CC/Fire safety/2011/3298 to 3398 dated 01.03.11
7. Date of Inspection : 20.01.2016
8. Name of the Inspecting Officers : R.K. Yadav (ADO)
9. Name of the designation of Officer from the building side : Mrs. Kamlesh Kumari (Principal)
10. Year of Construction : 1993 (A-Block) & 2010 (B-Block)
11. Applicant's letter No : letter no. Nil dated 08.07.2015

S.No	Minimum Standards on fire safety requirements as per circular no. 3298 to 3398 Dated. 01.03.11	Requirement	Provided at Site	Remarks MR/NMR
1	Access to building			
	Road width	6 m	6 m	MR
	Gate width	N.A	N.A	N.A
	Width of internal road	N.A	N.A	N.A
2	Number, Width, Type and Arrangement of Exits			
	a. Number of Staircases			
	Upper Floor	2no.	3 no.	MR
	Basement	N.A	N.A	N.A
	B. Width of Staircases			
	Upper Floor	1.5 m	1.5 m (2 Nos.) & 1.40 m (1 No.)	MR
	Basement			
	c. Protection of exits			
	Fire check door	N.A	N.A	N.A
	Pressurization	N.A	N.A	N.A
	d. No. of continuous staircases to terrace	N.A	N.A	N.A
e. Width of Corridor	02 no.	02 no.	MR	
f. Door Size	1.5 m	1.5 m	MR	
		1 m	1.5 m	MR
3	Compartmentation.			
	Fire check door	N.A	N.A	N.A
	Sealing of electrical shafts	N.A	N.A	N.A
	Fire rating of shaft door	N.A	N.A	N.A
	Water curtain	N.A	N.A	N.A
	Fire Dampers	N.A	N.A	N.A
4	Smoke Management System.			
	Basement	N.A	N.A	N.A
	Upper floor	N.A	N.A	N.A
5.	Fire Extinguisher			
	Total numbers	08 nos.	8 nos.	MR


6	First-aid-Hose Reels.			
	Total numbers of each floor	N.A	N.A	N.A
	Length of hose reel hose	N.A	N.A	N.A
	Nozzle diameter	N.A	N.A	N.A
7	Automatic fire detection and alarming system.			
	Type of detectors	N.A	N.A	N.A
	Location of main panel	N.A	N.A	N.A
	Location of repeater panel	N.A	N.A	N.A
	Alternate source of power	N.A	N.A	N.A
	Hooters	N.A	N.A.	N.A.
8	MOEFA	N.A	N.A	N.A
9	Public address System.	N.A	N.A	N.A
10	Automatic Sprinkler System.			
	basement	N.A	N.A	N.A
	upper floor	N.A	N.A	N.A
	sprinkler above false ceiling	N.A	N.A	N.A
11	Internal Hydrants			
	size of riser/down-comer	N.A	N.A	N.A
	Number of hydrants per floor	N.A	N.A	N.A
	Hose Box	N.A	N.A	N.A
12	Yard Hydrants.			
	Total number of hydrants	N.A	N.A	N.A
	Hose Box	N.A	N.A	N.A
13	Pumping Arrangements.			
	Ground Level	N.A	N.A	N.A
	Discharge of main Pump	N.A	N.A	N.A
	Head of Main Pump	N.A	N.A	N.A
	Number of main pumps	N.A	N.A	N.A
	Jockey pump out put	N.A	N.A	N.A
	Jockey pump head	N.A	N.A	N.A
	Standby pump out put	N.A	N.A	N.A
	Standby pump Head	N.A	N.A	N.A
	Auto Starting /Manual stopping	N.A	N.A	N.A
	Pump House Access	N.A	N.A	N.A
	Terrace Level	N.A	N.A	N.A
	Discharge of pump	N.A	N.A	N.A
	Head of the Pump	N.A	N.A	N.A
	Power supply	N.A	N.A	N.A
	tarting of pump	N.A	N.A	N.A
14	Captive Water Storage for Fire Fighting.			
	Underground tank capacity	N.A	N.A	N.A
	Draw-off connection	N.A	N.A	N.A
	Fire service inlet	N.A	N.A	N.A
	Access to tank	N.A	N.A	N.A
	Overhead Tank capacity	N.A	N.A	N.A
15	Exit Signage.	N.A	N.A	N.A

16	Provision of Lifts.			
	Pressurization of Lift Shaft	N.A	N.A	N.A
	Pressurization of Lift lobby	N.A	N.A	N.A
	Communication in lift car	N.A	N.A	N.A
	Firemen's grounding switch	N.A	N.A	N.A
	Lift Signage	N.A	N.A	N.A
17	Standby power supply	N.A	N.A	N.A
18	Refuge Area.			
	Total area	N.A	N.A	N.A
	Location	N.A	N.A	N.A
19	Fire Control Room			
	Detector system panel	N.A	N.A	N.A
	Flow switch panel	N.A	N.A	N.A
	PA system panel	N.A	N.A	N.A
	Batter backup	N.A	N.A	N.A
	Building Floor Plans	N.A	N.A	N.A
20	Special Fire Protection systems for protection of special Risks, if any:	N.A	N.A	N.A


The fire protection systems provided in the building were tested/checked and found functional at the time of inspection.

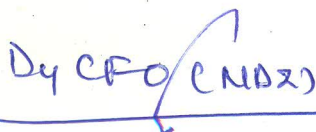
In view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules. The FSC issued vide letter no. F6/DFS/MS/School/2012/3311 dated 11.09.2012 renewal under the circular no. F.16/Estate/CC/Fire safety/2011/3298 to 3398 dated 01.03.11 is recommended.

DO(ED)


 Signature of the Inspecting Officer ^{22/11/2016}
 Name- R.K. Yadav
 Designation- ADO(LN)

Submitted for approval please.


 27/11/16


 Dy CPO (NDRS)

