


No. F6/DFS/MS/GH/2016/SZ/322

Dated: 01/03/16

**FIRE SAFETY CERTIFICATE**

Certified that M/S "The Grand Hotel" Guest house located at C-2/12, Safdarjung Development Area, Hauz Khas, New Delhi-110029, comprised of basement (Storage only), Ground floor reception, kitchen & owner's Residence, 1<sup>st</sup> floor to 3<sup>rd</sup> floor 6 guest rooms on each floor). Total 18 guest rooms, was granted FSC by this department vide letter No. F6/DFS/MS/2014/SZ/1653, dated 26-12-2014. The premises was re-inspected by the officer concerned of this department on 11-02-2016 in the presence of Sh. Bhupinder Singh, Owner and found that the said guest house building have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the premises is fit for occupancy class Residential (Guest House) with effect from 01/03/2016 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 01/03/2016 at New Delhi by.

  
113  
Dr. G.C. Misra  
Chief Fire Officer  
Delhi Fire Service  
Tele. No. - 23414333



- Copy to:-
1. The Joint. Commissioner of Police (Lic.), First Floor, P.S. Defence Colony , New Delhi-110049.
  2. M/S The Grand Hotel located at C-2/12, Safdarjung Development Area, Hauz Khas, New Delhi-110029.

**Conditions for the validity of fire safety certificate are overleaf:-**

1. All the means of escape shall be kept free of all type of obstruction all the time.
2. All the employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
3. All the fire fighting equipments shall be maintained in perfect working condition all the time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
4. Any deviation, with regards to construction, ventilation, occupancy, electric installation etc. may be got verified from the concerned authorities.
5. This Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction unauthorized use of land if any.
6. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).
7. The owner/occupier shall apply for renewal of this Fire Safety Certificate on form J, six month prior to its expiry.

INSPECTION REPORT

1. Name & address of the building : M/S The Grand Hotel, located at C-2/12, Safdarjung Development Area, Hauz Khas, New Delhi-110016.
2. Building is comprised of : B+G+3, (Basement storage, Ground floor reception, kitchen & owner's Residence, 1<sup>st</sup> floor to 3<sup>rd</sup> floor 6 guest rooms on each).  
Total 18 guest rooms.
3. Type of Occupancy : Lodging House
4. Type of Case : Old Case but now change of name and nos. of guest rooms.
5. Details of Previous NOC : No.F6/DFS/MS/2014/SZ/1653, dated-26.12.2014.
6. Fire Safety direction letter No : Nil.
7. Date of Inspection : 11.02.2016.
8. Name of the Inspecting Officers: : Vedpal (ADO)
9. Name and designation of officer from the building side : Sh. Bhupinder Singh (Owner)
10. Year of Construction : Prior to 1983.
11. Applicant's letter No. : No.156-61/Join C.P./Lic.(H), dated 29.01.2016.

S.N	Minimum Standards on fire prevention and fire safety U/R33	Old NOC Requirements	Provided at Site	Remarks
1	Access to building			
	Road width	12m	12 m	MR
	Gate width	N.A.	N.A.	N.A.
	Width of internal road	N.A.	N.A.	N.A.
2	Number, Width, Type and Arrangement of Exits.			
	a. Number of Staircases			
	Upper Floor	02nos.	02nos.	MR
	Basement	02nos.	02nos.	MR
	B. Width of Staircases			
	Upper Floor	103cm & 80cm	103cm & 80cm	MR
	Basement	105cm & 80cm	103cm & 80cm	MR
	c. Protection of exits			
	Fire check door	N.A.	N.A.	N.A.
	Pressurization	N.A.	N.A. (Staircases are Segregated at ground Floor.)	N.A.
	e. No. of continuous staircases to terrace.	1no.	2nos.	MR
g. Width of Corridor	N.A.	N.A.	N.A.	
h. Door Size	1m	1m	MR	
3	Compartmentation			
	Fire check door	N.A.	N.A.	N.A.
	Sealing of electrical shafts	N.A.	N.A.	N.A.
	Fire rating of shaft door	N.A.	N.A.	N.A.
	Water curtain	N.A.	N.A.	N.A.
	Fire Dampers	N.A.	N.A.	N.A.
4	Smoke Management System.			
	Basement	30a/c per hour	Provided exhaust fans	MR
	Upper floor	12 a/c per hour	N.A.	N.A.
5.	Fire Extinguisher			
	Total numbers	10 nos.	10 nos.	MR
	types	WCO <sub>2</sub> & ABC	WCO <sub>2</sub> & ABC	MR
	IS marking	ISI marked	ISI marked	MR
6	First-aid-Hose Reels.			
	Total numbers of each floor	01no.	01no.	MR
	Length of hose reel hose	30 m	30m	MR
	Nozzle diameter	5mm	5mm	MR

8	MOEFA	N.A.	N.A.	N.A.
9	Public address System.	N.A.	N.A.	N.A.
10	Automatic Sprinkler System.			
	Basement	Required	Provided	MR
	upper floor	N.A.	N.A.	N.A.
	sprinkler above false ceiling	N.A.	N.A.	N.A.
11	Internal Hydrants			
	size of riser/down-comer	N.A.	N.A.	N.A.
	Number of hydrants per floor	N.A.	N.A.	N.A.
	Hose Box	N.A.	N.A.	N.A.
12	Yard Hydrants.			
	Total number of hydrants	N.A.	N.A.	N.A.
	Hose Box	N.A.	N.A.	N.A.
13	Pumping Arrangements.			
	• Ground Level	N.A.	N.A.	N.A.
	➤ Discharge of main Pump	N.A.	N.A.	N.A.
	➤ Head of Main Pump	N.A.	N.A.	N.A.
	➤ Number of main pumps	N.A.	N.A.	N.A.
	➤ Jockey pump out put	N.A.	N.A.	N.A.
	➤ Jockey pump head	N.A.	N.A.	N.A.
	➤ Standby pump out put	N.A.	N.A.	N.A.
	➤ Standby pump Head	N.A.	N.A.	N.A.
	➤ Auto Starting /Manual stopping	N.A.	N.A.	N.A.
	➤ Pump House Access	N.A.	N.A.	N.A.
	• Terrace Level	Required	Provided	MR
	➤ Discharge of pump	900 LPM	900LPM	MR
	➤ Head of the Pump	40 Mtrs.	40Mtrs.	MR
	➤ Power supply	Required	Provided	MR
	➤ Auto Starting of pump	Required	Provided	MR
14	Captive Water Storage for Fire Fighting.			
	Underground tank capacity	N.A.	N.A.	N.A.
	Draw-off connection	N.A.	N.A.	N.A.
	Fire service inlet	N.A.	N.A.	N.A.
	Access to tank	N.A.	N.A.	N.A.
	Overhead Tank capacity	10000Ltrs.	10000Ltrs.	MR
15	Exit Signage.	Required	Provided	MR
16	Provision of Lifts.			
	Pressurization of Lift Shaft	N.A.	N.A.	N.A.
	Pressurization of Lift lobby	N.A.	N.A.	N.A.
	Communication in lift car	N.A.	N.A.	N.A.
	Firemen's grounding switch	N.A.	N.A.	N.A.
	Lift Signage	N.A.	N.A.	N.A.
17	Standby power supply	Required	D.G. Set	MR
18	Refuge Area.			
	Total area	N.A.	N.A.	N.A.
	Location	N.A.	N.A.	N.A.
19	Fire Control Room			
	Detector system panel	N.A.	N.A.	N.A.
	Flow switch panel	N.A.	N.A.	N.A.
	PA system panel	N.A.	N.A.	N.A.
	Batter backup	N.A.	N.A.	N.A.
	Building Floor Plans	N.A.	N.A.	N.A.


N/35

M/S The Grand Hotel located at C-2/12, Safdarjung Development , Area, Hauz Khas , New Delhi.

20	Special Fire Protection systems for of special Risks, if any:	N.A.	N.A.	N.A.
----	---	------	------	------

The fire protection systems provided in the building were test checked at random and found functional at the time of inspection. In view of the deemed compliance of the minimum standards on fire prevention and fire safety required under the rules, the FSC issued vide letter No: F6/DFS/MS/2014/SZ/1653, dated 26.12.2014, renewal under rule 35 of the Delhi Fire Service Rule 2010 is recommended.

Accordingly DFA is put up please.

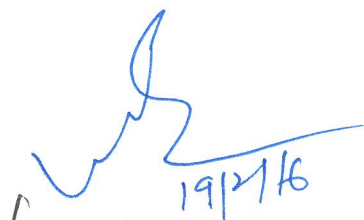
  
16/2/16

Signature of the Inspecting Officer

Name Vedpal

Designation ADO

D.O. (South)

  
19/2/16