

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001**

E-mail: [gargatul@hotmail.com](mailto:gargatul@hotmail.com), Tel:- 011-26189168

No. F6/DFS/MS/School/2016/ 52/795

Dated: 17/5/16

**FIRE SAFETY CERTIFICATE**

Certified that **Bal Vidya Niketan located at B-96, Gali No.-04, Sindhu Farm Road, Meethapur, New Delhi-44** comprised of ground plus one upper floor was granted Fire Safety Certificate by this department vide letter No. F.6/DFS/MS/2006/1791 dated 28-07-2006. The school building was re-inspected by the officer concerned of this department on 07/05/2016 in presence of Ms. Sushma, Principal of the school and found that the said School building have deemed complied with the fire prevention and fire safety requirements in accordance with the Directorate of Education circular No. 262-362 dated 17-01-2005 and that the school building is fit for occupancy class "Educational" with effect from the date of issue of this certificate for a period of three years, subject to compliance of the under mentioned conditions.

Issued on 17/5/16 at New Delhi by.

(ATUL GARG)

Dy. CHIEF FIRE OFFICER

Copy to: -

1. The Manager, Bal Vidya Niketan, B-96, Gali No.-04, Sindhu Farm Road, Meethapur, New Delhi-44
2. The Directorate of Education, Old Secretariat, GNCT of Delhi, NewDelhi-110006.

**Conditions for the validity of Fire Safety Certificate**

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non-functional fire safety measures shall be at the risk & responsibility of the management.
3. The trained staff should be available round the clock.
4. Any deviation w.r.t. construction shall be verified by the concerned building sanctioning agency.
5. The certificate may not be treated in any case for regularization of unauthorized construction, if any.
6. The owner/occupier shall submit a declaration every year in form 'K' Provided in the first schedule of Delhi Fire Service Rules 2010, form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)

## INSPECTION REPORT

1. Name & address of the building : Bal Vidya Niketan, B-96, Gali No.-04, Sindhu Farm Road, Meethapur, New Delhi-44
1. Type of Occupancy : Educational
2. Type of Case : renewal
3. Details of previous NOC : F.6/DFS/MS/2006/1791 dated 28-07-2006
4. Fire Safety directives letter No : Directorate of Education circular No. 262-362 dated 17-01-2005
5. Date of inspection : 07.05.2016
6. Name of the Inspecting Officers : M.K.Chattopadhyay, ADO(M.Rd)
7. Name and designation of officers from the building side : Ms. Sushma, Principal
9. Year of Construction : 2005
10. Applicant's letter No. : BVN/01/2016-17 date 28-04-2016.

Bal Vidya Niketan is comprised of ground plus one upper floor.

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	NBC Requirement	Provided at site	Remarks MR/NMR
1	<b>Access to building</b>			
	• Road width	06 mts	Provided	MR
	• Gate width	4.5 mts	Provided	MR
	• Width of internal road	N/A	N/A	N/A
2	<b>Number, Width, Type &amp; Arrangement of Exits</b>			
	a. Number of staircases	-----	-----	-----
	• Upper Floors	02	provided	MR
	• Basements	N/A	N/A	N/A
	b. Width of staircases	-----	-----	-----
	• Upper Floors	1.5 mts or less & 0.75 mt	Provided (1.10, 0.90 mt.)	MR
	• Basements	N/A	N/A	N/A
	c. Protection of exits	-----	-----	-----
	• Fire check door	N/A	N/A	N/A
	• Pressurization	N/A	N/A	N/A
	e. No. of continuous staircases to terrace	01	Provided (01)	MR
	g. Width of Corridor	N/A	N/A	N/A
	h. Door Size	1.0 mts	Provided	MR
3	<b>Compartmentation.</b>			
	• Fire check door	N/A	N/A	N/A
	• Sealing of electrical shafts	N/A	N/A	N/A
	• Fire Rating of shaft door	N/A	N/A	N/A
	• Water Curtain	N/A	N/A	N/A
	• Fire Dampers	N/A	N/A	N/A
4	<b>Smoke Management System.</b>			
	• Basements	30 a/c per hour	N/A	N/A

	<ul style="list-style-type: none"> <li>Upper floors</li> </ul>	12 a/c per hour	N/A	N/A
5	<b>Fire Extinguishers</b>			
	<ul style="list-style-type: none"> <li>Total numbers</li> <li>Types</li> <li>IS marking</li> </ul>	12 nos. ABC, CO <sub>2</sub> type ISI marked	Provided Provided Provided	MR MR MR
6	<b>First-Aid Hose Reels.</b>			
	<ul style="list-style-type: none"> <li>Total numbers on each floor</li> <li>Length of hose reel hose</li> <li>Nozzle diameter</li> </ul>	01 30 m 5 mm	Provided Provided Provided	MR MR MR
7	<b>Automatic fire detection and alarming system</b> <span style="float: right;"><b>Not Required</b></span>			
	<ul style="list-style-type: none"> <li>Type of detectors</li> <li>Location of Main Panel</li> <li>Location of Repeater Panel</li> <li>Alternate source of power</li> <li>Hooters' Location</li> </ul>	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A
8	<b>MOEFA</b>	N/A	N/A	N/A
9	<b>Public Address System.</b>	N/A	N/A	N/A
10	<b>Automatic Sprinkler System</b>			
	<ul style="list-style-type: none"> <li>Basement</li> <li>Upper Floor</li> <li>Sprinkler above false ceiling</li> </ul>	N/A N/A N/A	N/A N/A N/A	N/A N/A N/A
11	<b>Internal Hydrants</b>			
	<ul style="list-style-type: none"> <li>Size of riser/down-comer</li> <li>Number of hydrants per floor</li> <li>Hose Box</li> </ul>	N/A N/A N/A	N/A N/A N/A	N/A N/A N/A
12	<b>Yard Hydrants.</b>			
	<ul style="list-style-type: none"> <li>Total number of hydrants</li> <li>Hose Box</li> </ul>	N/A N/A	N/A N/A	N/A N/A
13	<b>Pumping Arrangements</b>			
	<ul style="list-style-type: none"> <li>Ground Level</li> <li>➤ Discharge of main Pump</li> <li>➤ Head of Main pump</li> <li>➤ Number of main pumps</li> <li>➤ Jockey Pump out put</li> <li>➤ Jockey pump head</li> <li>➤ Standby Pump out put</li> </ul>	--- N/A N/A N/A N/A N/A N/A	----- N/A N/A N/A N/A N/A N/A	----- N/A N/A N/A N/A N/A N/A


	<ul style="list-style-type: none"> <li>➤ Standby Pump Head</li> <li>➤ Auto Starting/ Manual stopping</li> <li>➤ Pump House Access</li> <li>• Terrace level <ul style="list-style-type: none"> <li>➤ Discharge of pump</li> <li>➤ Head of the pump</li> <li>➤ Power Supply</li> <li>➤ Auto Starting of pump</li> </ul> </li> </ul>	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		----	-----	-----
		225 LPM	Provided	MR
		30 mts	Provided	MR
		N/A	N/A	N/A
		Required	Provided	MR
14	<b>Captive Water Storage for fire fighting</b>			
	<ul style="list-style-type: none"> <li>• Underground tank capacity</li> <li>➤ Draw-off connection</li> <li>➤ Fire service inlet</li> <li>➤ Access to tank</li> <li>• Overhead Tank capacity</li> </ul>	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		2500 lts	4000 lts Provided	MR
15	<b>Exit Signage.</b>	Required	Provided	MR
16	<b>Provision of Lifts. Not Applicable</b>			
	<ul style="list-style-type: none"> <li>• Pressurization of Lift Shaft</li> <li>• Pressurization of Lift lobby</li> <li>• Communication In lift Car</li> <li>• Fireman's Grounding Switch</li> <li>• Lift Signage</li> </ul>	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
17	<b>Standby power supply</b>	N/A	N/A	N/A
18	<b>Refuge Area.</b>			
	<ul style="list-style-type: none"> <li>➤ Total Area</li> <li>➤ Location</li> </ul>	N/A	N/A	N/A
		N/A	N/A	N/A
19	<b>Fire Control Room</b>			
	<ul style="list-style-type: none"> <li>• Detector System Panel</li> <li>• Flow Switch Panel</li> <li>• PA System Panel</li> <li>• Batter backup</li> <li>• Building Floor Plans</li> </ul>	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
20	Special Fire Protection Systems for Protection of special Risks, if any:	Required	01 ABC type fire extinguisher is provided near elect. Panel.	MR

Handwritten signature

The fire protection systems provided in the building were tested / checked and found functional at the time of inspection.

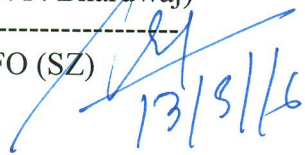
In view the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under the rules, the NOC issued vide letter No. F.6/DFS/MS/2006/1791 dated 28-07-2006, renewal under the Directorate of Education circular No. 262-362 dated 17-01-2005 is recommended.

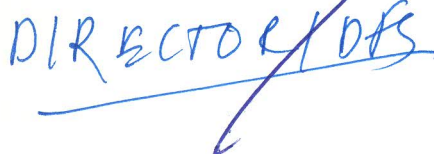
DFA is put up for approval & signature please

  
11/5/16

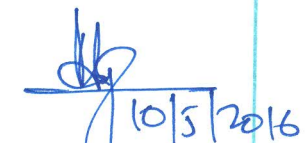
DCFO (D. P. Bhardwaj)

-----  
DCFO (SZ)

  
13/5/16

  
DIRECTOR/DFS

  
13/5

  
10/5/2016

Signature of the Inspecting Officer  
(M.K. CHATTOPADHYAY)

Assistant Divisional Officer (MRD)