

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CANNAUGHT PLACE**

NEW DELHI- 110 001

No. F6/dfs/ms/school/2016/82/821

Dated: 19/05/16

FIRE SAFETY CERTIFICATE

Certified that M/S Veer Public School, located at Village Kapashera, New Delhi-110097, comprised of ground plus three upper floors owned/occupied by Veer Public School, complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and verified by the officer concerned of this department on dated 17.05.16 in the presence of Mr. Rajveer Singh, Manager of the school and found that the school building is fit for occupancy class B 'Educational Building' with effect from 19/05/2016 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of Delhi Fire Service Rules, 2010.

Issued on 19/05/2016 at New Delhi by



(Atul Garg)

Dy. Chief Fire Officer

T.No.011-26189168



To,

1. The Principal, Veer Public School, located at Village Kapashera, New Delhi-110097.
2. The Director of Education, Old Secretariat, Civil Lines, Delhi-52.

Conditions for the validity of fire safety certificate are as under :-

1. All the means of escape shall be kept free of all type of obstruction all the time.
2. The employees shall be acquainted with the use and maintenance of all fire equipments and method of smooth and speedy safe evacuation of occupants in case of emergency.
3. All fire fighting equipments shall be maintained in perfect working condition all time and any lapse rendering non-functional of fire safety measures, management shall be responsible.
4. Any deviation, with regards to construction, ventilation, occupancy, electric installation etc. may be got verified from the concerned authorities.
5. This Fire Safety Certificate may not be treated in any case for regularizations of unauthorized construction unauthorized use of land if any.
6. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rule 2010. The form is available on www.dfs.delhigovt.nic.in.
7. The owner/occupier shall apply for renewal of this Fire Safety Certificate in form J, six month prior to its expiry.

INSPECTION REPORT

1	Name & address of the building	M/S Veer Public School, located at Village Kapashera, New Delhi-110097.
2	Type of Occupancy	Educational Building "B"
3	Type of case	Renewal/New Case (Initially the school building was ground plus two upper floors and now it is ground plus three upper floors).
4	Details of previous NOC	No.F6/DFS/MS/09/1169, Dated 30.04.09.
5	Fire safety directives letter No	Nil
6	Date of inspection	17.05.2016.
7	Name of the inspecting Officers	A.D.O. Vedpal.
8	Name and designation of officers from the building side	Sh. Rajveer Singh, Manager of the school.
9	Building Comprised of	Ground plus three upper floors.
9	Year of construction	2005
10	Applicant's letter No.	No.VPS/May/2016, Dated 05.05.2016.

S. NO.	Minimum Standards on fire prevention and fire safety U/R 33	Requirement	Provided at site	Remarks MR / NMR
1	Access to building			
	1) Road width	6m	12m	MR
	2) Gate width	5m	5m	MR
	3) Width of internal road	N/A		N/A
2	Number, width Type & arrangement of exits			
	a. Number of staircases			
	1. Upper floors	02nos.	02nos.	MR
	2. Basements	N/A	N/A	N/A
	b. Width of staircase			
	1. Upper floors	1.5m/90cm	1.4 & 1.4m	MR
	2. basements	N/A	N/A	N/A
	c. Protection of exits			
	1. Fire check door	N/A	N/A	N/A
	2. Pressurization	N/A	N/A	N/A
	d. No. of continuous staircase to terrace	01no.	01no.	MR
	e. Width of corridor	N/A	N/A	N/A
	f. Door size	1 Mtr	Provided	MR
3	Compartmentation.			
	1. Fire check door	N/A	N/A	N/A
	2. Sealing of electrical shafts	N/A	N/A	N/A
	3. Fire Rating of shaft door	N/A	N/A	N/A
	4. water curtain	N/A	N/A	N/A
	5. Fire dampers	N/A	N/A	N/A
4	Smoke Management system.			
	basement	30 a/c per hour	N/A	MR
	upper floors	12 a/c per hour	N/A	N/A
5	Fire Extinguishers			
	total numbers	16nos.	20nos.	MR
	Types		ABC Type	MR
	ISI marking		ISI Mark	MR
6	First-Aid Hose Reels.			
	Total numbers on each floor	01no.	01no.	MR
	Length of Hose reel hose	30 m	30m	MR
	Nozzle Diameter	5 mm	5mm	MR
7	Automatic fire detection and alarming system			
	Type of detectors in audi only	N/A	N/A	N/A
	location of Main Panel	N/A	N/A	N/A
	location of Repeater panel	N/A	N/A	N/A

4	Details of previous NOC	NO. F/DF/SHMS/05/1100, Dated 17.05.2016		
5	Fire safety directives letter No	Nil		
6	Date of inspection	17.05.2016.		
7	Name of the inspecting Officers	A. D. O. Vedpal.		
8	Name and designation of officers from the building side	Sh. Rajveer Singh, Manager of the school.		
9	Building Comprised of	Ground plus three upper floors.		
9	Year of construction	2005		
10	Applicant's letter No.	No.VPS/May/2016, Dated 05.05.2016.		

S. NO.	Minimum Standards on fire prevention and fire safety U/R 33	Requirement	Provided at site	Remarks MR / NMR
1	Access to building			
	1) Road width	6m	12m	MR
	2) Gate width	5m	5m	MR
	3) Width of internal road	N/A		N/A
2	Number, width Type & arrangement of exits			
	a. Number of staircases			
	1. Upper floors	02nos.	02nos.	MR
	2. Basements	N/A	N/A	N/A
	b. Width of staircase			
	1. Upper floors	1.5m/90cm	1.4 & 1.4m	MR
	2. basements	N/A	N/A	N/A
	c. Protection of exits			
	1. Fire check door	N/A	N/A	N/A
	2. Pressurization	N/A	N/A	N/A
	d. No. of continuous staircase to terrace	01no.	01no.	MR
	e. Width of corridor	N/A	N/A	N/A
	f. Door size	1 Mtr	Provided	MR
3	Compartmentation.			
	1. Fire check door	N/A	N/A	N/A
	2. Sealing of electrical shafts	N/A	N/A	N/A
	3. Fire Rating of shaft door	N/A	N/A	N/A
	4. water curtain	N/A	N/A	N/A
	5. Fire dampers	N/A	N/A	N/A
4	Smoke Management system.			
	basement	30 a/c per hour	N/A	MR
	upper floors	12 a/c per hour	N/A	N/A
5	Fire Extinguishers			
	total numbers	16nos.	20nos.	MR
	Types		ABC Type	MR
	ISI marking		ISI Mark	MR
6	First-Aid Hose Reels.			
	Total numbers on each floor	01no.	01no.	MR
	Length of Hose reel hose	30 m	30m	MR
	Nozzle Diameter	5 mm	5mm	MR
7	Automatic fire detection and alarming system			
	Type of detectors in audi only	N/A	N/A	N/A
	location of Main Panel	N/A	N/A	N/A
	location of Repeater panel	N/A	N/A	N/A
	Alternate source of power	N/A	N/A	N/A
	hooter's location	N/A	N/A	N/A

(Handwritten signature)

8	MOEFA	N/A	N/A	N/A
9	Public Address System.	N/A	N/A	N/A
10	Automatic Sprinkler System.			
	basement	N/A	N/A	N/A
	upper floors	N/A	N/A	N/A
	sprinkler above false ceiling	N/A	N/A	N/A
11	Internal Hydrants			
	Size of riser/down-corner	N/A	N/A	N/A
	Number of Hydrants per floor	N/A	N/A	N/A
	hose Box	N/A	N/A	N/A
12	Yard Hydrants.			
	total number of hydrants	N/A	N/A	N/A
	hose box	N/A	N/A	N/A
13	Pumping arrangements			
	1. Ground level	N/A	N/A	N/A
	a. Discharge of main Pump	N/A	N/A	N/A
	b. Head of main pump	N/A	N/A	N/A
	c. Number of main pumps	N/A	N/A	N/A
	d. jockey pump out put	N/A	N/A	N/A
	e. jockey pump head	N/A	N/A	N/A
	f. Standby Pump output	N/A	N/A	N/A
	g. Stanby Pump head	N/A	N/A	N/A
	h. Auto Starting/Manual stopping	N/A	N/A	N/A
	pump house access	N/A	N/A	N/A
	2. Terrace level			
	a. Discharge of pump	450LPM	450LPM	MR
	b. head of the pump	40m	40m	MR
	c. Power supply	Required	Provided	MR
	d. Auto starting of pump	Required	Provided	MR
14	Captive water storage for fire fighting			
	1. Underground tank capacity	N/A	N/A	N/A
	a. Draw-off connection	N/A	N/A	N/A
	b. fire service inlet	N/A	N/A	N/A
	c. Access to tank	N/A	N/A	N/A
	Over head tank Capacity	10000 Ltr.	10000 Ltr.	MR
15	Exit Signage.	Required	Provided	MR
16	Provision of lifts.			
	a. Pressurization of lift shaft	N/A	N/A	N/A
	b. pressurization of lift lobby	N/A	N/A	N/A
	c. communication in lift car	N/A	N/A	N/A
	d. Fireman's grounding switch	N/A	N/A	N/A
	e. Lift signage	N/A	N/A	N/A
17	Standby power supply	N/A	N/A	N/A
18	Refuge Area.	Not Required		
	total area	N/A	N/A	N/A
	location	N/A	N/A	N/A
19	Fire control room			
	a. detector system Panel	N/A	N/A	N/A
	b. Flow switch Panel	N/A	N/A	N/A
	c. PA system Panel	N/A	N/A	N/A
	d. Batter backup	N/A	N/A	N/A
	e. Building floor plans	N/A	N/A	N/A
20	Special Fire Protection systems for protection of special risks, if any: N/A			

N-4

The fire protection systems provided in the building were test checked randomly and found functional at the time of inspection. Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules, it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules 2010.

Accordingly DFA is put up for your approval and signature please.




17/5/16

Signature of the inspecting officer

Name: Vedpal

Designation : ADO

Dy CPO D.P.B

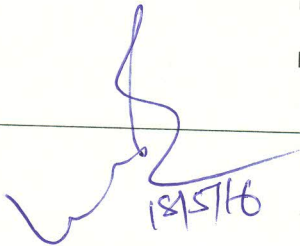

18/5/16