

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001

No.F.6/DFS/MS/School/2016 /1012

Dated: 10/6 /2016

FIRE SAFETY CERTIFICATE

Certified that the Blooming Dales Public School(Code-65618) at Rajendra Park, Rohtak Road, Nangloi, New Delhi-110041 comprised of Ground, Three Upper Floors owned / occupied by Blooming Dales Public School has already been issued Fire Safety Certificate Vide letter No: F6/MS/DFS/2006/2509 dated 14/09/2006. The premises was re-inspected by the officer concerned of Fire Service on 01.06.2016 in the presence of Sh. Braham Dev Dabas (Secretary) and observed that all the fire prevention and fire safety arrangements provided in the premises found in good working condition. The premises have therefore deemed complied with DOE Circular date 17/01/2005 and that the building / premises is fit for occupancy class Educational (Group-B) with effect from 10 / 6 /2016 for a period of three years in accordance with rule 36 unless renewal under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the DFS rules, 2010.

Issued on 10/6/16 **at New Delhi by.**



(SUNIL CHAUDHARY)
DY. CHIEF FIRE OFFICER,
Ph: 011-25156707.

Copy to :-

1. Principal, Blooming Dales Public School(Code-65618), Rajendra Park, Rohtak Road, Nangloi, New Delhi-110041.

Conditions for the validity of Fire Safety Certificate:

1. All the fire safety arrangement provided their in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction.
6. "The owner / Occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule37] along with a copy of this Certificate, six months prior to its expiry".
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on WWW.dfs.Delhigovt.nic.in

1. Name & address of the building: Blooming Dales Public School(Code-65618),
Rajendra Park, Rohtak Road, Nangloi, New Delhi-110041.
2. Type of Occupancy : Educational
3. Type of Case : Renewal ✓
4. Details of previous NOC : F6/MS/DFS/2006/2509 dated 14/09/2006
(G+ three upper floors only)
5. Fire Safety directives Letter No.: DOE Circular date 17/01/2005
6. Date of inspection : **01/06/2016**
7. Name of the Inspecting Officer : A. K. Jaiswal
8. Name and designation of Officer
from the building side : Sh. Braham Dev Dabas (Secretary)
9. Year of Construction : 2006
10. Applicant's letter No. : BDPS/P Dated 06/05/2016

S No	Minimum standards on fire prevention and fire safety U/R 33	DOE Circular date 17/01/2005 Requirements	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	Accessible	On main Rohtak Road	MR
	• Gate width	Accessible	4.5 mtr	MR
	• Width of internal road	NR	NR	NR
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	2	2	MR
	• Basements	N/A	N/A	N/A
	b. Width of staircases			
	• Upper floors	Old Case	1.30m, 1.10m	MR
	• Basements	N/A	N/A	N/A
	c. Protection of exits			
	• Fire check door	N/A	N/A	N/A
	• Pressurization	N/A	N/A	N/A
	d. No of continuous staircase to terrace	Old Case	1	MR
	e. Width Of Corridor	Old Case	1.50 Mtr.	MR
	f. Door Size	Old Case	1.00 Mtr.	MR
3.	Compartmentation			
	• Fire check door	N/A	N/A	N/A
	• Sealing of electrical shafts	N/A	N/A	N/A
	• Fire Rating of shaft door	N/A	N/A	N/A
	• Water Curtain	N/A	N/A	N/A
	• Fire Dampers			
4.	Smoke managements System			
	• Basements	N/A	N/A	N/A
	• Upper floors	N/A	N/A	N/A
5.	Fire Extinguishers			
	• Total numbers	8	10	MR
	• Types	ISI marked ABC/CO ₂	Provided	MR
		Required	Provided	M/R

6.	First – Aid Hose Reels			
	• Total numbers on each floor	1	Provided	MR
	• Length of hose reel hose	30 Mtr.	Provided	MR
	• Nozzle diameter	5 mm	Provided	MR
7.	Automatic fire detection and alarming system			
	• Type of detector	N/A	N/A	N/A
	• Location of Main Panel	N/A	N/A	N/A
	• Location of Repeater Panel	N/A	N/A	N/A
	• Alternate source of power	N/A	N/A	N/A
	• Hooters' Location	N/A	N/A	N/A
8.	MOEFA (in basement)	N/A	N/A	N/A
9.	Public Address System	N/A	N/A	N/A
10.	Automatic Sprinkler System			
	• Basements	N/A	N/A	N/A
	• Upper Floor	N/A	N/A	N/A
	• Sprinkler above false ceiling	N/A	N/A	N/A
11.	Internal Hydrants			
	• Size of riser/down-comer	100mm	Provided (100mm)	MR
	• Number of hydrants per floor	1	Provided	MR
	• Hose Box	1	Provided	MR
12.	Yard Hydrants			
	• Total number of hydrants	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
13.	Pumping Arrangements			
	• Ground Level	N/A		
	• Discharge of main pump	N/A	N/A	
	➤ Head of main pump	N/A	N/A	N/A
	➤ Number of main pumps	N/A	N/A	N/A
	➤ Jockey pump out put	N/A	N/A	N/A
	➤ Jockey pump head	N/A	N/A	N/A
	➤ Standby Pump out put	N/A	N/A	N/A
	➤ Standby Pump Head	N/A	N/A	N/A
	➤ Auto Starting/Manual stopping	N/A	N/A	N/A
	➤ Pump House Access	N/A	N/A	N/A
	• Terrace level			
	➤ Discharge of pump	450 LPM & 180 LPM	Provided	MR
	➤ Head of the pump	40 Mtr.	Provided	MR
	➤ Power supply	Required	Provided	MR
	➤ Auto starting of pump	Required	Provided	MR
14.	Captive water Storage for fire fighting			
	• Underground tank capacity	N/A	N/A	N/A
	➤ Draw of connection	N/A	N/A	N/A
	➤ Fire service inlet	Required	Provided	MR
	➤ Access to tank	N/A	N/A	N/A

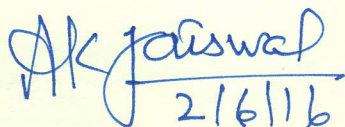
15	Exit Signage	Required	Provided	MR
16.	Provision of Lifts			
	➤ Pressurization of Lift Shaft	N/A	N/A	N/A
	➤ Pressurization of lift lobby	N/A	N/A	N/A
	➤ Communication in lift Car	N/A	N/A	N/A
	➤ Fireman's Grounding Switch	N/A	N/A	N/A
	➤ Lift Signage	N/A	N/A	N/A
17.	Standby power supply	N/A	N/A	N/A
18.	Refuge Area	N/A	N/A	
	➤ Total area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19.	Fire control room			
	➤ Detector system panel	N/A	N/A	N/A
	➤ Flow Switch Panel	N/A	N/A	N/A
	➤ PA System Panel	N/A	N/A	N/A
	➤ Batter backup	N/A	N/A	N/A
	➤ Building Floor Plans	N/A	N/A	N/A
20.	Special Fire Protection Systems for Protection of special Risks, if any;	N/A	N/A	N/A

Note:-General requirements for schools as per Director of Education circular dated 01/03/2011.

1. Escape route:- **Clear**
2. LPG cylinders in laboratories :- **Nil**
3. Electric wiring:- **Conduit Wiring MCB and ELCB.....**
Electric circuit:- **MCB Provided**
4. Electric meter board:- **Not under staircase**
5. Basement use as per BBL 1983 :- **N/A**
6. Emergency telephone no. board :- **Displayed**
7. Generator set :- **NA**

The fire protection systems provided in the building were tested, checked and found functional at the time of inspection.

In view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules the NOC issued vide letter No. F6/MS/DFS/2006/2509 dated 14/09/2006 renewal under rule 35 of the Delhi Fire Service rules 2010 is recommended.


21/6/11

Signature of the Inspecting Officer

Name : Ashok Kumar Jaiswal

Designation : A.D.O. (Jwala Puri)