

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001

No.F6/DFS/MS/2016/102/1070

Dated: 22/06/2016

FIRE SAFETY CERTIFICATE

Certified that the Lamansion located at C-92, Wazirpur Industrial Area, New Delhi-110052 comprised of Basement + Mezzanine + Ground Floor + First Floor & Second Floor, owned occupied by M/s Vijay Kapoor (owner) have complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and verified by the officer concerned of this department on 16.06.2016 in the presence of Sh. Vijay Kapoor (owner) and found that the said building is fit for occupancy class- "Assembly" Group- D with effect from 22/06/2016 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules 2010.

Issued on 22/06/2016 at New Delhi by

(ATUL GARG)
Chief Fire Officer
Delhi Fire Service

Copy to, Sh. Vijay Kapoor,
C-92, Wazirpur Industrial Area, New Dellhi – 110052.

Following fire safety directives must be adhered to:-

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non-functional fire safety measures shall be at the risk & responsibility of the management.
3. The trained staff should be available round the clock.
4. Mezzanine floor shall not be used for any purpose.
5. Any deviation w.r.t. construction shall be verified by the concerned building sanctioning agency.
6. The certificate may not be treated in any case for regularization of unauthorized construction, if any.
7. The owner / occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form "J" [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry. The form is available on www.dfs.delhigovt.nic.in
8. The owner/occupier shall submit a declaration every year in form 'K' Provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in

Re inspection to see the compliance of shortcomings communicated vide letter no. F6/DFS/MS/2016/1353 dated 26-05-2016

INSPECTION REPORT

1. Name & address of the building: **C-92, Wazipur Industrial Area, New Delhi-110052.**
2. Type of Occupancy : Banquet, (Assembly) Basement+ Mezzanine + Ground Floor + Two UFs
3. Type of Case : New
4. Details of previous NOC : Nil
5. Fire Safety directives Letter No. : F-6/DFS/MS/BP/2015/136 Dated 14/05/2015
6. Date of inspection : 16-06-2016
7. Name of the Inspecting Officer : DCFO/WZ, DO/W & ADO (WP)
8. Name and designation of Officer from the building side : Sh. Vijay Kapoor (Owner)
9. Year of Construction :
10. Applicant's letter No. : Nil Dated - 23/05/2016

S N o	Minimum standards on fire prevention and fire safety U/R 33	BBL Requirements	Provided at site	Remarks MR/NM R
1.	Access of building			
	• Road width	12 m	Provided	MR
	• Gate width	6 m	Provided	MR
	• Width of internal road	NA	NA	NA
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	2	Provided	MR
	• Basements	2	Provided	MR
	b. Width of staircases			
	• Upper floors	2x200cm	1x204cm, 1x122cm, 1x220cm For Maze. F=1x204cm	MR(Mez. Floor not be used)
	• Basements	1x150cm & 1x100cm	1x122cm & 1x204cm	MR
	c. Protection of exits			
	• Fire check door	Required	Provided	MR
	• Pressurization	Required	Provided	MR
	d. No of continuous staircase to terrace	1	Provided	MR
	e. Width Of Corridor			
	f. Door Size	NA	NA	NA
		2x2m & 1x1m	GF=1x330cm, 1x200cm & 2x220cm FF=1x194cm, 2x230cm & 1x88cm SF=2x230 & 1x205cm	MR

3.	Compartmentation			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4.	Smoke managements System			
	• Basements	Required	Provided	MR
	• Upper floors	12 a/c per hour	Provided	MR
5.	Fire Extinguishers			
	• Total numbers	18ABC, CO2 & WCO2 ISI marked	Provided	MR
	• Types		Provided	MR
	• IS marking		Provided	MR
6.	First – Aid Hose Reels			
	• Total numbers on each floor	2	Provided	MR
	• Length of hose reel hose	30 m	Provided	MR
	• Nozzle diameter	5 mm	Provided	MR
7.	Automatic fire detection and alarming system			
	• Type of detectors	Smoke & Heat	Provided	MR
	• Location of Main Panel	Required	Provided	MR
	• Location of Repeater Panel	Required	Provided	MR
	• Alternate source of power	Required	Provided	MR
	• Hooters' Location	Required	Provided	MR
8.	MOEFA	Required	Provided	MR
9.	Public Address System	NA	NA	NA
10	Automatic Sprinkler System			
	• Basements	Required	Provided	MR
	• Upper Floor	Required	Provided	MR
	• Sprinkler above false ceiling	NA	NA	NA
11	Internal Hydrants			
	• Size of riser/down-comer	150 mm	Provided	MR
	• Number of hydrants per floor	2	Provided	MR
	• Hose Box	Required	Provided	MR
12	Yard Hydrants			
	• Total number of hydrants	6	Provided	MR
	• Hose Box	6	Provided	MR

13.	Pumping Arrangements			
	<ul style="list-style-type: none"> • Ground Level • Discharge of main pump ➤ Head of main pump ➤ Number of main pumps ➤ Jockey pump out put ➤ Jockey pump head ➤ Standby Pump out put ➤ Standby Pump Head ➤ Auto Staring/Manual stopping ➤ Pump House Access • Terrace level ➤ Discharge of pump ➤ Head of the pump ➤ Power supply ➤ Auto starting of pump 	2280 lpm	Provided	MR
		60 m	Provided	MR
		1	Provided	MR
		180 lpm	Provided	MR
		60 m	Provided	MR
		2280 lpm	Provided	MR
		60 m	Provided	MR
		Required	Provided	MR
		Required	Provided	MR
		450 lpm	Provided	MR
		40 m	Provided	MR
		Required	Provided	MR
		Required	Required	MR
14.	Captive water Storage for fire fighting			
	<ul style="list-style-type: none"> • Under ground tank capacity ➤ Draw of connection ➤ Fire service inlet ➤ Access to tank • Overhead Tank capacity 	1,00,000 ltrs	Provided	MR
		Required	Provided	MR
		Required	Provided	MR
		Required	Provided	MR
		10, 000 litres	Provided	MR
15	Exit Signage	Required	Provided	MR
16.	Provision of Lifts			
	<ul style="list-style-type: none"> ➤ Pressurization of Lift Shaft ➤ Pressurization of lift lobby ➤ Communication in lift Car ➤ Fireman's Grounding Switch ➤ Lift Signage 	NA	NA	NA
		NA	NA	NA
		Required	Provided	MR
		Required	Provided	MR
		Required	Provided	MR
17.	Standby power supply	Required	Provided	MR
18.	Refuge Area			
	<ul style="list-style-type: none"> ➤ Total area ➤ Location 	NA	NA	NA
		NA	NA	NA
19.	Fire control room			
	<ul style="list-style-type: none"> ➤ Detector system panel ➤ Flow Switch Panel ➤ PA System Panel ➤ Battery backup ➤ Building Floor Plans 	Required	Provided	MR
		NA	NA	NA
		NA	NA	NA
		Required	Provided	MR
		NA	NA	NA

20.	Special Fire Protection Systems for Protection of special Risks, if any;	NA	NA	NA
-----	--	----	----	----

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety required under the rules it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules 2010/issue shortcomings as noted at serial numbers**NIL**.....

Signature of the Inspecting Officer 

Signature of the Inspecting Officer

Name Uday Vir Singh

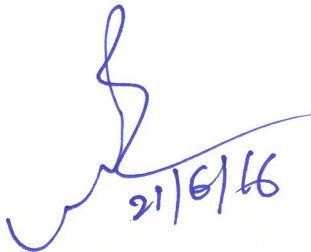
Name

Designation ADO/wp

Designation

DO/w on leave

~~Dyefot/w~~


21/6/16