

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE, NEW DELHI-110001


No. F6/DFS/MS/2016/School/WZ/1321

Dated: 30 / 08 /2016

FIRE SAFETY CERTIFICATE

Certified that the Rao Sher Singh Memorial Public School at J-31/3, Shiv Ram Park, Nilothi More, Nangloi, Delhi-41, comprised of Ground + One upper floors owned / occupied by Rao Sher Singh Memorial Public School, has already been issued Fire Safety Certificate Vide letter No. F6/DES/MS/2013/School/WZ/902 dated 11/09/2013. The premises was re-inspected by the officer concerned of Fire Service on 23.08.2016 in the presence of Sh. Amit (Teacher) and observed that all the fire prevention and fire safety arrangements provided in the premises found in good working condition. The premises have therefore deemed complied with Directorate of Education, Circular No. 262-362 dated 17.01.2005 and that the building / premises is fit for occupancy class-B **Educational** with effect from 30 / 08 /2016 for a period of three years subject to conditions printed below.

Issued on 30/08/16 at New Delhi by.


30/8/16
(DHARAMPAL BHARDWAJ)
DY. CHIEF FIRE OFFICER,
PHONE:011-25156707.

Copy to :-

1. The Principal, Rao Sher Singh Memorial Public School, Shiv Ram Park, Nilothi More, Nangloi, Delhi-41.

Conditions for the validity of Fire Safety Certificate:

1. All the fire safety arrangement provided their in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. This certificate cannot be treated in any case for regularizations of unauthorized construction.
6. "The owner / Occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule37] along with a copy of this Certificate, six months prior to its expiry".
7. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on WWW.dfs.Delhigovt.nic.in

INSPECTION REPORT

1. Name & address of the building: Rao Sher Singh Memorial Public School, J-31/3,
Nilothi More, Shiv Ram Park, Nangloi, Delhi-41.
2. Type of Occupancy : Educational
(Plot Area-5000m², Covered Area-1500m²)
3. Type of Case : Renewal (Ground + One upper Floor only)
4. Details of previous NOC : F6/DFS/MS/2013/School/WZ/902, 11/09/2013
5. Fire Safety directives Letter No. : DOE letter dated 17/01/2005
6. Date of inspection : 23/08/2016
7. Name of the Inspecting Officer : A. K. Jaiswal
8. Name and designation of Officer
from the building side : Sh. Amit (Teacher)
9. Year of Construction : Before 2010
10. Applicant's letter No. : RSSMPS/3/8/2016

S No	Minimum standards on fire prevention and fire safety U/R 33	DOE Circ. Dt.17/1/2005 Requirements	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	Accessible	6 Mtr	MR
	• Gate width	Accessible	On Road	MR
	• Width of internal road	N/A	N/A	N/A
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	2	2	MR
	• Basements	No basement	N/A	N/A
	b. Width of staircases			
	• Upper floors	1.50 Mtr.	1.55 Mtr	MR
	• Basements	N/A	N/A	N/A
	c. Protection of exits			
	• Fire check door	N/A	N/A	N/A
	• Pressurization	N/A	N/A	N/A
	d. No of continuous staircase to terrace	1	2	MR
	e. Width Of Corridor	1.50 Mtr.	1.50 mtr	MR
	f. Door Size	1.00 Mtr.	1.00 mtr	MR
3.	Compartmentation			
	• Fire check door	N/A	N/A	N/A
	• Sealing of electrical shafts	N/A	N/A	N/A
	• Fire Rating of shaft door	N/A	N/A	N/A
	• Water Curtain	N/A	N/A	N/A
	• Fire Dampers			
4.	Smoke managements System			
	• Basements	N/A	N/A	N/A
	• Upper floors	N/A	N/A	N/A
5.	Fire Extinguishers			
	• Total numbers	6	8	M/R
	• Types	ISI marked ABC/CO ₂	Provided	MR
	• IS marking	Required	Provided	

6.	First - Aid Hose Reels	1	Provided	MR
	• Total numbers on each floor			
	• Length of hose reel hose	30 Mtr.	Provided	MR
	• Nozzle diameter	5 mm	Provided	MR
7.	Automatic fire detection and alarming system			
	• Type of detector	N/A	N/A	N/A
	• Location of Main Panel	N/A	N/A	N/A
	• Location of Repeater Panel	N/A	N/A	N/A
	• Alternate source of power	N/A	N/A	N/A
	• Hooters' Location	N/A	N/A	N/A
8.	MOEFA	N/R	N/P	NR
9.	Public Address System	N/R	N/P	NR
10.	Automatic Sprinkler System			
	• Basements	N/A	N/A	N/A
	• Upper Floor	N/A	N/A	N/A
	• Sprinkler above false ceiling	N/A	N/A	N/A
11.	Internal Hydrants			
	• Size of riser/down-comer	N/A	N/A	N/A
	• Number of hydrants per floor	N/R	N/P	N/R
	• Hose Box	N/R	N/P	N/R
12.	Yard Hydrants			
	• Total number of hydrants	Not Required	N/P	N/R
	• Hose Box	Not Required	N/P	NR
13.	Pumping Arrangements			
	• Ground Level			
	• Discharge of main pump	N/A	N/A	
	➤ Head of main pump	N/A	N/A	N/A
	➤ Number of main pumps	N/A	N/A	N/A
	➤ Jockey pump out put	N/A	N/A	N/A
	➤ Jockey pump head	N/A	N/A	N/A
	➤ Standby Pump out put	N/A	N/A	N/A
	➤ Standby Pump Head	N/A	N/A	N/A
	➤ Auto Starting/Manual stopping	N/A	N/A	N/A
	➤ Pump House Access	N/A	N/A	N/A
	• Terrace level			
	➤ Discharge of pump	450 LPM	450 LPM	MR
	➤ Head of the pump	40 Mtr.	40 Mtr	MR
	➤ Power supply	Required	Provided	MR
	➤ Auto starting of pump	Required	Provided	MR
14.	Captive water Storage for fire fighting			
	• Underground tank capacity	N/A	N/A	N/A

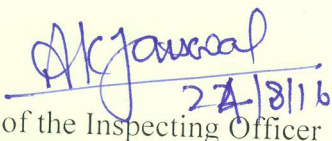
		Required	Provided	MR
15	Exit Signage			
16.	Provision of Lifts			
	➤ Pressurization of Lift Shaft	N/A	N/A	N/A
	➤ Pressurization of lift lobby	N/A	N/A	N/A
	➤ Communication in lift Car	N/A	N/A	N/A
	➤ Fireman's Grounding Switch	N/A	N/A	N/A
	➤ Lift Signage	N/A	N/A	N/A
17.	Standby power supply	N/A	N/A	N/A
18.	Refuge Area	N/A	N/A	
	➤ Total area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19.	Fire control room			
	➤ Detector system panel	N/A	N/A	N/A
	➤ Flow Switch Panel	N/A	N/A	N/A
	➤ PA System Panel	N/A	N/A	N/A
	➤ Battery backup	N/A	N/A	N/A
	➤ Building Floor Plans	N/A	N/A	N/A
20.	Special Fire Protection Systems for Protection of special Risks, if any;	N/A	N/A	N/A

Note:-A) General requirements for schools as per Director of Education circular dated 01/03/2011.

1. Escape route:- Clear
2. LPG cylinders in laboratories :- Nil
3. Electric wiring:- Conduit Wiring MCB and ELCB.....
Electric circuit:- MCB Provided
4. Electric meter board / switch board panel.:-Not Under the staircase
5. Basement use as per BBL 1983 :- N/A
6. Emergency telephone no. board :- Displayed
7. Generator set :- NA

The fire protection systems provided in the building were tested, checked and found functional at the time of inspection.

In view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules the NOC issued vide letter No. F6/DFS/MS/2013/School/WZ/902 dated 11/09/2013 renewal under rule 35 of the Delhi Fire Service rules 2010 is recommended.


24/8/16

Signature of the Inspecting Officer

Name : Ashok Kumar Jaiswal

Designation : A.D.O. (Jwala Puri)

D.P./CW

Inspected 24/8/16

