

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI

HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001

Fax No. 011-23412593, Ph. 011-23412225

No. F6/DFS/MS/Club/2016/SZ/ 1846

Dated: 28/12/16

FIRE SAFETY CERTIFICATE

Certified that M/s **New Friends Club, New Friends Colony, Mathura Road, New Delhi**, comprised of Basement, lower ground, upper ground plus two upper floors was granted FSC by this department vide letter No. F6/DFS/MS/Club/2013/SZ/540 dated 09.07.2013. the premises was re-inspected by the officer concerned of this department on 17.12.2016 in the presence of Mr. A.K. Jha (Admin) of the club and observed that the said building/premises have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the premises is fit for occupancy class-D "**Assembly Building (Club)**" (NOC renewed for **Basement-Swimming Pool, Lower ground floor-Offices, Activity rooms etc., Upper ground floor-Restaurant, Bar & lobby, 1st floor-Restaurant, Meeting room/Card room and 2nd floor- 6 guest rooms**) with effect from 28/12/16 for a period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 28/12/16 at New Delhi by

Vipin Kental
Chief Fire Officer

Copy to: -

1. M/s New Friends Club, New Friends Colony, Mathura Road, New Delhi-110025
2. The Joint C.P. (Lic.), 1st floor, PS Defence Colony, New Delhi-110049

Conditions for the validity of Fire Safety Certificate

1. All the fire safety and means of escape facilities shall be maintained in good working condition at all time. Any lapse rendering the fire safety or means of evacuation facilities non-functional shall be the responsibility of the management.
2. Building Sanctioning authority may verify any deviation with regard to construction/occupancy in the building. In case of any deviation, the fire safety certificate stands null & void.
3. The staff shall be trained for operating fire fighting system and mock evacuation drill be conducted at regular interval and record be maintained.
4. The basement shall be used strictly as per the provisions of Building Bye Laws.
5. The Owner/Occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules, 2010. The form is available on www.dfs.delhigovt.nic.in.
6. The water capacity of 50,000 Ltr shall always remain available in the swimming pool for firefighting purpose all the time.
7. The Owner/Occupier shall apply for renewal of this Fire Safety Certificate to the Director in the form 'J' [sub rule (1) of rule 37] along with copy of this certificate, six months prior to its expiry. The form is available on www.dfs.delhigovt.nic.in.

INSPECTION REPORT

1	Name & Address of the Building	New Friends Club, New Friends Colony, Mathura Road, New Delhi-110025		
2	Type of Occupancy	Assembly Building "Group-D" (Club)		
3	Building Comprised of	Basements + LG + UG, + 2 upper floors.		
4	Type of Case	Renewal		
5	Details of Previous NOC	F6/DFS/MS/Club/2013/SZ/540 dated 09.07.2013		
6	Fire Safety Directives Letter No	F.6/DFS/MS/BP/92/1120 Dated 10/06/1992		
7	Date of Inspection	17.12.2016		
8	Name of the Inspecting Officers	ADO R.N. Singh		
9	Name & Designation of Officers from the building side	Mr. AK Jha (Admin)		
10	Year of construction			
11	Applicant letter No.	Nil dated 28/10/2016		
S. No	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC Dt. 28/06/1994 & Directives Requirement	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	1. Road width	9 mtr	20 mtr	MR
	2. Gate width	NA	NA	NA
	3. Width of internal road	NA	NA	NA
2	Number, width, type and arrangements of exits.			
	a. Number of Staircase			
	1. Upper floors	2 No's	2 No's	MR
	2. Basement floor	2 No's	3 No's	MR
	b. Width of Staircase			
	1. Upper floors	1.25 m/0.75 m	1.6 m & 1.1m	MR
	2. Basement floor	1.25 m/0.75 m	1.5 m, 2 m & 1.1 m	MR
	c. Protection of exits			
	1. Fire check door	NA	NA	NA
	2. Pressurization	NA	NA	NA
	d. No. of continuous staircase to terrace	One	One	MR
	e. Width of corridor	1.5 m	1.8 m	MR
	f. Door size	1 m	1 m	MR
3	Compartmentation.			
	1. Fire check door.	NA	NA	NA
	2. Sealing of electrical shafts.	NA	NA	NA
	3. Fire rating of shaft door.	NA	NA	NA
	4. Water curtain	NA	NA	NA
	5. Fire dampers.	NA	NA	NA
4.	Smoke Management system.			
	1. Basement	30 ACPH	Exhaust Fans provided	MR
	2. Upper floors	12 ACPH	Natural Ventilation	NA
5.	Fire Extinguishers.			
	1. Total numbers	20 No's	25 Nos.	MR
	2. Types	ISI	ABC- 10, W.Co2- 05	MR
	3. ISI Marking	Marked	Provided	MR
6.	First Aid Hose Reels.			
	1. Total numbers on each floor.	Hose Reel	Two	MR
	2. Length of hose-reel hose.		30 mtr	MR
	3. Nozzle Diameter		05 mm	MR

Renewal

New Friends Club, New Friends Colony, New Delhi


B.

7	Automatic Fire Detection and Alarming system.			
	1. Type of detectors	NA	Heat & Smoke.	NA
	2. Location of Main Panel	NA	Lower Ground	NA
	3. Location of Repeater Panel	NA	NA	NA
	4. Alternate source of power	NA	Provided	NA
	5. Hooter's location	NA	All floor	NA
8.	MOEFA	Required	Provided	MR
9.	Public Address System	NA	NA	NA
10.	Automatic Sprinkler System			
	1. Basement	Required	Provided	MR
	2. Upper floors	NA	NA	NA
	3. Sprinkler above false ceiling	NA	NA	NA
11.	Internal Hydrants.			
	1. Size of Riser/Down-comer	100 mm	100 mm	MR
	2. Number of Hydrant per floor	Two	Two	MR
	3. Hose box.	Two	Two	MR
12.	Yard Hydrants.			
	1. Total number of hydrants.	NA	NA	NA
	2. Hose box.	NA	NA	NA
13.	Pumping arrangements.			
	a) Ground Level			
	➤ Discharge of main pump.	NA	NA	NA
	➤ Head of main pump.	NA	NA	NA
	➤ Number of main pumps.	NA	NA	NA
	➤ Jockey Pump output.	NA	NA	NA
	➤ Jockey Pump head.	NA	NA	NA
	➤ Standby Pump output.	NA	NA	NA
	➤ Standby Pump head.	NA	NA	NA
	➤ Auto Starting / Manual Stopping.	NA	NA	NA
	b) Terrace Level			
	➤ Discharge of pump.	900 LPM	180 & 450 LPM	MR (old case)
	➤ Head of pump.	40 m	35 mtr	MR (old case)
	➤ Power supply.	Required	Provided	MR
	➤ Auto starting of pump.	Required	Provided	MR
14.	Captive water storage for Fire Fighting.			
	1. Underground tank capacity.	NA	NA	NA
	2. Draw-off connection.	NA	NA	NA
	3. Fire Service Inlet.	NA	NA	NA
	4. Access to tank.	NA	NA	NA
	5. Overhead tank capacity.	10,000 Ltr.	10,000 Ltr.	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	1. Pressurization of lift shaft.	NA	NA	NA
	2. Pressurization of lift lobby.	NA	NA	NA
	3. Communication in lift car.	NA	Provided	NA
	4. Fireman's switch.	NA	Provided	NA
	5. Lift signage.	NA	Provided	NA
17	Standby Power Supply	Required	Provided	MR
18.	Refuge Area			
	1. Total area	NA	NA	NA
	2. Location	NA	NA	NA

Renewal

New Friends Club, New Friends Colony, New Delhi

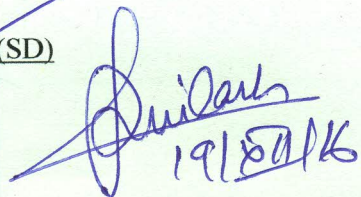
N/

19.	Fire Control Room.			
	1. Detector System Panel.	NA	NA	NA
	2. Flow Switch Panel.	NA	NA	NA
	3. PA system Panel.	NA	NA	NA
	4. Battery backup	NA	NA	NA
	5. Building floor plan	NA	NA	NA
20.	Special Fire Protection System for the Protection of special Risk, if any :			NA
<p>The Fire protection systems provided in the building were test checked and found functional at the time of inspection. Shortcomings communicated vide letter dated 09/09/2016 have been complied ✓</p> <p>Keeping in view of the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under the rules, the FSC issued vide letter No. F6/DFS/MS/Club/2013/540 dated 09.07.2013, renewal under rule 37 of the Delhi Fire Service rules, 2010 is recommended</p> <p>Accordingly, DFA is put up for approval and signature please.</p> <p style="text-align: right;"> Signature of the Inspecting Officer Name : R.N. Singh Designation: ADO</p>				

Renewal

New Friends Club, New Friends Colony, New Delhi

Div. Officer (SD)


19/09/16