


No. F6/DFS/MS/School/2017/SZ/ 66

Dated: 16/1/17

**FIRE SAFETY CERTIFICATE**

Certified that the **N.P. Middle School located at Narouji Nagar, New Delhi**, comprised of Ground + 1 Upper floor was granted Fire Safety Certificate by this department vide letter No. F.6/DFS/MS/School/2014/SZ/7 dated 01/01/2014. The premises was re-inspected by officer concerned of this department on 21.12.2016 in the presence of Mrs. Monika Anand (Principal) of the school and found that said school building have deemed complied with the fire prevention and fire safety arrangements in accordance DOE circular No. 262-362 dated 17.01.2005 issued by Director of Education Govt. of NCT of Delhi and that the building/premises is fit for occupancy class "**Educational Building, Group-B**" with effect from 16/1/2017 for a period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 16/1/17 at New Delhi by

  
Vipin Kental  
Chief Fire Officer

**Copy to: -**

1. Mr. Sajjan Kumar, Fire Officer, NDMC, Palika Kendra, New Delhi-110001
2. The Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi.

**Conditions for the validity of Fire Safety Certificate**

1. All the fire safety and means of escape facilities shall be maintained in good working condition at all time. Any lapse rendering the fire safety or means of evacuation facilities non-functional shall be the responsibility of the management.
2. Building Sanctioning authority may verify any deviation with regard to construction/occupancy in the building. In case of any deviation, the fire safety certificate stands null & void.
3. The staff shall be trained for operating fire fighting system and mock evacuation drill be conducted at regular interval and record be maintained.
4. The basement shall be used strictly as per the provisions of Building Bye Laws.
5. The Owner/Occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules, 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).
6. The Owner/Occupier shall apply for renewal of this Fire Safety Certificate to the Director in the form 'J' [sub rule (1) of rule 37] along with copy of this certificate, six months prior to its expiry. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)

## INSPECTION REPORT

1	Name & Address of the Building	N. P. MIDDLE SCHOOL, NAROUJI NAGR, NEW DELHI-110024		
2	Type of Occupancy	Educational Building "Group-B" (School)		
3	Building Comprised of	Ground + 01 upper floors		
4	Type of Case	Renewal		
5	Details of Previous NOC	F6/DFS/MS/School/2014/SZ/7 Dated 01/01/2014		
6	Fire Safety Directives Letter No	DOE Circular No. 262-362 Dated 17/01/2005		
7	Date of Inspection	21.12.2016		
8	Name of the Inspecting Officers	ADO R.N. Singh		
9	Name & Designation of Officers from the building side	Mrs. Monika Anand (Principal)		
10	Year of construction	1981		
11	Applicant letter No.	Nil dated 17/11/2016		
S. No	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC Dt. 21/12/2010 Requirements	Provided at Site	Remarks MR/NMR
<b>1</b>	<b>Access to Building.</b>			
	1. Road width	Required	6 mtr	MR
	2. Gate width	NA	4.5 mtr	NA
	3. Width of internal road	NA	NA	NA
<b>2</b>	<b>Number, width, type and arrangements of exits.</b>			
	<b>a. Number of Staircase</b>			
	1. Upper floors	Required	2 No's	MR
	2. Basement floor	NA	NA	NA
	<b>b. Width of Staircase</b>			
	1. Upper floors	Required	1.40 m, 0.92 m & 01 ramp of 1.52 mtr	MR (old case)
	2. Basement floor	NA	NA	NA
	<b>c. Protection of exits</b>			
	1. Fire check door	NA	NA	NA
	2. Pressurization	NA	NA	NA
	<b>d. No. of continuous staircase to terrace</b>	Required	1 No	MR
	<b>e. Width of corridor</b>	NA	NA	NA
	<b>f. Door size</b>	1.0 m	1.0 m	MR
<b>3</b>	<b>Compartmentation.</b>			
	1. Fire check door.	NA	NA	NA
	2. Sealing of electrical shafts.	NA	NA	NA
	3. Fire rating of shaft door.	NA	NA	NA
	4. Water curtain	NA	NA	NA
	5. Fire dampers.	NA	NA	NA
<b>4.</b>	<b>Smoke Management system.</b>			
	1. Basement	NA	NA	NA
	2. Upper floors	12 a/c per hour	Open corridor	NA
<b>5.</b>	<b>Fire Extinguishers.</b>			
	1. Total numbers	One/300 m <sup>2</sup>	08 No's	MR
	2. Types	ABC/Co2	ABC-04 Co2-04	MR
	3. ISI Marking	ISI marked	Provided	MR
<b>6.</b>	<b>First Aid Hose Reels.</b>			
	1. Total numbers on each floor.	Hose-reel	01 No	MR
	2. Length of hose-reel hose.		30 mtr	MR
	3. Nozzle Diameter		05 mm	MR

Renewal

N.P. Middle School, Narouji Nagar, New Delhi

B.

7	<b>Automatic Fire Detection and Alarming system.</b>			
	1. Type of detectors	NA	NA	NA
	2. Location of Main Panel	NA	NA	NA
	3. Location of Repeater Panel	NA	NA	NA
	4. Alternate source of power	NA	NA	NA
	5. Hooter's location	NA	NA	NA
8.	<b>MOEFA</b>	NA	Provided	NA
9.	<b>Public Address System</b>	Required	Provided	MR
10.	<b>Automatic Sprinkler System</b>			
	1. Basement	NA	NA	NA
	2. Upper floors	NA	NA	NA
	3. Sprinkler above false ceiling	NA	NA	NA
11.	<b>Internal Hydrants.</b>			
	1. Size of Riser/Down-comer	NA	NA	NA
	2. Number of Hydrant per floor	NA	NA	NA
	3. Hose box.	NA	NA	NA
12.	<b>Yard Hydrants.</b>			
	1. Total number of hydrants.	NA	NA	NA
	2. Hose box.	NA	NA	NA
13.	<b>Pumping arrangements.</b>			
	<b>a) Ground Level</b>			
	➤ Discharge of main pump.	NA	NA	NA
	➤ Head of main pump.	NA	NA	NA
	➤ Number of main pumps.	NA	NA	NA
	➤ Jockey Pump output.	NA	NA	NA
	➤ Jockey Pump head.	NA	NA	NA
	➤ Standby Pump output.	NA	NA	NA
	➤ Standby pump head.	NA	NA	NA
	➤ Auto Starting/Manual Stopping.	NA	NA	NA
	<b>b) Terrace Level</b>			
	➤ Discharge of pump.	Required	450 LPM	MR
	➤ Head of pump.	Required	38 mtr	MR
	➤ Power supply.	NA	NA	NA
	➤ Auto starting of pump.	NA	NA	NA
14.	<b>Captive water storage for Fire Fighting.</b>			
	1. Underground tank capacity.	NA	NA	NA
	2. Draw-off connection.	NA	NA	NA
	3. Fire Service Inlet.	NA	NA	NA
	4. Access to tank.	NA	NA	NA
	5. Overhead tank capacity.	2.500 Ltr	Provided	MR
15.	<b>Exit Signage.</b>	Required	Provided	MR
16.	<b>Provisions of Lifts.</b>			
	1. Pressurization of lift shaft.	NA	NA	NA
	2. Pressurization of lift lobby.	NA	NA	NA
	3. Communication in lift car.	NA	NA	NA
	4. Fireman's switch.	NA	NA	NA
	5. Lift signage.	NA	NA	NA
17	<b>Standby Power Supply</b>	NA	NA	NA
18.	<b>Refuge Area</b>			
	1. Total area	NA	NA	NA
	2. Location	NA	NA	NA

Renewal

N.P. Middle School, Narouji Nagar, New Delhi

hi


N/

19.	<b>Fire Control Room.</b>	1. Detector System Panel.	NA	NA	NA
		2. Flow Switch Panel.	NA	NA	NA
		3. PA system Panel.	NA	NA	NA
		4. Battery backup	NA	NA	NA
		5. Building floor plan	NA	NA	NA
		20.	<b>Special Fire Protection System for the Protection of special Risk, if any.</b>		

The Fire protection systems provided in the building were randomly tested, checked and found functional at the time of inspection.

Keeping in view of the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under the DOE circular dated 17/01/2005, Fire Safety Certificate issued vide letter No. F6/DFS/MS/School/2014/SZ/7 dated 01.01.2014, renewal under rule 37 of the Delhi Fire Service rules, 2010 is recommended

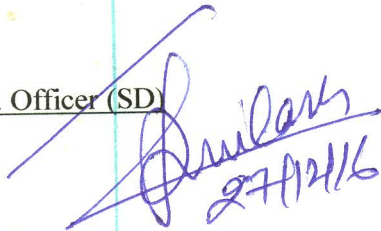
Accordingly, DFA is put up for approval and signature please.

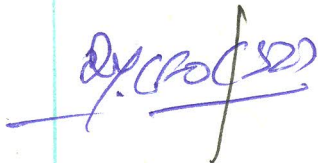
  
Signature of the Inspecting Officer  
Name: R.N. Singh  
Designation: ADO


Renewal

N.P. Middle School, Narouji Nagar, New Delhi

Div. Officer (SD)

  
27/12/16

  
27/12/16

  
27/12

FT/a-

m-scds 27/12



498/CBSS  
27/12/16  
CFO/MS