

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001

Fax No. 011-23412593, Ph. 011-23412225

No. F6/DFS/MS/School/2017/SZ/ 394

Dated: 16/03/17

FIRE SAFETY CERTIFICATE

Certified that the **Oxford Angel Public School** located at **Chattarpur, New Delhi**, comprised of Basement, Ground + 02 upper floors, having total 27 class rooms was granted Fire Safety Certificate by this department vide letter No. F.6/DFS/MS/School/2013/SZ/1025 Dated 04/10/2013. The premises was re-inspected by officer concerned of this department on 20/02/2017 in the presence of Mr. Ved Parkash (Principal) of the school and observed that there has been addition of one upper floor (which is not in use). The said school have deemed complied with the fire prevention and fire safety arrangements in accordance with circular no. 262-362 dated 17/01/2005 issued by Director of Education and that the building is fit for occupancy class "**Educational Building Group-B**" (FSC renewed up to 2nd floor only) with effect from 16/03/ 2017 for a period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 16/03/17 at New Delhi by

W 14/3.
(Vipin Kental)
Chief Fire Officer

Copy to: -

1. The Head Mistress, Oxford Angel Public School,
Chattarpur, New Delhi-110074
2. The Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi.

Conditions for the validity of Fire Safety Certificate

1. All the fire safety and means of escape facilities shall be maintained in good working condition at all time. Any lapse rendering the fire safety or means of evacuation facilities non-functional shall be the responsibility of the management.
2. Building Sanctioning authority may verify any deviation with regard to construction/occupancy in the building. In case of any deviation, the fire safety certificate stands null & void.
3. The staff shall be trained for operating fire fighting system and mock evacuation drill be conducted at regular interval and record be maintained.
4. The basement shall be used strictly as per the provisions of Building Bye Laws.
5. The Owner/Occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules, 2010. The form is available on www.dfs.delhigovt.nic.in.
6. The Owner/Occupier shall apply for renewal of this Fire Safety Certificate to the Director in the form 'J' [sub rule (1) of rule 37] along with copy of this certificate, six months prior to its expiry. The form is available on www.dfs.delhigovt.nic.in.


INSPECTION REPORT

1	Name & Address of the Building	Oxford Angel Public School, Chhattarpur, New Delhi-110074		
2	Type of Occupancy	Educational Building "Group-B" (School)		
3	Building Comprised of	Basement, Ground + 03 upper floors (3 rd floor not in use)		
4	Type of Case	Renewal		
5	Details of Previous NOC	F6/DFS/MS/School/2013/SZ/1025 Dated 04/10/2013 for basement, ground + 02 upper floors		
6	Fire Safety Directives Letter No	DOE Circular No. 262-362 Dated 17/01/2005		
7	Date of Inspection	20/02/2017		
8	Name of the Inspecting Officers	ADO R.N. Singh		
9	Name & Designation of Officers from the building side	Sh. Ved Prakash (Principal)		
10	Year of construction	2006 & 2015		
11	Applicant letter No.	Nil Dt.3/01/2017 ODD No 1048 dt 31/01/2017		
S. No	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC Dt. 27/09/2006 requirement	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	1. Road width	Accessible	9 Mtr	MR
	2. Gate width	NA	2.10 Mtr	NA
	3. Width of internal road	NA	NA	NA
2	Number, width, type & arrangement of exits			
	a. Number of Staircase			
	1. Upper floors	One	Two	MR
	2. Basement floor	Two	Two	MR
	b. Width of Staircase			
	1. Upper floors	1.50 mtr	1.30m & 1.00 m	MR
	2. Basement floor	1.50 mtr	1.30m & 1.00 m	MR
	c. Protection of exits			
	1. Fire check door	N/A	N/A	N/A
	2. Pressurization	N/A	N/A	N/A
	d. No. of continuous staircase to terrace	One	One	MR
	e. Width of corridor	N/A	N/A	N/A
	f. Door size	N/A	N/A	N/A
3	Compartmentation.			
	1. Fire check door.	N/A	N/A	N/A
	2. Sealing of electrical shafts.	N/A	N/A	N/A
	3. Fire rating of shaft door.	N/A	N/A	N/A
	4. Water curtain	N/A	N/A	N/A
	5. Fire dampers.	N/A	N/A	N/A
4.	Smoke Management system.			
	1. Basement	Required	Exhaust fans provided	MR
	2. Upper floors	N/A	N/A	N/A
5.	Fire Extinguishers.			
	1. Total numbers	12 No's	12 No's	MR
	2. Types	ABC/Co2	ABC-10, W.Co2-02	MR
	3. ISI Marking	ISI Marked	Provided	MR
6.	First Aid Hose Reels.			
	1. Total numbers on each floor.	Hose-reels	One	MR
	2. Length of hose-reel hose.		30 Mtr	MR
	3. Nozzle Diameter		05 mm	MR

Renewal

Oxford Angel Public School, Chhattarpur, ND-74


7	Automatic fire detection & alarming system.			
	1. Type of detectors	N/A	N/A	N/A
	2. Location of Main Panel	N/A	N/A	N/A
	3. Location of Repeater Panel	N/A	N/A	N/A
	4. Alternate source of power	N/A	N/A	N/A
	5. Hooter's location	N/A	N/A	N/A
8.	MOEFA	N/A	N/A	N/A
9.	Public Address System	N/A	N/A	N/A
10.	Automatic Sprinkler System			
	1. Basement.	Required	Provided	MR
	2. Upper floors	N/A	N/A	N/A
	3. Sprinkler above false ceiling	N/A	N/A	N/A
11.	Internal Hydrants.			
	1. Size of Riser/Down-comer	Required	100 mm	MR
	2. Number of Hydrant per floor	N/A	One	N/A
	3. Hose box.	N/A	One	N/A
12.	Yard Hydrants.			
	1. Total number of hydrants.	N/A	N/A	N/A
	2. Hose box.	N/A	N/A	N/A
13.	Pumping arrangements.			
	a) Ground Level			
	➤ Discharge of main pump.	N/A	N/A	N/A
	➤ Head of main pump.	N/A	N/A	N/A
	➤ Number of main pumps.	N/A	N/A	N/A
	➤ Jockey Pump output.	N/A	N/A	N/A
	➤ Jockey Pump head.	N/A	N/A	N/A
	➤ Standby Pump output.	N/A	N/A	N/A
	➤ Standby Pump head.	N/A	N/A	N/A
	➤ Auto Starting / Manual Stopping.	N/A	N/A	N/A
	➤ Pump house access.	N/A	N/A	N/A
	b) Terrace Level			
	➤ Discharge of pump.	Required	450 LPM	MR
	➤ Head of pump.	Required	40 Mtr	MR
	➤ Power supply.	Required	Provided	MR
	➤ Auto starting of pump.	Required	Provided	MR
14.	Captive water storage for Fire Fighting.			
	1. Underground tank capacity.	N/A	N/A	N/A
	2. Draw-off connection.	N/A	N/A	N/A
	3. Fire Service Inlet.	N/A	N/A	N/A
	4. Access to tank.	N/A	N/A	N/A
	5. Overhead tank capacity.	5,000 Ltr	5,000 Ltr	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	1. Pressurization of lift shaft.	N/A	N/A	N/A
	2. Pressurization of lift lobby.	N/A	N/A	N/A
	3. Communication in lift car.	N/A	N/A	N/A
	4. Fireman's switch.	N/A	N/A	N/A
	5. Lift signage.	N/A	N/A	N/A
17	Standby Power Supply	Required	Provided	MR
18.	Refuge Area			
	1. Total area	N/A	N/A	N/A
	2. Location	N/A	N/A	N/A

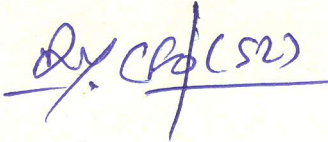
19.	Fire Control Room.			
	1. Detector System Panel.	N/A	N/A	N/A
	2. Flow Switch Panel.	N/A	N/A	N/A
	3. PA system Panel.	N/A	N/A	N/A
	4. Battery backup	N/A	N/A	N/A
	5. Building floor plan	N/A	N/A	N/A
20.	Special Fire Protection System for the Protection of special Risk, if any.			
<p>The Fire Protection system provided in the building were checked at random and found functional at the time of inspection. School management has submitted an undertaking that 3rd floor shall not be used for school purposes.</p> <p>Keeping in view of the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under the circular of Directorate of Education dated 17/01/2005, FSC issued vide letter No. F6/DFS/MS/School/2013/SZ/1025 dated 04.10.2013, renewal under rule 37 of the Delhi Fire Service rules, 2010 is recommended</p> <p>Accordingly DFA is put up for approval and signature please.</p>				
 Signature of the Inspecting Officer Name : R.N. Singh Designation: ADO				

Renewal


Oxford Angel Public School, Chhattarpur, ND-74

Div. Officer (SD)

~~Div. Officer (SD)~~

28/12/17



682/C/S2
23/1572



1/3



CFO (S/P)

m. s. cell

FT/101


29/3