

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI - 110001


NO F 6/DFS/MS/EH/2017/ NDZ/ 654

Dated:- ...5.../...5.../2017

FIRE SAFETY CERTIFICATE

Certified that the M/S Ware House Café (A Unit of Sukhija Bar & Gril Pvt. Ltd.) located at 1st Floor & Mezzanine floor of D-19 & D-20, Inner Circle, Connaught Place New Delhi-11001 owned/occupied by the department Ware House Cafe" Pvt. Ltd. was issued FSC by This Department vide letter No F.6/DFS/MS/EH/2013/NDZ/123 dated 26/03/2013. The restaurant was re- inspected by the officer concerned of this department on. 28/04/17 in the presence of Sh. Ashwini Sharma and found that the owner have deemed complied with the fire prevention and fire safety requirement in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the building/ premises is fit for occupancy of class Assembly Group- D with effect from 5/5/17 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40, subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010 mentioned below.

Issued on-----5/5/17-----at New Delhi


(Vipin Kental)
Chief Fire Officer
Delhi Fire Service

Copy to:-

1. M/S Ware House Cafe" (A Unit of Sukhija Bar & Gril Pvt. Ltd), D-19 & D-20, Inner Circle Connaught Place New Delhi-11001.
2. The Medical Officer of Health, Health Department NDMC, Palika Kendra, New Delhi.
3. The Assistant Commissioner, Restaurant Branch, L & N Block, I.P. Estate, Vikas Bhawan, New Delhi.

Following fire safety directives may be adhered to :-

1. All the fire safety arrangements provided therein shall be maintained in good working conditions at all times.
2. The means of escape shall be kept unobstructed/unlocked & remain available for speedy evacuation of occupants in case of an emergency. of smooth and speedy safe evacuation of occupants in case of emergency
3. Any loss of life or property due to non functional fire safety measures shall be at the responsibility of the management. rendering non functional of fire safety measures, management shall be responsible.
4. Any deviation with regard to construction, electric shall be verified by the concerned building sanctioning authority.
5. The trained fire fighting staff should be available around the clock.
6. This fire safety certificate may not be treated in any case for regularizations of unauthorized construction if any.
7. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi fire service 2010. The form is available on www.dfs.delhigovt.nic.in.
8. The owner / occupier shall apply for renewal of this fire safety certificated to the director in Form "J" [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to it expiry.

INSPECTION REPORT

1. Name & address of the building : M/S Ware House Café” (A Unit of Sukhija Bar & Grill Private Limited), First Floor & Mezzanine floor D-19-20, Inner Circle, Connaught Place, New Delhi-110001
2. Type of Occupancy : Eating House.
3. Type of Case : Renewal.
4. Details of Previous FSC letter : F6/DFS/MS/EH/2013/NDZ/123 dated 26/03/2013.
5. Fire Safety Circular No. : Nil.
6. Date of Inspection : 28/04/2017.
7. Name of the Inspecting officers : (Dy. C.F.O. Sunil Chawdhary.& A.D.O manoj Sharma)
8. Name and designation of
Officer from the building side : Mr. Ashwini Sharma.
9. Year of Construction : prior 1962.
10. Applicant's letter No : Dated 07/04/17.

N O.	Minimum Standards on fire prevention and fire safety U/R33	Requirement	Provided at Site	Remarks
1	Access to building			
	<ul style="list-style-type: none"> • Road width • Gate width • Width of internal road 	06 mtr	More than 06 mtr	MR
		Directly accessible from the road	N/A
		N/A	N/A	N/A
2	Number, Width, Type and Arrangement of Exits			
	a. Number of Staircases			
	<ul style="list-style-type: none"> • Upper Floor • Basement 	02 Nos.	03 Nos.	MR
		N/A	N/A	N/A
	B. Width of Staircases			
	<ul style="list-style-type: none"> • Upper Floor • Basement 	1.25 mtr	1.30 mtr 1.22 mtr & 1.0 mtr (G to 1 st floor), 1.48 mtr (1 st to Mez. Floor)	MR being old bldg. prior to 1983
		N/A	N/A	N/A
	c. Protection of exits			
	<ul style="list-style-type: none"> • Fire check door • Pressurization 	N/A	N/A	N/A
		N/A	N/A	N/A
	e. No. of continuous staircases to terrace	01	01	MR
	g. Width of Corridor	N/A	N/A	N/A
	h. Door Size	1.5 Mtr	provided	N/A
3	Compartmentation.			
	<ul style="list-style-type: none"> • Fire check door • Sealing of electrical shafts • Fire rating of shaft door • Water curtain • Fire Dampers 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
4	Smoke Management System.			
	<ul style="list-style-type: none"> • Basement • Upper floor 	30 ACPH	N/A	N/A
		12 ACPH	provided	MR
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> • Total numbers • types 	08 Nos.	provided	MR
		ABC & W.Co2	provided	MR
	<ul style="list-style-type: none"> • ISI marking 	ISI marked	Provided	MR

MW


6	First-aid-Hose Reels.			
	Total numbers of each floor	1 no.	provided	MR
	• Length of hose reel hose	30 m	provided	MR
	• Nozzle diameter	05 mm	provided	MR
7	Automatic fire detection and alarming system.			
	• Type of detectors	N/A	N/A	N/A
	• Location of main panel	N/A	N/A	N/A
	• Location of repeater panel	N/A	N/A	N/A
	• Alternate source of power	N/A	N/A	N/A
	• Hooter's location	N/A	N/A	N/A
8	MOEFA	Required	Provided	MR
9	Public address System.	N/A	N/A	N/A
10	Automatic Sprinkler System.			
	• Basement	N/A	N/A	N/A
	• upper floor	Required	Provided	MR
	• sprinkler above false ceiling	Required	Provided	MR
11	Internal Hydrants			
	• size of riser/down-comer	100 mm	Provided	MR
	• Number of hydrants per floor	01 no.	Provided	MR
	• Hose Box	01 no.	Provided	MR
12	Yard Hydrants.			
	• Total number of hydrants	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
13	Pumping Arrangements.			
	• Ground Level	N/A	N/A	N/A
	➤ Discharge of main Pump	N/A	N/A	N/A
	➤ Head of Main Pump	N/A	N/A	N/A
	➤ Number of main pumps	N/A	N/A	N/A
	➤ Jockey pump out put	N/A	N/A	N/A
	➤ Jockey pump head	N/A	N/A	N/A
	➤ Standby pump out put	N/A	N/A	N/A
	➤ Standby pump Head	N/A	N/A	N/A
	➤ Auto Starting /Manual stopping	N/A	N/A	N/A
	➤ Pump House Access	N/A	N/A	N/A
	• Terrace Level			
	➤ Discharge of pump	900 Lpm&180 LPM	900 Lpm&180 LPM	MR
	➤ Head of the Pump	40Mtr.	40Mtr.	MR
	➤ Power supply	Required	Provided	MR
	➤ Auto Starting of pump	Required	Provided	MR
14	Captive Water Storage for Fire Fighting.			
	• Underground tank capacity	N/A	N/A	N/A
	➤ Draw-off connection	N/A	N/A	N/A
	➤ Fire service inlet	N/A	N/A	N/A
	➤ Access to tank	N/A	N/A	N/A
	• Overhead Tank capacity	10,000 ltrs	10,000 ltrs	MR
15	Exit Signage.	Required	Provided	MR


M

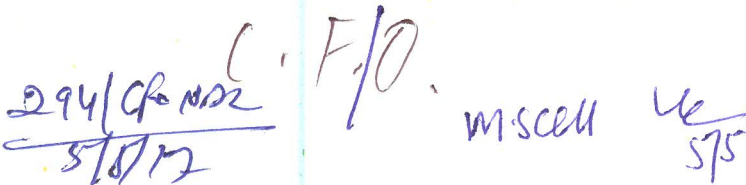
16	Provision of Lifts.			
	• Pressurization of Lift Shaft	N/A	N/A	N/A
	• Pressurization of Lift lobby	N/A	N/A	N/A
	• Communication in lift car	N/A	N/A	N/A
	• Firemen's grounding switch	N/A	N/A	N/A
	• Lift Signage	N/A	N/A	N/A
17	Standby power supply	Required	Provided (200KVA)	MR
18	Refuge Area.			
	• Total area	N/A	N/A	N/A
	• Location	N/A	N/A	N/A
19	Fire Control Room			
	• Detector system panel	N/A	N/A	N/A
	• Flow switch panel	N/A	N/A	N/A
	• PA system panel	N/A	N/A	N/A
	• Battery backup	N/A	N/A	N/A
	• Building Floor Plans	N/A	N/A	N/A
20	Special Fire Protection systems for protection of special Risks, if any:	Required	One ABC type fire extinguisher found provided near elect. panel	MR

The fire protection systems provided in the guest house were tested /checked at random and found functional at the time of inspection.

In view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules. The FSC issued vide letter no. F6/DFS/MS/EH/2013/NDZ/123 dated 26/03/2013 renewal under Rule 35 of the Delhi fire Service rules 2010, is recommended. It is recommended to renew Fire Safety Certificate.


Signature of the Inspecting Officer
Name: Sunil Chawdhary
Designation: Dy. Chief Fire Officer


Signature of the Inspecting Officer
Name: Manoj Sharma
Designation: (A.D.O/ C.C)


294/CP/MSR
5/8/12
C. F/O.
miscell
ve
575.