

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001

Fax No. 011-23412593, Ph. 011-23412225

No. F6/DFS/MS/School/2017/SZ/ 810

Dated: 07/06/17

FIRE SAFETY CERTIFICATE

Certified that the National Public School, located at Kalindi Colony, Maharani Bagh, New Delhi-110065 comprised of in two blocks ground + three upper Floors and ground + two upper floors both blocks interconnect with each other Owned/Occupied by School Management was inspected by officer concerned of this department on 18/05/2017 in the presence of Mr. Kuldeep (Manager) of the school and found that school have complied with the fire prevention and fire safety arrangements in accordance with Directorate of Education circular No. F.16/Fire Safety/2011/13298 to 3398 dated 01.03.2011 issued by Director of Education and the building/premises is fit for occupancy class "Educational Building Group-B" with effect from 07/06/2017 of the issue of this certificate for a period of **Three years** subject to conditions as mentioned below.

Issued on 07/06/17 at New Delhi by

Vipin Kental
Chief Fire Officer

Copy to: -

1. The Manager, National Public School, Kalindi Colony, Maharani Bagh, New Delhi-110065
2. The Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi.

Conditions for the validity of Fire Safety Certificate

1. All the fire safety and means of escape facilities shall be maintained in good working condition at all time. Any lapse rendering the fire safety or means of evacuation facilities non-functional shall be the responsibility of the management.
2. Building Sanctioning authority may verify any deviation with regard to construction/occupancy in the building. In case of any deviation, the fire safety certificate stands null & void.
3. The staff shall be trained for operating fire fighting system and mock evacuation drill be conducted at regular interval and record be maintained.
4. The basement shall be used strictly as per the provisions of Building Bye Laws.
5. The Owner/Occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules, 2010. The form is available on www.dfs.delhigovt.nic.in.
6. The Owner/Occupier shall apply for renewal of this Fire Safety Certificate to the Director in the form 'J' [sub rule (1) of rule 37] along with copy of this certificate, six months prior to its expiry. The form is available on www.dfs.delhigovt.nic.in.

INSPECTION REPORT

S. No	Minimum standards on Fire Prevention and Fire Safety U/R 33	DOE Circular Dt. 01/03/2011 requirement	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	• Road width	Accessible	9 mtr	MR
	• Gate width	NA	6 mtr × 2	NA
	• Width of internal road	NA	NA	NA
2	Number, width, type & arrangement of exits			
	a. Number of Staircase			
	➤ Upper floors	03 no's	03 no's	MR
		NA	NA	NA
	➤ Basement floor			
	b. Width of Staircase			
	➤ Upper floors	1.50m / 0.75m	1.50, 1.50 & 1.41m	MR
		NA	NA	NA
	➤ Basement floor			
	c. Protection of exits			
	➤ Fire check door	N/A	N/A	N/A
	➤ Pressurization	N/A	N/A	N/A
	d. No. of continuous staircase to terrace	One	Two	MR
	e. Width of corridor	N/A	N/A	N/A
	f. Door size	1.0 mtr	1.0 mtr	MR
3	Compartmentation.			
	• Fire check door.	N/A	N/A	N/A
	• Sealing of electrical shafts.	N/A	N/A	N/A
	• Fire rating of shaft door.	N/A	N/A	N/A
	• Water curtain	N/A	N/A	N/A
	• Fire dampers.	N/A	N/A	N/A
4.	Smoke Management system.			
	• Basement	N/A	N/A	N/A
	• Upper floors	N/A	N/A	N/A
5.	Fire Extinguishers.			
	• Total numbers	21No's	23 No's	MR
	• Types	ABC / Co2	ABC-23 No's	MR
	• ISI Marking	ISI Marked	Yes	MR
6.	First Aid Hose Reels.			
	• Total numbers on each floor.	Two	Two	MR
	• Length of hose-reel hose.	30 mtr	30 mtr	MR
	• Nozzle Diameter	05 mm	05 mm	MR


7	Automatic fire detection & alarming system.			
	• Type of detectors	N/A	N/A	N/A
	• Location of Main Panel	N/A	N/A	N/A
	• Location of Repeater Panel	N/A	N/A	N/A
	• Alternate source of power	N/A	N/A	N/A
	• Hooter's location	N/A	N/A	N/A
8.	MOEFA	N/A	N/A	N/A
9.	Public Address System	N/A	N/A	N/A
10.	Automatic Sprinkler System			
	• Basement.	N/A	N/A	N/A
	• Upper floors	N/A	N/A	N/A
	• Sprinkler above false ceiling	N/A	N/A	N/A
11.	Internal Hydrants.			
	• Size of Riser/Down-comer	N/A	N/A	N/A
	• Number of Hydrant per floor	N/A	N/A	N/A
	• Hose box.	N/A	N/A	N/A
12.	Yard Hydrants.			
	• Total number of hydrants.	N/A	N/A	N/A
	• Hose box.	N/A	N/A	N/A
13.	Pumping arrangements.			
	a) Ground Level			
	➤ Discharge of main pump.	N/A	N/A	N/A
	➤ Head of main pump.	N/A	N/A	N/A
	➤ Number of main pumps.	N/A	N/A	N/A
	➤ Jockey Pump output.	N/A	N/A	N/A
	➤ Jockey Pump head.	N/A	N/A	N/A
	➤ Standby Pump output.	N/A	N/A	N/A
	➤ Standby Pump head.	N/A	N/A	N/A
	➤ Auto Starting / Manual Stopping.	N/A	N/A	N/A
	➤ Pump house access.	N/A	N/A	N/A
	b) Terrace Level			
	➤ Discharge of pump.	450 LPM	450 LPM	MR
	➤ Head of pump.	40 mtr	40 mtr	MR
	➤ Power supply.	Required	Provided	MR
	➤ Auto starting of pump.	Required	Provided	MR
14.	Captive water storage for Fire Fighting.			
	• Underground tank capacity.	N/A	N/A	N/A
	➤ Draw-off connection.	N/A	N/A	N/A
	➤ Fire Service Inlet.	N/A	N/A	N/A
	➤ Access to tank.	N/A	N/A	N/A
	• Overhead tank capacity.	10,000 Ltr	Provided	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	• Pressurization of lift shaft.	N/A	N/A	N/A
	• Pressurization of lift lobby.	N/A	N/A	N/A
	• Communication in lift car.	N/A	N/A	N/A
	• Fireman's switch.	N/A	N/A	N/A
	• Lift signage.	N/A	N/A	N/A
17	Standby Power Supply	N/A	N/A	N/A
18.	Refuge Area			
	• Total area	N/A	N/A	N/A
	• Location	N/A	N/A	N/A

19.	Fire Control Room.			
	• Detector System Panel.	N/A	N/A	N/A
	• Flow Switch Panel.	N/A	N/A	N/A
	• PA system Panel.	N/A	N/A	N/A
	• Battery backup	N/A	N/A	N/A
	• Building floor plan	N/A	N/A	N/A
20.	Special Fire Protection System for the Protection of special Risk, if any.			N/A

The Fire protection systems provided in the building were checked randomly and found functional at the time of inspection.


Keeping in view of the substantial compliance of the minimum standards on fire prevention and fire safety measures as required under the rules, it is recommended to issue Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules, 2010.


Accordingly DFA is put up for approval and signature please.

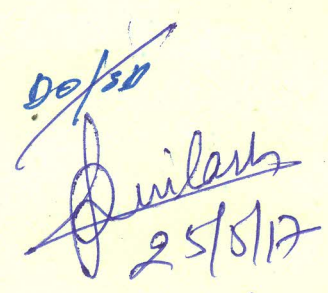

 Signature of the Inspecting Officer
 Name : R.N. Singh
 Designation: ADO

D. O. (SD)

Kindly indicate the document since when the school is running in this building.

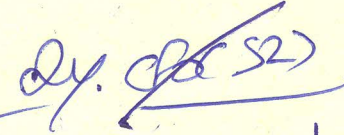

24/5/17



Sir please, see on c/22, a letter issued from Delhi municipal corporation No 1770. plz


25/5/17

901/cfo s2
29/5-17/6/17






26/5

cfo s21 m. stell 29/5

F.T letter is put up for sign. plz.