

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001

Fax No. 011-23412593, Ph. 011-23412225.

No. F.6/DFS/MS/Instt/2017/SZ/ 1029

Dated: 13/07/17

**FIRE SAFETY CERTIFICATE**

Certified that the **Institute of Sanskrit and Vedic Studies** located at **Plot No-3, Phase-II, Institutional Area, Vasant Kunj, New Delhi**, comprised of **Institute Block** for education purpose (Basement, Ground plus three upper floors) & **Health & Hostel Block** (Basement, ground plus two upper floors) **Owned/Occupied** by **Sri Ram Vittala Shikshana Seva Samiti** was inspected by officer concerned of this department on 20/06/2017 in the presence of Mr. Devi Singh (Admin) of the institute and observed that said building/premises have complied with the fire prevention and fire safety arrangements in accordance with rule 33 of Delhi Fire Service Rules, 2010 and that the building/premises is fit for occupancy class "**Educational Building (Institute)**" as above with effect from the date of issue of this certificate for a period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 13/07/17 at New Delhi by

W 13/7.  
(Vipin Kental)  
Chief Fire Officer  
f.

Copy to: -

1. The Manager, Institute of Sanskrit and Vedic Studies, Plot No-3, Phase-II, Institutional Area, Vasant Kunj, New Delhi-110070
2. The Joint Director (L & I), DDA, Building Section, Vikas Sadan, INA, New Delhi.

**Conditions for the validity of Fire Safety Certificate**

1. All the fire safety and means of escape facilities shall be maintained in good working condition at all time. Any lapse rendering the fire safety or means of evacuation facilities non-functional shall be the responsibility of the management.
2. Building Sanctioning authority may verify any deviation with regard to construction/occupancy in the building. In case of any deviation, the fire safety certificate stands null & void.
3. The staff shall be trained for operating fire fighting system and mock evacuation drill be conducted at regular interval and record be maintained.
4. The basement shall be used strictly as per the provisions of Building Bye Laws.
5. The Owner/Occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules, 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).
6. The Owner/Occupier shall apply for renewal of this Fire Safety Certificate to the Director in the form 'J' [sub rule (1) of rule 37] along with copy of this certificate, six months prior to its expiry. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).

## INSPECTION REPORT

1	Name & Address of the Building	Institute of Sanskrit & Vedic at Plot No-3, Phase-II, Vasant Kunj, New Delhi-110070		
2	Type of Occupancy	Educational Building (Institute)		
3	Building Comprised of	Institutional Block No-1- Basements, Gd. + 3 upper floors Health & Hostel Block No-2- Basement, Gd + 2 upper floors		
4	Type of Case	New		
5	Details of Previous NOC	Nil		
6	Fire Safety Directives Letter No	F.6/DFS/MS/BP/2002/2496 dated 26/12/2002		
7	Date of Inspection	20-06-2017		
8	Name of the Inspecting Officers	ADO R.N. Singh		
9	Name & Designation of Officers from the building side	Mr. Devi Singh (Admin)		
10	Year of construction	2014		
11	Applicant letter No.	SR/VSSS/2016-17/2 dated Nil (C-23)		
S. No	Minimum standards on Fire Prevention and Fire Safety U/R 33	NBC / BBL Requirements	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	• Road width	9 Mts.	9 Mts.	MR
	• Gate width	5 Mts.	6 Mts.	MR
	• Width of internal road	NA	NA	NA
2	Number, width, type & arrangement of exits			
	a) Number of Staircase			
	• Upper floors	Block 1 : 1 No's Block 2 : 2 No's	Block 1 : 2 No's Block 2 : 2 No's	MR
	• Basement floor	Block 1 : 3 + 1 Ramp Block 2 : 2 No's	Block 1 : 3 + 1 Ramp Block 2 : 2 No's	MR
	b) Width of Staircase			
	• Upper floors	Block 1 : 1.5m & 0.75m (fire escape) Block 2 : 1.5m each	Block 1 : 1.50m & 1.35m Block 2 : 1.5 mtr each	MR
	• Basement floor	1.50 m in each block	Block 1- 1.50m each and ramp - 4.07m Block 2 : 1.50 m each	MR
	c) Protection of exits			
	• Fire check door	Required	Provided	MR
	• Pressurization	NA	NA	NA
	d) No. of continuous staircase to terrace	One in each block	Two in each block	MR
	e) Width of corridor	NA	NA	NA
	f) Door size	1 m	1 m	MR
3	Compartmentation.			
	• Fire check door.	NA	NA	NA
	• Sealing of electrical shafts.	NA	NA	NA
	• Fire rating of shaft door.	NA	NA	NA
	• Water curtain	NA	NA	NA
	• Fire dampers.	NA	NA	NA
4.	Smoke Management system.			
	• Basement	Required	Provided	MR
	• Upper floors	NA	NA	NA
5.	Fire Extinguishers.			
	• Total numbers	22 No's	22 No's	MR
	• Types	ABC / CO2	ABC-22 No's	MR
	• ISI Marking	ISI Marked	Provided	MR
6.	First Aid Hose Reels.			
	• Total numbers on each floor.	One in each block	One in each block	MR
	• Length of hose-reel hose.	30 Mts.	30 Mts.	MR
	• Nozzle Diameter	5 mm	5 mm	MR


7	<b>Automatic fire detection &amp; alarming system</b>			
	• Type of detectors	Required	Provided	MR
	• Location of Main Panel	Required	Provided	MR
	• Location of Repeater Panel	NA	NA	NA
	• Alternate source of power	Required	Provided	MR
	• Hooter's location	Required	Provided	MR
8.	<b>MOEFA</b>	Required	Provided	MR
9.	<b>Public Address System</b>	NA	NA	NA
10.	<b>Automatic Sprinkler System</b>			
	• Basement	Required	Provided	MR
	• Upper floors	NA	NA	NA
	• Sprinkler above false ceiling	NA	NA	NA
11.	<b>Internal Hydrants.</b>			
	• Size of Riser / Down-comer	100 mm (each block)	Provided	MR
	• Number of Hydrant per floor	1 No	Provided	MR
	• Hose box.	1 No	Provided	MR
12.	<b>Yard Hydrants.</b>			
	• Total number of hydrants.	3 Nos.	3 Nos.	MR
	• Hose box.	3 Nos.	3 Nos.	MR
13.	<b>Pumping arrangements.</b>			
	<b>a) Ground Level</b>	.....	.....	.....
	➤ Discharge of main pump.	2850 LPM	2850 LPM	MR
	➤ Head of main pump.	75m	75m	MR
	➤ Number of main pumps.	1 No	1 No	MR
	➤ Jockey Pump output.	180 LPM	180 LPM	MR
	➤ Jockey Pump head.	75m	75m	MR
	➤ Standby Pump output.	2850 LPM	2850 LPM	MR
	➤ Standby Pump head.	75m	75m	MR
	➤ Auto Starting / Manual Stopping.	Required	Provided	MR
	<b>b) Terrace Level</b>	.....	.....	.....
	➤ Discharge of pump.	900 LPM × 2	900 LPM × 2	MR
	➤ Head of pump.	40 Mts.	As above	MR
	➤ Power supply.	Required	As above	MR
	➤ Auto starting of pump.	required	As above	MR
14.	<b>Captive water storage for Fire Fighting.</b>			
	• Underground tank capacity.	1, 00,000 Ltr.	1, 00,000 Ltr.	MR
	➤ Draw-off connection.	Required	Provided	MR
	➤ Fire Service Inlet.	Required	Provided	MR
	➤ Access to tank.	Required	Provided	MR
	• Overhead tank capacity.	20,000 Ltr.	20,000 Ltr.	MR
15.	<b>Exit Signage.</b>	Required	Provided	MR
16.	<b>Provision of Lifts.</b>			
	• Pressurization of lift shaft.	NA	NA	NA
	• Pressurization of lift lobby.	NA	NA	NA
	• Communication in lift car.	NA	NA	NA
	• Fireman's switch.	NA	NA	NA
	• Lift signage.	NA	NA	NA
17	<b>Standby Power Supply</b>	Required	Provided	MR
18.	<b>Refuge Area</b>			
	• Total area	NA	NA	NA
	• Location	NA	NA	NA

19.	<b>Fire Control Room.</b> 1. Detector System Panel. 2. Flow Switch Panel. 3. PA system Panel. 4. Battery backup 5. Building floor plan	NA NA NA NA NA	NA NA NA NA NA	NA NA NA NA NA
20.	<b>Special Fire Protection System for the Protection of special Risk, if any.</b>	NA	NA	NA

The Fire protection systems provided in the building were checked randomly and found functional at the time of inspection. The shortcomings communicated vide letter no. F.6/DFS/MS/2017/SZ/1240 dated 12/05/17 have been complied.

Keeping in view of the substantial compliance of the minimum standards on fire prevention and fire safety measures as required under the rules, it is recommended to issue Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules, 2010.


Accordingly DFA is put up for approval and signature please.



Signature of the Inspecting Officer  
Name : R.N. Singh  
Designation: ADO

Instt of Sanskrit & Vedic Studies at Plot No-3, Phase-II, Institutional Area, Vasant Kunj, New Delhi-70

DO (SD)

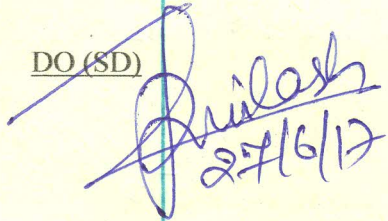  
27/6/17

