

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001

Fax No. 011-23412593, Ph. 011-23412225


No. F.6/DFS/MS/Cinema/2017/SZ/ 1130

Dated: 28/7/17.

FIRE SAFETY CERTIFICATE

Certified that the PVR at Select City Walk Mall, located at District Center, Saket, New Delhi, building comprised of Three tier Basement, Ground + 07 upper floors, auditorium block with two tier basement, ground and two upper floors was granted FSC by this department vide letter No. F6/DFS/MS/Cinema/2007/3367 dated 06/11/2007. The premises was re-inspected by the officer concerned of this department on 05/07/2017 in the presence of Mr. Amit Tyagi (Head of PVR) and observed that the said building/premises have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the premises is fit for occupancy class "Assembly Building, Group-D" with effect from the date of issuance of this certificate for a period of Three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 28/7/17 at New Delhi by


Vipin Kental
Chief Fire Officer

Copy to: -


1. The Authorised Signatory, PVR, Select City, District Center, Saket, New Delhi-110017
2. The Joint Comm. of Police (Lic.), 1st floor, P.S. Defence Colony, New Delhi-110049

Conditions for the validity of Fire Safety Certificate

1. All the fire safety and means of escape facilities shall be maintained in good working condition at all time. Any lapse rendering the fire safety or means of evacuation facilities non-functional shall be the responsibility of the management.
2. Building Sanctioning authority may verify any deviation with regard to construction/occupancy in the building. In case of any deviation, the fire safety certificate stands null & void.
3. The staff shall be trained for operating fire fighting system and mock evacuation drill be conducted at regular interval and record be maintained.
4. The basement shall be used strictly as per the provisions of Building Bye Laws.
5. The Owner/Occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules, 2010. The form is available on www.dfs.delhigovt.nic.in.
6. The Owner/Occupier shall apply for renewal of this Fire Safety Certificate to the Director in the form 'J' [sub rule (1) of rule 37] along with copy of this certificate, six months prior to its expiry. The form is available on www.dfs.delhigovt.nic.in.

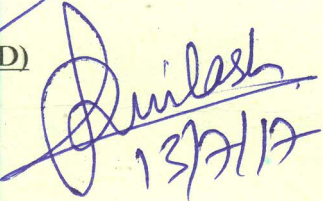
INSPECTION REPORT				
1	Name & Address of the Building	PVR at Select City Walk Mall, Plot No. A-3, District Centre, Saket, New Delhi-110017		
2	Type of Occupancy	Assembly Building "Group-D" (Cinema)		
3	Building Comprised of	3 Tier Basements, Ground + 07 upper floors Auditoriums block having two tier basement, ground and two upper floors.		
4	Type of Case	Renewal		
5	Details of Previous NOC	F.6/DFS/MS/Cinema/2007/3367 Dated 06/11/2007		
6	Fire Safety Directives Letter No	F.6/DFS/MS/BP/2004/3084 Dated 21/12/2004		
7	Date of Inspection	05-07-2017		
8	Name of the Inspecting Officers	ADO R.N. Singh		
9	Name & Designation of Officers from the building side	Mr. Amit Tyagi (Head of PVR)		
10	Year of construction	Ground floor (Audi-1 & 2 with projector & snacks stall), 2 nd floor- (Audi-3, 4, 5 & 6 with projector & snacks stall)		
11	Applicant letter No.	Nil dated 03.05.2017, ODD No.		
S. No	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC (06/11/2007) requirement	Provided at Site	Remarks MR/NMR
1	Access to Building.	F.6/DFS/MS/Mall/2015/SZ/232 Dated 18/02/2015		
	1. Road width	Required	As above	MR
	2. Gate width	NA	As above	NA
	3. Width of internal road	NA	As above	NA
2	Number, width, type & arrangement of exits.	Provided & Maintained by Select City Walk Mall		
	a. Number of Staircase	Provided & Maintained by Select City Walk Mall		
	1. Upper floors	Required	As above	MR
	2. Basement floor	NA	As above	NA
	b. Width of Staircase	Provided & Maintained by Select City Walk Mall		
	1. Upper floors	Required	As above	MR
	2. Basement floor	NA	As above	NA
	c. Protection of exits	Provided & Maintained by Select City Walk Mall		
	1. Fire check door	NA	As above	NA
	2. Pressurization	NA	As above	NA
	d. No. of continuous staircase to terrace	Required	As above	MR
	e. Width of corridor	NA	NA	NA
	f. Door size /Exits	Required	1.60 m	MR (old case as approved on plans)
3	Compartmentation.	Provided & Maintained by Select City Walk Mall		
	1. Fire check door.	NA	As above	NA
	2. Sealing of electrical shafts.	Required	Provided	MR
	3. Fire rating of shaft door.	NA	As above	NA
	4. Water curtain	NA	As above	NA
	5. Fire dampers.	NA	As above	NA
4.	Smoke Management system.	Provided & Maintained by Select City Walk Mall		
	1. Basement	NA	As above	NA
	2. Upper floors	Required	Provided	MR
5.	Fire Extinguishers.	Provided & Maintained by Select City Walk Mall		
	1. Total numbers	50 No's	68 No's	MR
	2. Types	ABC/Co2/W.Co2	Co2- 38, W.Co2-26, ABC-04	MR
	3. ISI Marking	ISI marked	Provided	MR
6.	First Aid Hose Reels.	Provided & Maintained by Select City Walk Mall		
	1. Total numbers on each floor.	Hose Reel	As above	MR
	2. Length of hose-reel hose.	In each Audi	As above	MR
	3. Nozzle Diameter		As above	MR

7	Automatic fire detection & alarming system.	Provided & Maintained by Select City Walk Mall		
	1. Type of detectors	Required	Heat & Smoke	MR
	2. Location of Main Panel	Required	As above	MR
	3. Location of Repeater Panel	NA	As above	NA
	4. Alternate source of power	Required	As above	MR
	5. Hooter's location	Required	As above	MR
8.	MOEFA	Required	As above	MR
9.	Public Address System	NA	As above	NA
10.	Automatic Sprinkler System	Provided & Maintained by Select City Walk Mall		
	1. Basement	NA	As above	NA
	2. Upper floors	Required	As above	NA
	3. Sprinkler above false ceiling	NA	NA	NA
11.	Internal Hydrants.	Provided & Maintained by Select City Walk Mall		
	1. Size of Riser/Down-comer	Required	As above	MR
	2. Number of Hydrant per floor	Required	As above	MR
	3. Hose box.	Required	As above	MR
12.	Yard Hydrants.	Provided & Maintained by Select City Walk Mall		
	1. Total number of hydrants.	NA	As above	NA
	2. Hose box.	NA	As above	NA
13.	Pumping arrangements.	Provided & Maintained by Select City Walk Mall		
	• Ground Level	Provided & Maintained by Select City Walk Mall		
	➤ Discharge of main pump.	NA	As above	NA
	➤ Head of main pump.	NA	As above	NA
	➤ Number of main pumps.	NA	As above	NA
	➤ Jockey Pump output.	NA	As above	NA
	➤ Jockey Pump head.	NA	As above	NA
	➤ Standby Pump output.	NA	As above	NA
	➤ Standby Pump head.	NA	As above	NA
	➤ Auto Starting/Manual Stopping.	NA	As above	NA
	• Terrace Level	Provided & Maintained by Select City Walk Mall		
	➤ Discharge of pump.	Required	As above	MR
	➤ Head of pump.	Required	As above	MR
	➤ Power supply.	Required	As above	MR
	➤ Auto starting of pump.	Required	As above	MR
14.	Captive water storage for Fire Fighting.	Provided & Maintained by Select City Walk Mall		
	• Underground tank capacity.	NA	As above	NA
	➤ Draw-off connection.	NA	As above	NA
	➤ Fire Service Inlet.	NA	As above	NA
	➤ Access to tank.	Required	As above	MR
	• Overhead tank capacity.	Required	As above	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.	Provided & Maintained by Select City Walk Mall		
	1. Pressurization of lift shaft.	NA	As above	NA
	2. Pressurization of lift lobby.	NA	As above	NA
	3. Communication in lift car.	NA	As above	NA
	4. Fireman's switch.	NA	As above	NA
	5. Lift signage:	NA	As above	NA
17.	Standby Power Supply	Required	As above	MR
18.	Refuge Area	Provided & Maintained by Select City Walk Mall		
	1. Total area	NA	NA	NA
	2. Location	NA	NA	NA


19.	Fire Control Room.	Provided & Maintained by Select City Walk Mall		
	1. Detector System Panel.	Required	As above	MR
	2. Flow Switch Panel.	NA	As above	NA
	3. PA system Panel.	Required	As above	MR
	4. Battery backup	Required	As above	MR
	5. Building floor plan	NA	As above	NA
20.	Special Fire Protection System for the Protection of special Risk, if any:	Required	Co2 flooding provided near electrical panel	MR
Details of Seating Capacity & Exits are as below: -				
Seats: <u>Audi-1</u> <u>Audi-2</u> <u>Audi-3</u> <u>Audi-4</u> <u>Audi-5</u> <u>Audi-6</u>				
40 40 345 395 164 168				
Exits: 3 3 6 6 3 4				
<p>The Fire protection systems provided in the building were checked randomly and found functional at the time of inspection. Shortcomings communicated vide letter no. F6/DFS/MS/Cinema/2017/SZ/134 dated 18/01/2017 at serial no. 1, 2,4 found complied and shortcoming at serial no. 3 may be deemed complied in view of applicant representation at C-181 and record on file at C-143.</p> <p>Keeping in view of the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under the rule, NOC issued vide letter No. F.6/DFS/MS/Cinema/2007/3367 dated 06-11-2007, renewal under rule 37 of the Delhi Fire Service rules, 2010 is recommended.</p> <p>Accordingly, DFA is put up for approval and signature please.</p>				
<p style="text-align: right;">  Signature of the Inspecting Officer Name : R.N. Singh Designation: ADO </p>				

PVR at Select City Walk Mall, District Centre, Saket, New Delhi

DO (SD)


13/7/17

1077/cfo 52
24/7 13/7/17 dy. cfo (52)


13/7



CFO (52)

M. S. Khan

F.T.O.

24/7