

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI

HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001

Fax No. 011-23412593, Ph. 011-23412225

No. F.6/DFS/MS/Mixed/2017/SZ/ 1388

Dated: 18/8/17

FIRE SAFETY CERTIFICATE

Certified that the **Eros Cine World** located at **Jangpura Extension, New Delhi-110014**, building comprised of **Two tier basement, ground + 2 upper floors**, was granted NOC by this department vide letter No. F.6/DFS/MS/Cinema/2010/1408 dated 12/05/2010. The premises was re-inspected by the officer concerned of this department on 07/09/2017 in the presence of Mr. Kailash Vohra (Manager) and observed that the said building/premises have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the premises is fit for occupancy class "**Mixed**" (Assembly & Business) as above with effect from the date of issue of this certificate for a period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 18/8/17 at New Delhi by


Vipin Kental
Chief Fire Officer

Copy to: -

1. The Authorised Signatory, M/s Eros Cine World, Jangpura Extn., New Delhi-110014
2. The Joint Comm. of Police (Lic.), 1st floor, P.S. Defence Colony, New Delhi-110049

Conditions for the validity of Fire Safety Certificate

1. All the fire safety and means of escape facilities shall be maintained in good working condition at all time. Any lapse rendering the fire safety or means of evacuation facilities non-functional shall be the responsibility of the management.
2. Building Sanctioning authority may verify any deviation with regard to construction/occupancy in the building. In case of any deviation, the fire safety certificate stands null & void.
3. The staff shall be trained for operating fire fighting system and mock evacuation drill be conducted at regular interval and record be maintained.
4. The basement shall be used strictly as per the provisions of Building Bye Laws.
5. This Certificate cannot be treated as regularization of unauthorized construction, if any.
6. The Owner/Occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules, 2010. The form is available on www.dfs.delhigovt.nic.in.
7. The Owner/Occupier shall apply for renewal of this Fire Safety Certificate to the Director in the form 'J' [sub rule (1) of rule 37] along with copy of this certificate, six months prior to its expiry. The form is available on www.dfs.delhigovt.nic.in.

INSPECTION REPORT

1	Name & Address of the Building	EROS CINE WORLD, EROS CINEMA BUILDING, JANGPURA EXTENSION, NEW DELHI-110014		
2	Type of Occupancy	Assembly Building "Group-D" (Cinema)		
3	Building Comprised of	2 Tier Basements, Ground + 2 upper floors		
4	Type of Case	Renewal		
5	Details of Previous NOC	F.6/DFS/MS/Cinema/2010/1408 dated 12-05-2010		
6	Fire Safety Directives Letter No	F.6/DFS/MS/BP/2005/13 dated 07-01-2005		
7	Date of Inspection	07-09-2017		
8	Name of the Inspecting Officers	ADO R.N. Singh		
9	Name & Designation of Officers from the building side	Sh. Kailash Vohra (Manager)		
10	Year of construction	2005	Basement 1 & 2 (car parking) ground floor (two restaurants, booking window & cinema hall), 1 st & 2 nd floor (cinema hall, building office & projector)	
11	Applicant letter No.	Nil dated 02.08.2017 (C-181)		
S. No	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC (12/05/2010) requirement	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	1. Road width	Required	9 mtr	MR
	2. Gate width	Required	5 mtr (2 No's)	MR
	3. Width of internal road	Required	4.5 mtr	MR
2	Number, width, type & arrangement of exits.			
	a. Number of Staircase			
	1. Upper floors	4 No's	4 No's	MR
	2. Basement floor	3 + 2 ramp + 2 lift	3 No's + 2 ramps + 2 lift	MR
	b. Width of Staircase			
	1. Upper floors	1.5m (3), 2m (1)	1.5m (3) & 2.0m (1),	MR
	2. Basement floor	1.5 m	1.5 m (3) & ramp- 3.60m	MR
	c. Protection of exits			
	1. Fire check door	Required	Provided	NA
	2. Pressurization	Required	Provided	NA
	d. No. of continuous staircase to terrace	Required	3 No's	MR
	e. Width of corridor	NA	NA	NA
	f. Door size /Exits	Required	1.70m (3) & 1.65m (1)	MR (old case)
3	Compartmentation.			
	1. Fire check door.	Required	Provided in stairs & Drop curtain- lifts	MR
	2. Sealing of electrical shafts.	Required	Provided	MR
	3. Fire rating of shaft door.	Required	Provided	MR
	4. Water curtain	NA	NA	NA
	5. Fire dampers.	Required	Provided	MR
4.	Smoke Management system.			
	1. Basement	30ACPH	Provided	MR
	2. Upper floors	12 ACPH	Provided	MR
5.	Fire Extinguishers.			
	1. Total numbers	40 No's	43 No's	MR
	2. Types	ABC/Co2/	ABC-20, Co2-23	MR
	3. ISI Marking	ISI marked	Provided	MR
6.	First Aid Hose Reels.			
	1. Total numbers on each floor.	3 No's	3 No's	MR
	2. Length of hose-reel hose.	30 m	30 m	MR
	3. Nozzle Diameter	5 mm	5 mm	MR


7	Automatic fire detection & alarming system. 1. Type of detectors 2. Location of Main Panel 3. Location of Repeater Panel 4. Alternate source of power 5. Hooter's location	Required	Smoke & Beam	MR		
		Required	Control Room	MR		
		Required	Near staircase	MR		
		Required	Provided	MR		
		Required	Entire building	MR		
8.	MOEFA	Required	Provided	MR		
9.	Public Address System	Required	Provided	MR		
10.	Automatic Sprinkler System					
	1. Basement 2. Upper floors 3. Sprinkler above false ceiling	Required	Provided	MR		
		Required	Provided	MR		
		Required	Provided	MR		
11.	Internal Hydrants.					
	1. Size of Riser/Down-comer 2. Number of Hydrant per floor 3. Hose box.	Required	150 mm	MR		
		Required	3 No's	MR		
		Required	3 No's	MR		
12.	Yard Hydrants.					
	1. Total number of hydrants. 2. Hose box.	Required	4 No's	MR		
		Required	4 No's	MR		
13.	Pumping arrangements.					
	<ul style="list-style-type: none"> • Ground Level <ul style="list-style-type: none"> ➤ Discharge of main pump. ➤ Head of main pump. ➤ Number of main pumps. ➤ Jockey Pump output. ➤ Jockey Pump head. ➤ Standby Pump output. ➤ Standby Pump head. ➤ Auto Starting/Manual Stopping. ➤ Pump house access. • Terrace Level <ul style="list-style-type: none"> ➤ Discharge of pump. ➤ Head of pump. ➤ Power supply. ➤ Auto starting of pump. 	2850 LPM	2850 LPM for entire bldg.	MR		
		60 mtr	60 mtr	MR		
		2 No's	2 No's for entire bldg.	MR		
		180 LPM	180 LPM for entire bldg.	MR		
		60 mtr	60 mtr	MR		
		2850 LPM	2850 LPM for entire bldg.	MR		
		60 mtr	60 mtr	MR		
		Required	Provided	MR		
		Required	Provided	MR		
		NA	NA	NA		
		NA	NA	NA		
		NA	NA	NA		
		Required	Provided	MR		
		14.	Captive water storage for Fire Fighting.			
			<ul style="list-style-type: none"> • Underground tank capacity. <ul style="list-style-type: none"> ➤ Draw-off connection. ➤ Fire Service Inlet. ➤ Access to tank. • Overhead tank capacity. 	2,00,000 ltrs	Provided for entire bldg	MR
				Required	Provided	MR
NA	NA			NA		
Required	Provided			MR		
30,000 ltrs	Provided for entire bldg			MR		
15.	Exit Signage.	Required	Provided	MR		
16.	Provision of Lifts.					
	1. Pressurization of lift shaft. 2. Pressurization of lift lobby. 3. Communication in lift car. 4. Fireman's switch. 5. Lift signage.	Required	Provided	MR		
		Required	Provided	MR		
		Required	Provided	MR		
		Required	Provided	MR		
		Required	Provided	MR		
17	Standby Power Supply	Required	Provided	MR		
18.	Refuge Area					
	1. Total area 2. Location	NA	NA	NA		
		NA	NA	NA		

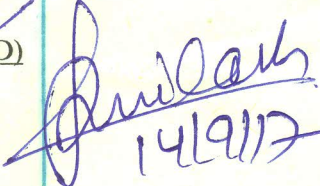
19.	Fire Control Room.	1. Detector System Panel.	Required	Provided	MR
		2. Flow Switch Panel.	Required	Provided	MR
		3. PA system Panel.	Required	Provided	MR
		4. Battery backup	Required	Provided	MR
		5. Building floor plan	Required	Provided	MR
20.	Special Fire Protection System for the Protection of special Risk, if any:	Required	Co2 flooding provided for electrical panel	MR	

The Fire protection systems provided in the building were checked / operated randomly and found functional at the time of inspection. Shortcomings communicated vide letter no.

Keeping in view of the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under the rule, NOC issued vide letter No. F.6/DFS/MS/Cinema/2010/1408 dated 12-05-2010, renewal under rule 37 of the Delhi Fire Service rules, 2010 is recommended.

Accordingly, DFA is put up for approval and signature please.


 Signature of the Inspecting Officer
 Name : R.N. Singh
 Designation: Asstt. Div. Officer

DO (SD)

 14/9/17

cfoc (SD)

camp
 15/9


FT/101

cfoc (sy)

m-scell

W
 18/9

1233/cfo 2
 19/9

F.T letter is put up for sign. vide 
 18/9

cfoc/sp2

m-scell

W
 19/9

