

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001**


No. F.6/DFS/MS/EH/2017/SZ/ 1504

Dated: 18/10/17

**FIRE SAFETY CERTIFICATE**

Certified that M/s **Haldiram Restaurant** located at **Ground, First & Second floor of B-1/H-8, M.C.I.E., Main Mathura Road, New Delhi-110044**, building comprised of **Basement, Ground plus two upper floors** (Main building has already been issued FSC vide letter dated 18/11/2015) **Owned/Occupied** by M/s Haldiram Marketing Pvt. Ltd. was granted Fire Safety Certificate by this department vide letter No. F.6/DFS/MS/EH/2014/SZ/1316 dated 21/10/2014. The restaurant premises was re-inspected by the officer concerned of this department on 07/09/2017 in the presence of Mr. SK Jain (Manager) and found that the said restaurant have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the building/premises is fit for occupancy class-D "Assembly" (restaurant) as above with effect from the date of issue of this certificate for a period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 18/10/17 at New Delhi by

  
(Vipin Kental)  
Chief Fire Officer  
Ph. 011-23412225

Copy to: -

1. The Additional C.P. (Lic.) 1st floor, Police Station Defence Colony, New Delhi-110049
2. The Manager, M/s Haldiram Restt., B-1/H-8, M.C.I.E, Mathura Road, New Delhi-110044
3. M/s Haldiram Marketing Pvt. Ltd., B-1/H-8/1, M.C.I.E, Main Mathura Road, N Delhi-44

**Conditions for the validity of Fire Safety Certificate**

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of firefighting system.
4. The basement shall be used strictly as per the provisions of Building Bye Laws.
5. The Owner/Occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules, 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).
6. The Owner/Occupier shall apply for renewal of this Fire Safety Certificate to the Director in the form 'J' [sub rule (1) of rule 37] along with copy of this certificate, six months prior to its expiry. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).
7. This FSC will become null & void, if the FSC of the main premise is not renewed under rule 37 of DFS Rules-2010
8. The capacity of O.H. tank should be made from 10,000 ltrs to 20,000 ltrs before next renewal.

## INSPECTION REPORT


1	Name & Address of the Building	HALDIRAM RESTAURANT, located at Plot No. B-1/ H-8, M.C.I.E., Mathura Road, New Delhi-110044		
2	Type of Occupancy	Assembly buildings 'Group-D'		
3	Building comprised of	Basement, Ground plus two upper floors.		
4	Type of Case	Renewal		
5	Details of Previous NOC	F.6/DFS/MS/EH/2014/SZ/1316 Dated 21-10-2014		
6	Fire Safety Directives Letter No	Nil		
7	Date of Inspection	07-09-2017		
8	Name of the Inspecting Officers	ADO R.N. Singh		
9	Name & Designation of Officers from the building side	Mr. SK Jain (Manager)		
10	Year of construction	2011	Restt at ground, 1 <sup>st</sup> & 2 <sup>nd</sup> floor of the bldg	
11	Applicant letter No.	Nil dated 08.08.2017		
S. No	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC requirement	Provided at Site	Remarks MR/NMR
1	<b>Access to Building.</b>			
	• Road width	Approachable	6 mtr	MR
	• Gate width	N/A	N/A	N/A
	• Width of internal road	N/A	N/A	N/A
2	<b>Number, width, type &amp; arrangement of exits</b>			
	<b>a. Number of Staircase</b>			
	• Upper floors	Required	Two	MR
	• Basement floor	N/A	N/A	N/A
	<b>b. Width of Staircase</b>			
	• Upper floors	1.50m + 1.25m	1.5m & 1.25m	MR
	• Basement floor	N/A	N/A	N/A
	<b>c. Protection of exits</b>			
	• Fire check door	N/A	N/A	N/A
	• Pressurization	N/A	N/A	N/A
	<b>d. No. of continuous staircase to terrace</b>	Required	One	MR
	<b>e. Width of corridor</b>	N/A	N/A	N/A
	<b>f. Door size</b>	N/A	1.5 mtr	N/A
3	<b>Compartmentation.</b>			
	• Fire check door.	N/A	N/A	N/A
	• Sealing of electrical shafts.	N/A	N/A	N/A
	• Fire rating of shaft door.	N/A	N/A	N/A
	• Water curtain	N/A	N/A	N/A
	• Fire dampers.	N/A	N/A	N/A
4.	<b>Smoke Management system.</b>			
	• Basement	N/A	N/A	N/A
	• Upper floors	Required in Kitchen	Provided	MR
5.	<b>Fire Extinguishers.</b>			
	• Total numbers	6 No's	10 No's	MR
	• Types	ABC / Co2	ABC-06, Co2-04	MR
	• ISI Marking	ISI marked	Provided	MR
6.	<b>First Aid Hose Reels.</b>			
	• Total numbers on each floor.	One	One	MR
	• Length of hose-reel hose.	30 m	30 m	MR
	• Nozzle Diameter	5 mm	5 mm	MR

Renewal

M/s Haldiram Restt., B-1, H-8, M.C.I.E., Main Mathura Road, New Delhi

7. Automatic fire detection & alarming system.		Not required		
<ul style="list-style-type: none"> <li>• Type of detectors</li> <li>• Location of Main Panel</li> <li>• Location of Repeater Panel</li> <li>• Alternate source of power</li> <li>• Hooter's location</li> </ul>		N/A	Smoke type	N/A
		N/A	Ground floor	N/A
		N/A	N/A	N/A
		N/A	Provided	N/A
		N/A	Each floor	N/A
8.	<b>MOEFA</b>	Required	Provided	MR
9.	<b>Public Address System</b>	N/A	N/A	N/A
10.	<b>Automatic Sprinkler System</b>			
<ul style="list-style-type: none"> <li>• Basement</li> <li>• Upper floors</li> <li>• Sprinkler above false ceiling</li> </ul>		N/A	N/A	N/A
		Required	Provided	MR
		N/A	N/A	N/A
11.	<b>Internal Hydrants.</b>			
<ul style="list-style-type: none"> <li>• Size of Riser/Down-comer</li> <li>• Number of Hydrant per floor</li> <li>• Hose box.</li> </ul>		Required	100 mm	MR
		Required	One	MR
		Required	One	MR
12.	<b>Yard Hydrants.</b>			
<ul style="list-style-type: none"> <li>• Total number of hydrants.</li> <li>• Hose box.</li> </ul>		Required	Two	MR
		Required	Two	MR
13.	<b>Pumping arrangements.</b>			
<ul style="list-style-type: none"> <li>• <b>Ground Level</b> <ul style="list-style-type: none"> <li>➤ Discharge of main pump.</li> <li>➤ Head of main pump.</li> <li>➤ Number of main pumps.</li> <li>➤ Jockey Pump output.</li> <li>➤ Jockey Pump head.</li> <li>➤ Standby Pump output.</li> <li>➤ Standby Pump head.</li> <li>➤ Auto Starting / Manual Stopping.</li> </ul> </li> <li>• <b>Terrace Level</b> <ul style="list-style-type: none"> <li>➤ Discharge of pump.</li> <li>➤ Head of pump.</li> <li>➤ Power supply.</li> <li>➤ Auto starting of pump.</li> </ul> </li> </ul>		Not required		
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		900 LPM	900 & 180 LPM	MR
		Required	40 mtr each	MR
		Required	Provided	MR
		Required	Provided	MR
	14.	<b>Captive water storage for Fire Fighting.</b>		
<ul style="list-style-type: none"> <li>• Underground tank capacity. <ul style="list-style-type: none"> <li>➤ Draw-off connection.</li> <li>➤ Fire Service Inlet.</li> <li>➤ Access to tank.</li> </ul> </li> <li>• Overhead tank capacity.</li> </ul>		1,50,000 ltrs	75,000 ltrs	MR
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		10,000 ltrs	10,000 ltrs	MR
15.	<b>Exit Signage.</b>	Required	Provided	MR
16.	<b>Provision of Lifts.</b>			
<ul style="list-style-type: none"> <li>• Pressurization of lift shaft.</li> <li>• Pressurization of lift lobby.</li> <li>• Communication in lift car.</li> <li>• Fireman's switch.</li> <li>• Lift signage.</li> </ul>		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
17.	<b>Standby Power Supply</b>	Required	Provided	MR
18.	<b>Refuge Area</b>			
<ul style="list-style-type: none"> <li>• Total area</li> <li>• Location</li> </ul>		N/A	N/A	N/A
		N/A	N/A	N/A

N/24

19.	<b>Fire Control Room.</b> <ul style="list-style-type: none"> <li>• Detector System Panel.</li> <li>• Flow Switch Panel.</li> <li>• PA system Panel.</li> <li>• Battery backup</li> <li>• Building floor plan</li> </ul>	Not required		
		N/A	Provided	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	Provided	N/A
		N/A	N/A	N/A
20.	<b>Special Fire Protection System for the Protection of special Risk, if any :</b>	Required	ABC type fire extinguishers provided near electrical panel	MR
<p>The Fire protection systems provided in the building were checked / operated and found functional at the time of inspection.</p> <p>Keeping in view the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under the rules, the FSC issued vide letter No. F6/DFS/MS/GH2014/SZ/1316 dated 21.10.2014, renewal under rule 37 of the Delhi Fire Service rules, 2010 is recommended.</p> <p>Accordingly, DFA is put up for approval and signature please.</p> <div style="text-align: right; margin-top: 20px;">               Signature of the Inspecting Officer              Name : R.N. Singh              Designation: ADO         </div>				

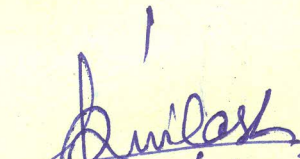
Renewal

M/s Haldiram Restt., B-1, H-8, M.C.I.E., Main Mathura Road, New Delhi

D.O. (SD)

Please clarify how the U/G water storage is meeting the requirement at Sr. No. 14 of your inspection note.

  
R.N.S.

  
28/9/12