

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001

No. F.6 DFS/MS/School/2017/SZ/ 1542

Dated: 27/10/17

FIRE SAFETY CERTIFICATE

Certified that **Ambience Public School** located at **Plot No A-1, Safdarjung Enclave, New Delhi-110029**, comprises of **2 tier basement, ground and four upper floors** (lower basement & caretaker room at terrace floor are sealed) owned/occupied by **Ambience Education Society** was granted Fire Safety Certificate by this department vide letter No. F.6/DFS/MS/School/2014/SZ/1268 Dated 07/10/2014. The premises was re-inspected by officer concerned of this department on 04/10/2017 in presence of Mr. C Narayanan (Er.) and observed that the school building have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the building (**One Basement, Ground plus four upper floors only**) is fit for occupancy class "**Educational Building**" Group-B, as above with effect from the date of issue of this certificate for a period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 27/10/17 at New Delhi by

VK
23/10
(Vipin Kental)
Chief Fire Officer
Ph. 11-23412225

Copy to: -

1. The Principal, Ambience Public School at A-1, Safdarjung Enclave, New Delhi-110029
2. The Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi.

Conditions for the validity of Fire Safety Certificate

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of firefighting system.
4. This Certificate cannot be treated as regularization of unauthorized construction, if any.
5. The Owner/Occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules, 2010. The form is available on www.dfs.delhigovt.nic.in.
6. The Owner/Occupier shall apply for renewal of this Fire Safety Certificate to the Director in the form 'J' [sub rule (1) of rule 37] along with copy of this certificate, six months prior to its expiry. The form is available on www.dfs.delhigovt.nic.in.

INSPECTION REPORT				
1	Name & Address of the Building	AMBIENCE PUBLIC SCHOOL, Plot No A-1, Safdarjung Enclave, New Delhi-110029		
2	Type of Occupancy	Educational Building "Group-B" (School)		
3	Building Comprised of	B1 (sealed)+ B2 + Ground + 4 upper floors		
4	Type of Case	Renewal		
5	Details of Previous NOC	F.6/DFS/MS/School/2014/SZ/1268 Dated 07/10/2014		
6	Fire Safety Directives Letter No	F.6/DFS/MS/BP/2011/1093 Dated 03-06-2011		
7	Date of Inspection	04-10-2017		
8	Name of the Inspecting Officers	ADO R.N. Singh		
9	Name & Designation of Officers from the building side	Mr. C. Narayanan (Er.)		
10	Year of construction	2014 School running at B1 + GF + 4 upper floors		
11	Applicant letter No.	Nil dated 12/09/2017 ODD No. 11246 Dt. 14.09.17		
S. No	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC requirement	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	• Road width	6 mtr	13 mtr	MR
	• Gate width	6 mtr	6 mtr	MR
	• Width of internal road	6 mtr	6 mtr	MR
2	Number, width, type & arrangement of exits			
	a) Number of Staircase			
	➤ Upper floors	3 No's	3 No's	MR
	➤ Basement floor	3 No's	3 No's + 1 ramp	MR
	b) Width of Staircase			
	➤ Upper floors	2m	2m each	MR
	➤ Basement floor	2m & 1.5m	2m (two), 1.5m (one) and ramp (2way) 6m	MR
	c) Protection of exits			
	➤ Fire check door	Required	Provided	MR
	➤ Pressurization	Required	Provided	MR
	d) No. of continuous staircase to terrace	3 nos.	3 nos	MR
	e) Width of corridor	1.5m	1.5m	MR
	f) Door size	1m	1m	MR
3	Compartmentation.			
	• Fire check door.	Required	Provided	MR
	• Sealing of electrical shafts.	Required	Provided	MR
	• Fire rating of shaft door.	Required	Provided	MR
	• Water curtain	N/A	N/A	N/A
	• Fire dampers.	Required	Provided	MR
4.	Smoke Management system.			
	• Basement	30 ACPH	Provided	MR
	• Upper floors	12 ACPH	Provided	MR
5.	Fire Extinguishers.			
	• Total numbers	40 No's	46 Nos	MR
	• Types	ABC / Co2	ABC-26, W.Co2-20	MR
	• ISI Marking	ISI marked	Provided	MR
6.	First Aid Hose Reels.			
	• Total numbers on each floor.	3 No's	Provided	MR
	• Length of hose-reel hose.	30 m	Provided	MR
	• Nozzle Diameter	5 mm	Provided	MR


7	Automatic fire detection & alarming system			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooter's location 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
8.	MOEFA	Required	Provided	MR
9.	Public Address System	Required	Provided	MR
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basement Upper floors Sprinkler above false ceiling 	Required	Provided	MR
		N/A	Provided	N/A
		N/A	N/A	N/A
11.	Internal Hydrants.			
	<ul style="list-style-type: none"> Size of Riser/Down-comer Number of Hydrant per floor Hose box. 	150 mm	Provided	MR
		3 No's	Provided	MR
		3 No's	Provided	MR
12.	Yard Hydrants.			
	<ul style="list-style-type: none"> Total number of hydrants. Hose box. 	N/A	N/A	N/A
		N/A	N/A	N/A
13.	Pumping arrangements.			
	<ul style="list-style-type: none"> Ground Level <ul style="list-style-type: none"> Discharge of main pump. Head of main pump. Number of main pumps. Jockey Pump output. Jockey Pump head. Standby Pump output. Standby pump head. Auto Starting/Manual Stopping. Terrace Level <ul style="list-style-type: none"> Discharge of pump. Head of pump. Power supply. Auto starting of pump. 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		900 LPM	900 LPM (2 nos.)	MR
		40 mtr	40 mtr each	MR
		Required	Provided	MR
		Required	Provided	MR
14.	Captive water storage for Fire Fighting.			
	<ul style="list-style-type: none"> Underground tank capacity. <ul style="list-style-type: none"> Draw-off connection. Fire Service Inlet. Access to tank. Overhead tank capacity. 	N/A	N/A	N/A
		Required	Provided	MR
		Required	Provided	MR
		N/A	N/A	N/A
		50,000 ltrs	50,000 ltrs	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provisions of Lifts.			
	<ul style="list-style-type: none"> Pressurization of lift shaft. Pressurization of lift lobby. Communication in lift car. Fireman's switch. Lift signage. 	Required	Provided	MR
		Required	Provided	MR
		Required	Provided	MR
		Required	Provided	MR
		Required	Provided	MR
17	Standby Power Supply	Required	DG Set provided	MR
18.	Refuge Area			
	<ul style="list-style-type: none"> Total area Location 	N/A	N/A	N/A
		N/A	N/A	N/A

19.	Fire Control Room.			
	• Detector System Panel.	N/A	N/A	N/A
	• Flow Switch Panel.	Required	Provided	MR
	• PA system Panel.	Required	Provided	MR
	• Battery backup	Required	Provided	MR
	• Building floor plan	Required	Provided	MR
20.	Special Fire Protection System for the Protection of special Risk, if any.	N/A	N/A	N/A

The Fire protection systems provided in the building were checked / operated and found functional at the time of inspection.

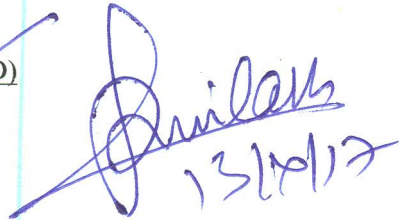
Keeping in view the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under the rule, FSC issued vide letter No. F.6/DFS/MS/School/2014/SZ/1268 dated 07/10/2014, renewal under rule 37 of the Delhi Fire Service rules, 2010 is recommended. ✓

Accordingly, DFA is put up for approval and signature please.



 Signature of the Inspecting Officer
 Name: R.N. Singh
 Designation: ADO

Ambience Public School, Plot No A-1, Safdarjung Enclave, New Delhi-110029

D.O. (SD)


13/10/17




13/7

1306 / CF SR
18/12




CFR SR

M. SCELL

17/10

BT letter is put up for sign/ple.

CFR SR


18/17

M. SCELL

23/10