

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001

No. F.6 DFS/MS/School/2017/SZ/ 1547

Dated: 27/10/17

FIRE SAFETY CERTIFICATE

Certified that the **B.S.D. Academy** located at **G-292/12, Near Shooting Range, Sangam Vihar, New Delhi-110062** is running at ground floor of a building comprised of **Basement and Ground floor** was issued FSC by this department vide letter No. F.6/DFS/MS/School/2014/SZ/1207 dated 16/09/2014. The premises was re-inspected by officer concerned of this department on 27/09/2017 in presence of Mr. B.S. Deswal, Manager of the school and found that said school building have deemed complied with the fire prevention and fire safety requirements in accordance with Directorate of Education circular F.16//Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011 issued by Director of Education and that the school building is fit for occupancy class "**Educational Building**" Group-B, with effect from the date of issue of this certificate for a period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 27/10/17 at New Delhi by


(Vipin Kental)
Chief Fire Officer
Ph. 011-23412225


Copy to: -

1. Manager, BSD Academy, G-292/12, Near Shooting Range, Sangam Vihar, New Delhi.
2. The Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi.

Conditions for the validity of Fire Safety Certificate

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of firefighting system.
4. This Certificate cannot be treated as regularization of unauthorized construction, if any.
5. The Owner/Occupier, shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules, 2010. The form is available on www.dfs.delhigovt.nic.in.
6. The Owner/Occupier shall apply for renewal of this Fire Safety Certificate to the Director in the form 'J' [sub rule (1) of rule 37] along with copy of this certificate, six months prior to its expiry. The form is available on www.dfs.delhigovt.nic.in.

INSPECTION REPORT

1	Name & Address of the Building	B.S.D. ACADEMY, G-292/12, NEAR SHOOTING RANGE, SANGAM VIHAR, NEW DELHI-110062		
2	Type of Occupancy	Educational Building "Group-B" (School)		
3	Building Comprised of	Basement and Ground floor only.		
4	Type of Case	Renewal		
5	Details of Previous NOC	F.6/DFS/MS/School/2014/SZ/1207 dated 16-09-2014		
6	Fire Safety Directives Letter No	F.16//Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011		
7	Date of Inspection	27-09-2017		
8	Name of the Inspecting Officers	ADO R.N. Singh		
9	Name & Designation of Officers from the building side	Mr. BS Deswal (Manager)		
10	Year of construction	2011-12 School is running at ground floor only.		
11	Applicant letter No.	1145 Dated 28.09.2017		
S. No	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC requirement	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	• Road width	Required	6 mtr	MR
	• Gate width	N/A	directly assessable from main road	N/A
	• Width of internal road	N/A	N/A	N/A
2	Number, width, type & arrangement of exits			
	a) Number of Staircase			
	➤ Upper floors	N/A	N/A	N/A
	➤ Basement floor	N/A	N/A	N/A
	b) Width of Staircase			
	➤ Upper floors	GF only	N/A	N/A
	➤ Basement floor	N/A	N/A	N/A
	c) Protection of exits			
	➤ Fire check door	N/A	N/A	N/A
	➤ Pressurization	N/A	N/A	N/A
	d) No. of continuous staircase to terrace	N/A	N/A	N/A
	a) Width of corridor	N/A	N/A	N/A
	f. Door size	N/A	N/A	N/A
3	Compartmentation.			
	• Fire check door.	N/A	N/A	N/A
	• Sealing of electrical shafts.	N/A	N/A	N/A
	• Fire rating of shaft door.	N/A	N/A	N/A
	• Water curtain	N/A	N/A	N/A
	• Fire dampers.	N/A	N/A	N/A
4.	Smoke Management system.			
	• Basement	30 ACPH	N/A	N/A
	• Upper floors	12 ACPH	N/A	N/A
5.	Fire Extinguishers.			
	• Total numbers	02 No's	02 No's	MR
	• Types	ABC / Co2	ABC-12	MR
	• ISI Marking	ISI Marked	Provided	MR
6.	First aid Hose-reels.			
	• Total numbers on each floor.	N/A	N/A	N/A
	• Length of hose-reel hose.	N/A	N/A	N/A
	• Nozzle Diameter	N/A	N/A	N/A

7	Automatic fire detection & alarming system.			
	• Type of detectors	N/A	N/A	N/A
	• Location of Main Panel	N/A	N/A	N/A
	• Location of Repeater Panel	N/A	N/A	N/A
	• Alternate source of power	N/A	N/A	N/A
	• Hooter's location	N/A	N/A	N/A
8.	MOEFA	N/A	N/A	N/A
9.	Public Address System	N/A	N/A	N/A
10.	Automatic Sprinkler System			
	• Basement.	N/A	N/A	N/A
	• Upper floors	N/A	N/A	N/A
	• Sprinkler above false ceiling	N/A	N/A	N/A
11.	Internal Hydrants.			
	• Size of Riser/Down-comer	N/A	N/A	N/A
	• Number of Hydrant per floor	N/A	N/A	N/A
	• Hose box.	N/A	N/A	N/A
12.	Yard Hydrants.			
	• Total number of hydrants.	N/A	N/A	N/A
	• Hose box.	N/A	N/A	N/A
13.	Pumping arrangements.			
	a) Ground Level			
	➤ Discharge of main pump.	N/A	N/A	N/A
	➤ Head of main pump.	N/A	N/A	N/A
	➤ Number of main pumps.	N/A	N/A	N/A
	➤ Jockey Pump output.	N/A	N/A	N/A
	➤ Jockey Pump head.	N/A	N/A	N/A
	➤ Standby Pump output.	N/A	N/A	N/A
	➤ Standby Pump head.	N/A	N/A	N/A
	➤ Auto Starting / Manual Stopping.	N/A	N/A	N/A
	➤ Pump house access.	N/A	N/A	N/A
	b) Terrace Level			
	➤ Discharge of pump.	N/A	N/A	N/A
	➤ Head of pump.	N/A	N/A	N/A
	➤ Power supply.	N/A	N/A	N/A
	➤ Auto starting of pump.	N/A	N/A	N/A
14.	Captive water storage for Fire Fighting.			
	• Underground tank capacity.	N/A	N/A	N/A
	➤ Draw-off connection.	N/A	N/A	N/A
	➤ Fire Service Inlet.	N/A	N/A	N/A
	➤ Access to tank.	N/A	N/A	N/A
	• Overhead tank capacity.	N/A	N/A	N/A
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	• Pressurization of lift shaft.	N/A	N/A	N/A
	• Pressurization of lift lobby.	N/A	N/A	N/A
	• Communication in lift car.	N/A	N/A	N/A
	• Fireman's switch.	N/A	N/A	N/A
	• Lift signage.	N/A	N/A	N/A
17	Standby Power Supply	N/A	N/A	N/A
18.	Refuge Area			
	• Total area	N/A	N/A	N/A
	• Location	N/A	N/A	N/A


19.	Fire Control Room. <ul style="list-style-type: none"> • Detector System Panel. • Flow Switch Panel. • PA system Panel. • Battery backup • Building floor plan 	N/A	N/A	N/A
20.	Special Fire Protection System for the Protection of special Risk, if any.	N/A	N/A	N/A

Basement floor is rented out by school management and running trade of printing banners etc. undertaking regarding storage of non hazardous and inflammable material submitted by manager/owner of school.

The Fire protection systems provided in the building were checked / operated and found functional at the time of inspection.


Keeping in view the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under the rule, FSC issued vide letter No. F.6/DFS/MS/School/2014/SZ/1207 dated 16/09/2014, renewal under rule 37 of the Delhi Fire Service rules, 2010 is recommended.


Accordingly, DFA is put up for approval and signature please.





Signature of the Inspecting Officer
 Name : R.N. Singh
 Designation: ADO

BSD ACADEMY, G-292/12, NEAR SHOOTING RANGE, SANGAM VIHAR, NEW DELHI

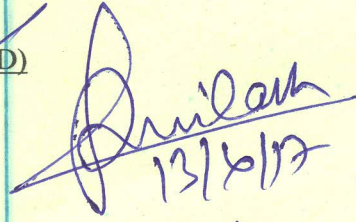DO (SD)

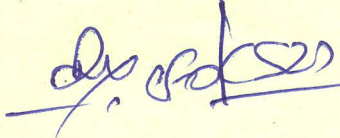 13/8/17





 13/8


Chf Sd/ M. S. Cell FT 10.

 17/10.

1303/cfasc
 18/8.



1219/cfasc
 23/8.

FT letter is put up for sign. file

 18/17

cro/92
 m-s cell 
 23/10