

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001

No. F.6 DFS/MS/School/2017/SZ/ 1538

Dated: 27/10/17...

FIRE SAFETY CERTIFICATE

Certified that **Govt. Girls Secondary School** located at **J.J. Colony, Madanpur Khadar, New Delhi-110076**, comprised of **Ground floor only** was issued Fire Safety Certificate by this department vide letter No. F.6/DFS/MS/School/2015/SZ/500 dated 01/04/2015. The premise was re-inspected by officer concerned of this department on 06/10/2017 in the presence of Mr. Abdul Mohit (JE) and observed that old school building has been removed and new building block, comprised of ground plus three upper floors has been constructed in its place and that new school block have complied with the fire prevention and fire safety requirements in accordance with rule 33 of Delhi Fire Service Rules, 2010 and that the school building is fit for occupancy class "**Educational Building**" Group-B, as above with effect from the date of issue of this certificate for a period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 27/10/17 at New Delhi by


(Vipin Kental)
Chief Fire Officer
Tel. 011-23412225

Copy to: -

1. The Principal, Govt. Girls Secondary School, J.J. Colony, Madanpur Khadar, New Delhi.
2. The AE (E), Edn. (Maint) Sub Divn M1-1, PWD, ITI Campus, Pusa, New Delhi- 110012


Conditions for the validity of Fire Safety Certificate

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of firefighting system.
4. This Certificate cannot be treated as regularization of unauthorized construction, if any.
5. The Owner/Occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules, 2010. The form is available on www.dfs.delhigovt.nic.in.
6. The Owner/Occupier shall apply for renewal of this Fire Safety Certificate to the Director in the form 'J' [sub rule (1) of rule 37] along with copy of this certificate, six months prior to its expiry. The form is available on www.dfs.delhigovt.nic.in.

INSPECTION REPORT


1	Name & Address of the Building	GOVT GIRLS SECONDARY SCHOOL, J.J. COLONY, Madanpur Khadar, New Delhi- 76 (ID-1925340)		
2	Type of Occupancy	Group-B, "Educational Building" (School)		
3	Building Comprised of	Ground + three upper floors. (Newly constructed)		
4	Type of Case	New		
5	Details of Previous NOC	F.6/DFS/MS/School/2016/SZ/500 Dated 01-04-2016		
6	Fire Safety Directives Letter No	Nil		
7	Date of Inspection	06-10-017		
8	Name of the Inspecting Officers	ADO R.N. Singh		
9	Name & Designation of Officers from the building side	Mr. Abdul Mohit (JE)		
10	Year of construction	2016		
11	Applicant letter No.	GGSS/143 Dated 11-09-2017		
S. No	Minimum standards on Fire Prevention and Fire Safety U/R 33	NBC / BBL requirement	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	• Road width	6 mtr	6 mtr	MR
	• Gate width	4.5 mtr	4.5 mtr	MR
	• Width of internal road	-NA-	NA	-NA-
2	Number, width, type & arrangement of exits.			
	a) Number of Staircase			
	➤ Upper floors	4 No's	4 No's	MR
	➤ Basement floor	-NA-	-NA-	-NA-
	b) Width of Staircase			
	➤ Upper floors	1.50 mtr	1.80 mtr each	MR
	➤ Basement floor	-NA-	-NA-	-NA-
	c) Protection of exits			
	➤ Fire check door	-NA-	-NA-	-NA-
	➤ Pressurization	-NA-	-NA-	-NA-
	d) No. of continuous staircase to terrace	Required	Two	MR
	e) Width of corridor	-NA-	-NA-	-NA-
	f) Door size	1 mtr	Provided	MR
3	Compartmentation.			
	• Fire check door.	-NA-	-NA-	-NA-
	• Sealing of electrical shafts.	-NA-	-NA-	-NA-
	• Fire rating of shaft door.	-NA-	-NA-	-NA-
	• Water curtain	-NA-	-NA-	-NA-
	• Fire dampers.	-NA-	-NA-	-NA-
4.	Smoke Management system.			
	• Basement.	-NA-	-NA-	-NA-
	• Upper floors	-NA-	-NA-	-NA-
5.	Fire Extinguishers.			
	• Total numbers	24 Nos	36 Nos	MR
	• Types	ABC/ Co2	ABC- 32, Co2-04	MR
	• ISI Marking	ISI marked	Provided	MR
6.	First Aid Hose Reels.			
	• Total numbers on each floor.	4 Nos	Provided	MR
	• Length of hose-reel hose.	30m	Provided	MR
	• Nozzle Diameter	5mm	Provided	MR

7	Automatic fire detection & alarming system.			
	• Type of detectors	-NA-	-NA-	-NA-
	• Location of Main Panel	-NA-	-NA-	-NA-
	• Location of Repeater Panel	-NA-	-NA-	-NA-
	• Alternate source of power	-NA-	-NA-	-NA-
	• Hooter's location	-NA-	-NA-	-NA-
8.	MOEFA / SIREN	-NA-	-NA-	-NA-
9.	Public Address System	-NA-	-NA-	-NA-
10.	Automatic Sprinkler System			
	• Basement.	-NA-	-NA-	-NA-
	• Upper floors	-NA-	-NA-	-NA-
	• Sprinkler above false ceiling	-NA-	-NA-	-NA-
11.	Internal Hydrants.			
	• Size of Riser / Down-comer	-NA-	-NA-	-NA-
	• Number of Hydrant per floor	-NA-	-NA-	-NA-
	• Hose box.	-NA-	-NA-	-NA-
12.	Yard Hydrants.			
	• Total number of hydrants.	-NA-	-NA-	-NA-
	• Hose box.	-NA-	-NA-	-NA-
13.	Pumping arrangements.			
	• Ground Level			
	➤ Discharge of main pump.	-NA-	-NA-	-NA-
	➤ Head of main pump	-NA-	-NA-	-NA-
	➤ Number of main pumps.	-NA-	-NA-	-NA-
	➤ Jockey Pump output.	-NA-	-NA-	-NA-
	➤ Jockey Pump head.	-NA-	-NA-	-NA-
	➤ Standby Pump output.	-NA-	-NA-	-NA-
	➤ Standby Pump head.	-NA-	-NA-	-NA-
	➤ Auto Starting / Manual Stopping.	-NA-	-NA-	-NA-
	• Terrace Level			
	➤ Discharge of pump.	450 LPM	450 LPM × 2	MR
	➤ Head of pump.	40 mtr	40 mtr each	MR
	➤ Power supply.	Required	Provided	MR
	➤ Auto starting of pump.	Required	Provided	MR
14.	Captive water storage for Fire Fighting.			
	• Underground tank capacity.	-NA-	-NA-	-NA-
	➤ Draw-off connection.	-NA-	-NA-	-NA-
	➤ Fire Service Inlet.	-NA-	-NA-	-NA-
	➤ Access to tank.	-NA-	-NA-	-NA-
	• Overhead tank capacity.	10,000 ltrs	10,000 ltrs	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	• Pressurization of lift shaft.	-NA-	-NA-	-NA-
	• Pressurization of lift lobby.	-NA-	-NA-	-NA-
	• Communication in lift car.	-NA-	-NA-	-NA-
	• Fireman's switch.	-NA-	-NA-	-NA-
	• Lift signage.	-NA-	-NA-	-NA-
17	Standby Power Supply	-NA-	-NA-	-NA-
18.	Refuge Area			
	• Total area	-NA-	-NA-	-NA-
	• Location	-NA-	-NA-	-NA-

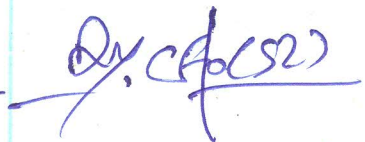
19.	Fire Control Room.			
	• Detector System Panel.	-NA-	-NA-	-NA-
	• Flow Switch Panel.	-NA-	-NA-	-NA-
	• PA system Panel.	-NA-	-NA-	-NA-
	• Battery backup	-NA-	-NA-	-NA-
	• Building floor plan	-NA-	-NA-	-NA-
20.	Special Fire Protection System for the Protection of special Risk, if any.			-NA-
<p>The old school building comprised of ground floor only was granted FSC by this department vide letter no. F.6/DFS/MS/School/2016/SZ/500 dated 01/04/2016. The same has been removed and new building block comprised of ground plus three upper floors have been constructed by PWD, Govt. of NCT of Delhi.</p>				
<p>The Fire protection systems provided in new building block were checked / operated and found functional at the time of inspection.</p>				
<p>Keeping in view of the substantially satisfactory compliance of the minimum standards on fire prevention and fire safety measures as required under the rules, it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules, 2010</p>				
<p>Accordingly DFA is put up for approval and signature please.</p>				
<p style="text-align: right;">  Signature of the Inspecting Officer Name : R.N. Singh Designation: ADO </p>				


Govt. Girls Secondary School, J.J. Colony, Madanpur Khadar, New Delhi

D.O (SD)


13/6/17

1202/cf-32
18/11/2017


13/6/17


13/7



CFD 15/11

M.S cell

17/10

F7/101.

R.T. letter is put up for signature
18/11/17

CFD 15/11

M.S cell

24/10